SEPA Implementation Guidance for the Interim Enhanced Surface Water Treatment Rule

This document does not substitute for EPA regulation nor is this document regulation itself. Thus, it cannot impose legally-binding requirements on EPA, states, or the regulated community, and may not apply to a particular situation based upon the circumstances.

Contents

Introduction	·····	ix
Section I.	Rule Requirements	. 1
A.	IESWTR Executive Summary	
B.	Key Dates for the IESWTR	
O /* **		
Section II.	SDWIS Reporting and SNC Definitions	
A.	Safe Drinking Water Information System (SDWIS) Reporting Under the IESWTR	
D	A.1 Federally Reported Violations	
В.	SNC Definitions for the IESWTR	11
Section III.	State Primacy Revision Applications	. 1
A.	State Primacy Program Revision	. 3
	A.1 The Revision Process	. 5
	A.2 The Final Review Process	. 7
B.	State Primacy Program Revision Extensions	. 7
	B.1 The Extension Process	. 7
	B.2 Criteria that an Extension Request Must Meet	. 7
	B.3 Conditions of the Extension	. 8
C.	State Primacy Package	
r	C.1 Section I—The State Primacy Revision Checklist (40 CFR 142.10)	
	C.2 Section II—Text of the State's Regulation	
	C.3 Section III—Primacy Revision Crosswalk	
	C.4 Section IV—State Reporting and Recordkeeping Checklists	
	C.5 Section V—Special Primacy Requirements (40 CFR 142.16)	
_	C.6 Section VI—Attorney General's Statement of Enforceability	
D.	Guidance for IESWTR Special Primacy Requirements	15
Section IV.	Other Resources and Guidance	1
A.	Technical Information Available on the IESWTR	
B.	Profiling Spreadsheet	
C.	List of Labs Approved to Perform Analysis for ICR	. 5
D.	Rule Presentation	
E.	Fact Sheets	
F.	Frequently Asked Questions	
Appendices		
Appendix A	Primacy Revision Crosswalk	1 -1
Appendix B	Sample Extension Agreement	3-1
Appendix C	Statement of Principles—Guidance on Audit Law Issues	
Appendix D	IESWTR Plain English Summary	
Appendix E	IESWTR Rule Language	
Appendix F	Examples of IESWTR Monitoring Forms for States	- 1

Regional Contacts



Region I

Kevin Reilly 617-918-1694 Linda Tsang 617-918-1395

Region II

Michael Lowy 212-637-3830

Region III

Jason Gambatese 215-814-5759

Region IV

David Parker 404-562-9460

Region V

Miguel Del Toral 312-886-5253

Region VI

Blake Atkins 214-665-2297

Region VII

Ralph Flournoy 913-551-7374

Region VIII

Bob Clement 303-312-6653

Region IX

Bruce Macler 415-744-1884

Region X

Wendy Marshall 206-553-1890

State Contacts

REGION I

Connecticut Gerald Iwan

Maine Nancy Beardsley

Massachusetts David Terry

New Hampshire Anthony Giunta

Rhode Island
June Swallow

Vermont Jay Rutherford

REGION II

New Jersey Vince Monaco

New York Ron Entringer

Puerto Rico Olga Rivera

US Virgin Islands Christine Lottis **REGION III**

<u>Delaware</u> Ed Hallock

Maryland Nancy Reilman

Pennsylvania John Wroblewski

Virginia John Capito Bob Taylor

West Virginia
Vic Wilford

REGION IV

Alabama Joe Alan Power

<u>Florida</u> Van Hoofnagle

Georgia Onder Serefli

Kentucky Vicki Ray

Mississippi David Mitchell

North Carolina Jessica Miles

South Carolina Alton C. Boozer

<u>Tennessee</u> W. David Draughon

REGION V

Illinois
Dave Antonacci
Mike Crumly
Jerry Kuhn
Eric Portz

Roger Selburg

Indiana Stacy Jones Jill Shalabi

Michigan James Cleland

Minnesota Dennis E. Maki

Ohio Kirk Leifheit

Wisconsin Robert Baumeister

REGION VI

Arkansas Harold R. Seifert

Louisiana Bobby Savoie

New Mexico Robert Gallegos

Oklahoma Jon L. Craig

<u>Texas</u> Steven Walden

REGION VII

<u>Iowa</u> Dennis Alt

Kansas Dave Waldo

Missouri Terry Timmons

<u>Nebraska</u> Jack Daniel

REGION XIII

<u>Colorado</u> Jerry Biberstine

Montana John Camden

North Dakota Larry Thelen

South Dakota Garland Erbele

<u>Utah</u> Russ Topham

Wyoming Gary Beach

REGION IX

American Samoa Sheila Wiegman

Arizona Jeff Stuck

California David P. Spath

Guam Fred Castro

<u>Hawaii</u> Bill Wong

<u>Nevada</u> Galen Denio

Northern Mariana Islands Miriam Seman

REGION X

Alaska James Weise

<u>Idaho</u> Tom John

Oregon Michael Grimm

Washington Jim Hudson

Abbreviations Used in This Document

"C": Residual Disinfectant Concentration

BAT: Best Available Technology

CCP: Composite Correction Program

CCR: Consumer Confidence Report

CDC: Centers for Disease Control

CFE: Combined Filter Effluent

CFR: Code of Federal Regulations

CPE: Comprehensive Performance Evaluation

CT: Residual Disinfectant Concentration in mg/l "C" x Disinfectant Contact Time in min "T"

CTA: Comprehensive Technical Assistance

CWS: Community Water System

DBP: Disinfection Byproducts

DBPP: Disinfection Byproducts Precursors

DBPR: Disinfectants/Disinfection Byproducts Rule

DE: Diatomaceous Earth

DTF: Data Transfer Format

DWPD: Drinking Water Protection Division

EC: Enhanced Coagulation

EPA: United States Environmental Protection Agency

ES: Enhanced Softening

ESWTR: Enhanced Surface Water Treatment Rule

FACA: Federal Advisory Committee Act

FR: Federal Register

FRDS: Federal Reporting Data System

GAC10: Granular activated carbon with ten minute empty bed contact time and 180 day reactivation

frequency

GWR: Ground Water Rule

GWUDI: Ground Water Under the Direct Influence of Surface Water

HAA5: Haloacetic acids (Monochloroacetic, Dichloroacetic, Trichloroacetic, Monobromoacetic and

Dibromoacetic Acids) HAV: Hepatitis A Virus

hrs: Hours

ICR: Information Collection Rule

IESWTR: Interim Enhanced Surface Water Treatment Rule

IFA: Individual Filter Assessment

Log Inactivation: Logarithm of (N₀/N_T)

Log: Logarithm (common, base 10)

LT1ESWTR: Long Term 1 Enhanced Surface Water Treatment Rule LT2ESWTR: Long Term 2 Enhanced Surface Water Treatment Rule

LTESWTR: Long Term Enhanced Surface Water Treatment Rule

MCL: Maximum Contaminant Level

MCLG: Maximum Contaminant Level Goal

M-DBP: Microbial and Disinfectants/Disinfection Byproducts

MPA: Microscopic Particulate Analysis

M/R: Monitoring/Reporting

MRDL: Maximum Residual Disinfectant Level

MRDLG: Maximum Residual Disinfectant Level Goal

NCWS: Non-Community Water System

NIPDWR: National Interim Primary Drinking Water Regulation

NPDES: National Pollutant Discharge Elimination System

NPDWR: National Primary Drinking Water Regulation

NSCEP: National Service for Environmental Publications

NTIS: National Technical Information Service

NTNCWS: Non-Transient Non-Community Water System

NTU: Nephelometric Turbidity Unit OAR: Office of Air and Radiation

OECA: Office of Enforcement and Compliance Assurance

OGC: Office of General Counsel

OGWDW: Office of Ground Water and Drinking Water

OMB: Office of Management and Budget

ORC: Office of Regional Counsel

OSWER: Office of Solid Waste and Emergency Response

OW: Office of Water PWS: Public Water System

PWSS: Public Water Supply Supervision Program

Reg. Neg.: Regulatory Negotiation

SDWA: Safe Drinking Water Act, or "The Act," as amended 1996

SDWIS: Safe Drinking Water Information System

SNC: Significant Non-Compliance

Subpart H: PWS using surface water or ground water under the direct influence of surface water

SUVA: Specific Ultraviolet Absorption SWTR: Surface Water Treatment Rule

"T": Disinfectant Contact Time

TCR: Total Coliform Rule

TNCWS: Transient Non-Community Water System

TOC: Total Organic Carbon
TT: Treatment Technique
TTHM: Total Trihalomethanes

UV: Ultraviolet

x log removal: Reduction to 1/10x of original concentration

Introduction

This document provides guidance to EPA Regions and states exercising primary enforcement responsibility under the Safe Drinking Water Act (SDWA) concerning how EPA interprets the Interim Enhanced Surface Water Treatment Rule (IESWTR) under SDWA. It also provides guidance to the public and the regulated community on how EPA intends to exercise its discretion in implementing the statute and regulations. This guidance is designed to implement national policy on these issues.

The SDWA provisions and EPA regulations described in this document contain legally binding requirements. This document does not substitute for those provisions or regulations, nor is it a regulation itself. It does not impose legally-binding requirements on EPA, states, or the regulated community, and may not apply to a particular situation based upon the circumstances. EPA and state decisionmakers retain the discretion to adopt approaches on a case-by-case basis that differ from this guidance where appropriate. Any decisions regarding a particular facility will be made based on the applicable statutes and regulations. Therefore, interested parties are free to raise questions and objections about the appropriateness of the application of this guidance to a particular situation, and EPA will consider whether or not the recommendations or interpretations in the guidance are appropriate in that situation based on the law and regulations. EPA may change this guidance in the future.

This manual was developed through a workgroup process involving Regions, states, and stakeholders, and contains the following sections:

Section I summarizes the IESWTR and presents a timetable of important dates for this rule. Section II addresses violation determination and associated reporting requirements to assist states in their compliance activities. Section III covers state primacy revision requirements, including a detailed timeframe for application review and approval. This section also contains guidance and references to help states adopt each new special primacy requirement included in these rules. Section IV contains a series of "stand-alone" guidance materials that will help states and public water systems comply with the new requirements.

The Appendices of this document also provide information that will be useful to states and EPA Regions throughout the primacy revision application process. Appendix A contains the primacy revision application crosswalk for the rule. Appendix B contains a sample extension agreement between EPA and a state which will allow the state and EPA to document how they will share rule implementation responsibilities if the state does not submit a primacy application by the deadline. Appendix C contains a "Statement of Principles" which outlines the criteria EPA will use to determine whether states with audit laws have retained adequate enforcement and information gathering authority to meet the requirements of the Safe Drinking Water Act (SDWA). Appendix D contains a Plain English summary of the rule. Appendix E contains the rule language of IESWTR incorporating the technical amendments. Appendix F contains sample monitoring forms that can be used as a template by states developing their own forms.

EPA and state decision makers retain the discretion to adopt approaches on a case-by-case basis that differ from this guidance where appropriate. Any decisions regarding a particular facility will be made based on the applicable statutes and regulations. Therefore, interested parties are free to raise questions and objections about the appropriateness of the application of this guidance to a particular situation, and EPA will consider whether or not the recommendations or interpretations in the guidance are appropriate in that situation. EPA may change this guidance in the future.

Section I. Rule Requirements

I-A. IESWTR Executive Summary

Purpose

The purpose of this summary is to acquaint state decision-makers and public health officials with the Interim Enhanced Surface Water Treatment Rule (IESWTR). The IESWTR, published in the *Federal Register* on December 16, 1998 (63 FR 69478; www.epa.gov/OGWDW/mdbp/ieswtrfr.html; 66 FR 3770; www.epa.gov/safewater/mdbp/iesfr.html; Appendix E—rule language only), is the first part of a series of rules, the "Microbial-Disinfectants/Disinfection Byproducts Cluster" (M-DBP Cluster), to be published over the next several years that are intended to control microbial pathogens while minimizing the public health risks of disinfectants and disinfection byproducts (DBPs). The IESWTR is designed to address the health risks from microbial contaminants without significantly increasing the potential risks from chemical contaminants. This rule was published concurrently with the Stage 1 Disinfectants/Disinfection Byproducts Rule (Stage 1 DBPR), which addresses control of disinfectants and their byproducts.

Background

The 1974 Safe Drinking Water Act (SDWA) called for EPA to regulate drinking water by creating the national interim primary drinking water regulations (NIPDWR). In 1979, the first interim standard addressing DBPs was set for total trihalomethanes (TTHMs), a group of four volatile organic chemicals which form when disinfectants react with natural organic matter in the water.

Although SDWA was amended slightly in 1977, 1979, and 1980, the most significant changes to the 1974 law occurred when SDWA was reauthorized in 1986. Disease-causing microbial contamination had not been sufficiently controlled under the original Act. To safeguard public health, the 1986 Amendments required EPA to set health goals, or maximum contaminant level goals (MCLGs) and maximum contaminant levels (MCLs) for 83 named contaminants. EPA was also required to establish regulations within certain time frames, require disinfection of all public water supplies, specify filtration requirements for nearly all water systems that draw their water from surface sources, and develop additional programs to protect ground water supplies.

In 1989, EPA issued two important National Primary Drinking Water Regulations (NPDWR): The Total Coliform Rule (TCR) (40 CFR 141.21) and the Surface Water Treatment Rule (SWTR) (40 CFR 141 Subpart H). The TCR and SWTR provide the foundation for the M-DBP Cluster and are summarized below.

The TCR covers all public water systems. Since coliforms are easily detected in water, they are used to indicate a water system's vulnerability to pathogens in the water. In the TCR, EPA set a MCLG of zero for total coliforms. EPA also set a MCL for total coliforms. If more than 5.0 percent of the samples contain coliforms within a month, water system operators must report this violation to the state and the public. In addition, sanitary surveys are required every five or ten years (depending on the quality of the source water) for every system that collects fewer than five samples per month (typically systems that serve less than 4,100 people).

EPA issued the SWTR in response to Congress' mandate requiring disinfection, and where necessary, filtration of systems that draw their water from surface sources before distribution. The SWTR applies to all systems that use surface water or ground water under the direct influence of surface water (GWUDI). The rule sets MCLGs for *Legionella*, *Giardia lamblia*, and viruses at zero since any exposure to these contaminants presents some level of health risk.

Specifically, the rule requires that a surface water system have sufficient treatment to reduce the source water concentration of *Giardia lamblia* and viruses by at least 99.9 percent (3 log) and 99.99 percent (4 log), respectively. A detectable disinfection residual must be maintained throughout the entire distribution system. For systems that filter, the adequacy of the filtration process is determined by measuring the turbidity of the treated water since high levels of turbidity often indicate that the filtration process is not working properly. The goal of the SWTR is to reduce risk to less than one infection per year per 10,000 people. However, the SWTR does not account for systems with high pathogen concentrations that, when treated at the levels required under the rule, still may not meet this health goal, and the rule does not specifically control for the protozoan *Cryptosporidium*.

In 1990, EPA's Science Advisory Board, an independent panel of experts established by Congress, cited drinking water contamination as one of the most important environmental risks and indicated that disease-causing microbial contaminants (i.e., bacteria, protozoa, and viruses) are probably the greatest remaining health-risk management challenge for drinking water suppliers. Data from the Centers for Disease Control (CDC) confirm this concern and indicate that between 1980 and 1994, 379 waterborne disease outbreaks were reported, with over 500,000 cases of disease. During this period, a number of agents were implicated as the cause, including protozoa, viruses, bacteria, and several chemicals. Most of the cases (but not the outbreaks) were associated with surface water, including a single outbreak of cryptosporidiosis in Milwaukee (over 400,000 cases).

In response to these findings, the SDWA was further amended in 1996 to improve public health protection by incorporating new data on the adverse health effects of contaminants, the occurrence of contaminants in public water systems, and the estimated reduction in health risks that would result from further regulation. The Act also increased scientific research requirements and emphasized cost-benefit analyses in the regulatory decision process.

Based on prevailing scientific data, the M-DBP Cluster is intended to control microbial pathogens while minimizing the public health risk from disinfectants and DBPs. Since multiple threats require multiple barriers, the IESWTR and Stage 1 DBPR expand on the foundation of the TCR, SWTR, and TTHM standards to target health risk outliers unaddressed by prior regulations.

The IESWTR builds on the SWTR by adding protection from *Cryptosporidium* through strengthened combined filter effluent turbidity performance standards and individual filter turbidity provisions for filtered systems that serve greater than 10,000 people using conventional and direct filtration. For unfiltered systems, *Cyptosporidium* must be included in the watershed control requirements. In addition, the IESWTR builds on the TCR by requiring sanitary surveys for all public water systems using surface water and ground water under the direct influence of surface water. The IESWTR also requires covers for all new finished water storage facilities and includes disinfection benchmark provisions to ensure continued levels of microbial protection while taking the necessary steps to comply with the DBP standards. Collectively, the SWTR and IESWTR place stringent treatment requirements on systems using surface water as a source.

By building on the foundation set forth by the original SDWA, the quality of drinking water has improved and public health protection has increased. The IESWTR and Stage 1 DBP Rules are part of a series of rules designed to expand on the foundation of prior rulemaking efforts. By encompassing previously unaddressed health risks from microbials and disinfection byproducts, the M-DBP Cluster continues to maximize drinking water quality and public health protection.

Development of the IESWTR

The new rules are a product of 6 years of collaboration among the water supply industry, environmental and public health groups, and local, state, and federal governments. EPA first launched a rule-making process in 1992 and convened a Regulatory Negotiation (RegNeg) Advisory Committee under the Federal Advisory Committees Act (FACA), representing a range of stakeholders affected by possible regulation. The 1996 SDWA Amendments required EPA to develop rules to balance the risks between microbial pathogens and disinfection byproducts.

In 1997, a similar FACA process was implemented with the Microbial-Disinfectants/Disinfection Byproducts (M-DBP) Advisory Committee. The M-DBP Committee convened to collect, share, and analyze new information available since 1994, review previous assumptions made during the RegNeg process, as well as build consensus on the regulatory implications of this new information. Negotiations resulted in the following three proposals:

- A staged approach to regulation of DBPs (referred to as the Stage 1 and Stage 2 DBPRs) incorporating Maximum Contaminant Levels (MCLs), Maximum Residual Disinfectant Levels (MRDLs), and treatment technique requirements;
- A companion Interim Enhanced Surface Water Treatment Rule (IESWTR) designed to improve control of microbial pathogens and prevent inadvertent reductions in microbial safety as a result of DBP control efforts; and,
- An Information Collection Rule (ICR) to collect information necessary to reduce many key uncertainties prior to subsequent negotiations for the Stage 2 DBPR.

Benefits of the IESWTR

The IESWTR will improve public health by increasing the level of protection from exposure to *Cryptosporidium* and other pathogens in drinking water supplies through improvements in filtration at water systems. According to the risk assessment performed for the Regulatory Impact Analysis, the IESWTR decreases the likelihood of endemic illness (constant, low-level presence of a disease or infection) from *Cryptosporidium* by 110,000 to 463,000 cases annually. Based on these values, the estimated annual benefits of reducing the illness range from \$0.263 billion to \$1.240 billion per year. This calculation is based on a valuation of \$2,000 per incidence of cryptosporidiosis prevented. The IESWTR will also reduce the risk of more severe health impacts on sensitive populations, including the risk of mortality. Additionally, the IESWTR will reduce the likelihood of outbreaks of cryptosporidiosis and its associated costs by providing a larger margin of safety against such outbreaks in some systems.

Applicability and Compliance Dates

The IESWTR applies to public water systems (PWSs) that use surface water or ground water under the direct influence of surface water (GWUDI) as a source and serve 10,000 or more people. Additionally, it establishes a schedule by which states are required to conduct sanitary surveys for *all* surface water and GWUDI PWSs.

Systems must comply with the turbidity and monitoring requirements, the primary requirements of the IESWTR, no later than January 1, 2002. However, PWSs with elevated levels of DBPs (Total

Trihalomethanes—TTHM; and five haloacetic acids—HAA5) are required to develop an evaluation of their existing disinfection practices—a disinfection profile—beginning no later than March 31, 2000.

Requirements of the Rule: Public Water Systems

Disinfection profiling and benchmarking

Surface water or GWUDI systems having average annual TTHM ≥ 0.064 mg/L or annual average HAA5 ≥ 0.048 mg/L as a result of data or specific monitoring conducted by March 31, 2000 must develop a disinfection profile. The disinfection profile is a compilation of daily inactivation of Giardia (and in some cases, viruses) based on daily criteria (i.e., disinfectant residual, pH, temperature, and peak flow) that affect the efficacy of the disinfection process (microbial inactivation potential) collected over the period of 1 year. Systems may also use existing operational data in conjunction with daily criteria or three years of existing operational data to create a multi-year profile, if approved by the state. From the disinfection profile, the PWS calculates the average microbial inactivation for each month, and the lowest monthly average inactivation for the year becomes the disinfection benchmark. For systems creating a multi-year profile, the disinfection benchmark is the average of the lowest monthly average values.

The purpose of these provisions is to provide a process whereby a PWS and the state, working together, assure that there will be no significant reduction in microbial protection as the result of disinfection practice modifications designed to meet the more restrictive maximum contaminant levels (MCLs) for DBPs established in the Stage 1 DBPR. If a PWS required to develop disinfection profiles subsequently wishes to modify its disinfection practices to meet the new MCLs, it must establish the disinfection benchmark and consult with the state prior to implementing such modifications. In addition, PWSs must keep the disinfection profile on file for the state to review during their sanitary surveys.

Cryptosporidium

The IESWTR sets a maximum contaminant level goal (MCLG) of zero for the protozoan *Cryptosporidium*. It also establishes a requirement for 2-log removal of *Cryptosporidium* for systems that must filter under the SWTR. Systems that use conventional or direct filtration are assumed to meet this requirement if they are in compliance with the strengthened turbidity performance standards for combined filter effluent in the IESWTR (discussed below). Systems that use slow sand or diatomaceous earth filtration are assumed to meet the 2-log removal requirement if they are in compliance with the existing turbidity performance standards under the SWTR.

The IESWTR also extends the existing watershed control requirements for unfiltered systems to include the control of potential sources of *Cryptosporidium*. Such sources must be included in an unfiltered system's watershed control plan.

Strengthened turbidity requirements

The IESWTR includes a series of requirements related to turbidity. These requirements strengthen current SWTR requirements for combined filter effluent for systems that use conventional or direct filtration. The turbidity level of a system's combined filtered water at each plant must be less than or equal to 0.3 nephelometric turbidity units (NTUs) in at least 95 percent of the measurements taken each month, and the turbidity level of a system's combined filtered water must at no time exceed 1 NTU (under the SWTR, these turbidity requirements are 0.5 NTU and 5 NTU, respectively).

Individual filter monitoring requirements

The IESWTR introduces continuous turbidity monitoring for individual filters. The rule requires that surface water and GWUDI systems that use conventional or direct filtration must conduct continuous turbidity monitoring (every 15 minutes) on the effluent of each individual filter. PWSs must report instances of poor filter performance to the state, and, based on performance triggers, must take prescribed actions to identify and correct the cause(s).

Uncovered finished water storage facilities

The rule prohibits building any uncovered finished water storage facility (reservoir, holding tank, or other storage facility) for which construction begins after February 16, 1999 (60 days after publication).

Public water system recordkeeping and reporting requirements

The IESWTR requires PWSs to submit combined filter effluent monitoring and compliance data and report that they have conducted individual filter turbidity monitoring to states within 10 days after the end of each month the system serves water to the public. Additionally, PWSs must report to the state if certain individual filter monitoring trigger levels are exceeded. In this case, systems must report turbidity measurements and report that filter profiles, filter self-assessments, or comprehensive performance evaluation (CPE) reports have been produced or conducted when instances of poor filter performance occur or persist based on monitoring of individual filter performance. Systems must maintain the results of individual filter monitoring for at least three years.

Requirements of the Rule: States or Other Primacy Agents

Sanitary surveys

The IESWTR requires that the state conduct sanitary surveys for all PWSs using surface water or GWUDI, regardless of the population the PWS serves, no less frequently than every 3 years for community water systems and every 5 years for noncommunity systems. For community water systems determined by the state in previous sanitary surveys to have "outstanding performance," successive sanitary surveys may be conducted at up to 5-year intervals. As part of the eight required sanitary survey components, the state also must review the disinfection profile as part of the sanitary survey.

States must have rules or other authority to ensure that a PWS responds to any "significant deficiencies" revealed during its survey within 45 days, indicating how and on what schedule the system will address the deficiencies noted in the survey. States must also have rules or other authority to ensure that facilities take the steps necessary to address significant deficiencies identified in the survey report that are within the control of the PWS and its governing body.

State primacy, recordkeeping, and reporting requirements

In order to receive primacy for the IESWTR, states must adopt regulations no less stringent than this rule. In addition, states are required to explain, through responses to special primacy requirements, how they will implement the key provisions in the rule. States must have rules or other authority to require PWSs to respond to significant deficiencies uncovered in a sanitary survey, to conduct a Composite Correction

Program (CCP), and to assure that PWSs implement any follow-up recommendations that result from the CCP. States must submit revisions to their programs, regulations, or authorities no later than December 16, 2000 (2 years after rule publication), although states can request an extension of up to 2 years (December 16, 2002).

States must keep records of PWS turbidity measurements, PWSs required to do filter self-assessment reports, CPEs, CCPs, PWSs consulting with the state concerning modifications to disinfection practices, and decisions for PWSs using alternative filtration technology.

More information can be obtained from:

The Interim Enhanced Surface Water Treatment Rule 63 FR 69478 (December 16, 1998)

www.epa.gov/OGWDW/mdbp/ieswtrfr.html

The Interim Enhanced Surface Water Treatment Rule: Technical Corrections

66 FR 3770 (January 16, 2001)

www.epa.gov/safewater/mdbp/iesfr.html

The EPA Safe Drinking Water Hotline, Telephone: 1.800.426.4791

I-B. Key Dates for the IESWTR

The compliance date for the Interim Enhanced Surface Water Treatment Rule (IESWTR) is January 1, 2002. Several provisions, including disinfection profiling and benchmarking and restrictions on uncovered finished water storage facilities, however, will require compliance before the primary compliance date. The timetable for the IESWTR is presented in Table I-1.

Table I-1: Timetable for the IESWTR Requirements

Date	IESWTR Requirement
December 16, 1998	Rule is published in Federal Register [63 FR 1 69478].
February 16, 1999	60-day legal challenge period ends.
February 16, 1999	Construction of uncovered finished water storage facilities is prohibited [40 CFR 141.170(c)].
March 16, 1999	After this date, TTHM and HAA5 monitoring must begin for systems that do not have ICR or occurrence data and wish to determine if they must develop a disinfection profile [40 CFR 141.172(a)(2)(iii)].
April 16, 1999	Systems that have 4 consecutive quarters of HAA5 occurrence data that meet the TTHM monitoring requirements must submit those data to the state to determine if they must develop a disinfection profile [40 CFR 141.172(a)(5)(ii)].
December 31, 1999	TTHM and HAA5 data are due for those systems that collected data under the ICR to determine if they must develop a disinfection profile [40 CFR 141.172(a)(5)(i)].
December 31, 1999	Systems that elect to profile without conducting 4 quarters of TTHM and HAA5 monitoring must notify the state of their election [40 CFR 141.172(a)(5)(iv)].
December 31, 1999	Systems that wish to request state approval of "a more representative annual data set" than the ICR data set to determine if they must develop a disinfection profile must do so in writing [40 CFR 141.172(a)(5)(v)].
March 31, 2000	TTHM and HAA5 monitoring must be complete for systems determining if they must develop a disinfection profile [40 CFR 141.172(a)(2)(iii)(A)].
March 31, 2000	If system is using 3 years of existing operational data to develop the disinfection profile, the profile generated from these data and a request for state approval must be submitted [40 CFR 141.172(b)(3)(i)].
April 1, 2000	Systems determining if they must develop a disinfection profile must submit their TTHM and HAA5 data to the state [40 CFR 141.172(a)(5)(iii)].
April 1, 2000	Systems must begin developing a disinfection profile if either their annual average TTHM ≥ 0.064 mg/L or their annual average HAA5 ≥ 0.048 mg/L [40 CFR 141.172(b)(2)].
December 16, 2000	Final primacy applications must be submitted to EPA unless granted an extension [40 CFR 142.12(b)(1)]
March 31, 2001	Disinfection profile is complete [40 CFR 141.172(b)(2)].
March 31, 2001	After this date, systems that were required to develop a disinfection profile that wish to make a significant change to their disinfection practice must first calculate a disinfection benchmark and consult with the state [40 CFR 141.172(c)].

Date	IESWTR Requirement
December 31, 2001	Systems that are not required to filter must comply with the requirements for TTHM in §141.12 and §141.30 until this date. After this date, systems must comply with the requirements in Subpart L for TTHM, HAA5, bromate, chlorite, chlorine, chloramines, and chlorine dioxide [40 CFR 141.71(b)(6)].
December 31, 2001	Systems that do not meet all of the criteria for avoiding filtration and use conventional/direct filtration must meet the turbidity requirements of the rule [0.3 NTU CFE (Combined Filter Effluent) 95 percent of the time, at no time exceed 1 NTU] [40 CFR 141.173].
December 31, 2001	Alternative technologies for systems that serve at least 10,000 people must remove 99 percent of <i>Cryptosporidium</i> oocysts, and the state must establish alternative turbidity performance standards that must be met 95 percent of the time and a maximum [40 CFR 141.173(b)].
January 1, 2002	Systems must comply with the reporting and recordkeeping requirements of §141.175, including turbidity exceptions reporting. Systems must, when appropriate: • Produce filter profiles or identify obvious reason for poor filter performance. • Report profile has been produced or identify obvious reason for poor filter performance. • Conduct filter self-assessments. • Have 3 rd party CPEs performed.
December 16, 2002	Final primacy revisions applications with approved extensions must be submitted to EPA [40 CFR 142.12(b)(2)].
December 2004	State must have first round of sanitary surveys completed for Subpart H CWSs [40 CFR 142.16(b)(3)(i)].
December 2006	State must have first round of sanitary surveys completed for Subpart H NCWSs [40 CFR 142.16(b)(3)(i)].

Section II. SDWIS Reporting and SNC Definitions

II-A. Safe Drinking Water Information System (SDWIS) Reporting Under the IESWTR

SDWIS/FED (Safe Drinking Water Information System/Federal version) is an EPA national database storing routine information about the nation's drinking water. Designed to replace the system known as FRDS (Federal Reporting Data System), SDWIS/FED stores the information EPA needs to monitor approximately 175,000 public water systems.

States supervise the drinking water systems within their jurisdictions to ensure that each public water system meets state and EPA standards for safe drinking water. The Safe Drinking Water Act (SDWA) requires states to report drinking water information periodically to EPA; this information is maintained in SDWIS/FED.

States report the following information to EPA:

- Basic information on each water system, including: name, ID number, number of people served, type of system (year-round or seasonal), and source of water (ground water or surface water)
- Violation information for each water system: whether it has followed established monitoring and reporting schedules, complied with mandated treatment techniques, or violated any Maximum Contaminant Levels (MCLs)
- Enforcement information: what actions states have taken to ensure that drinking water systems return to compliance if they are in violation of a drinking water regulation
- Sampling results for unregulated contaminants and for regulated contaminants when the monitoring results exceed the MCL

EPA uses this information to determine if and when it needs to take action against non-compliant systems, oversee state drinking water programs, track contaminant levels, respond to public inquiries, and prepare national reports. EPA also uses this information to evaluate the effectiveness of its programs and regulations, and to determine whether new regulations are needed to further protect public health.

II-A.1 Federally Reported Violations

Under SDWIS/FED reporting, states only report when violations occur. In the interest of reducing the reporting burden on states, EPA has limited the number and type of violations to be reported to SDWIS/FED. However, PWSs must still keep records and report <u>all</u> required information to the state. Any violation of the rule, whether included in the accompanying table or not, is a basis for a state or federal enforcement action.

Table II-1 summarizes the violation and contaminant codes that will be used to report violations of the IESWTR to SDWIS/FED.

Table II-1: SDWIS/FED Codes for Federal Reporting Under the IESWTR

Violation Code	Contaminant Code	Treatment Technique (IT) Violations
37	0300	Failure to profile or consult w/state (disinfection changes)
43	0300	Combined filter effluent exceeds 1 NTU/state-set maximum requirements
44	0300	More than 5% of monthly combined filter effluent samples exceed 0.3 NTU/state-set maximum requirements
47	0300	Construction of an uncovered finished water storage facility
Inventory Code	0300	Failure to meet Cryptosporidium site specific conditions (unfiltered systems)
		Monitoring and Reporting (M/R) Violations
29	0300	Major: Failure to conduct follow-up activities triggered by individual filter turbidity exceedances.
381	0300	Major: Failure to collect and report 90% of required combined filter effluent turbidity samples
i		Major: Failure to report all individual filter monitoring has been conducted
		Major: Failure to report combined filter effluent exceedances by the end of the next business day
		Minor: Any other failure to monitor or report
		Recordkeeping Violations
09	0300	Failure to maintain the results of individual filter monitoring for at least 3 years
		Public Notification (PN) Violation*
06	0300	Failure to notify public after a violation

^{*} The revised PN rule (65 FR 25981) is effective May 6, 2002 and will supercede the PN violation listed above.

Table II-2 contains the federally reportable violations for the IESWTR in more detail. These violations are listed by contaminant or requirement and violation type. The table includes the SDWIS/FED reporting codes, the regulatory citation, system type affected, a detailed description of the violation, and the initial compliance date. This table will allow a user to better understand violations listed in SDWIS. For more information on how to report IESWTR violations to SDWIS, please refer to the *State Reporting Guidance for the Interim Enhanced Surface Water Treatment Rule* which will be available at www.epa.gov/safewater/mdbp/implement.html in fall 2001.

¹ Flag used to denote major or minor

Table II-2: Federally Reported Violations for the IESWTR

			Treatmen	Treatment Technique Violation	olation	
SDWIS Reporting Code	Regulated Contaminant/ Requirement	Citation	Violation Type	System Size and Type Affected	Violation	Initial Compliance Date
-	2	3	4	\$	9	7
37/0300	Disinfection and Consultation	§141.172(b) and (c)	TT	All Subpart H systems serving . at least 10,000 people	Failure to consult with the state before making a significant change to a disinfection practice if required to develop a disinfection profile	January 1, 2002
43/0300	Filtration	§141.173(a)(2) and (b)	ТТ	Subpart H systems serving > 10,000 using conventional or direct filtration	Failure to achieve combined filter effluent turbidity level that at no time exceeds 1 NTU if PWS uses conventional or direct filtration or	January 1, 2002
				Subpart H systems serving > 10,000 using alternative filtration technologies	exceedance of the state-set maximum turbidity performance requirements for systems using alternative filtration technologies	

			Treatmen	Treatment Technique Violation	lation	
SDWIS Reporting Code	Regulated Contaminant/ Requirement	Citation	Violation Type	System Size and Type Affected	Violation	Initial Compliance Date
1	2	3	4	5	9	7
44/0300	Filtration	§141.173(a)(1)	Ш	Subpart H systems serving > 10,000 using conventional or direct filtration	Failure to achieve combined filter effluent turbidity level of 0.3 NTU in 95 percent of monthly measurements if PWS uses conventional or direct filtration or	January 1, 2002
·				Subpart H systems serving > 10,000 using alternative filtration technologies	failure to meet the state-set turbidity performance requirements in 95% of monthly measurements for systems using alternative filtration technologies	
47/0300	Finished Water Storage Facilities	§141.170(c)	ТТ	All Subpart H systems serving at least 10,000 people	Systems are not allowed to start construction of any uncovered finished water storage facility (reservoir, holding tank, or other storage facility)	February 16, 1999
Inventory Code/0300	Cryptosporidiu m	§141.171	П	All unfiltered Subpart H systems serving at least 10,000 people	Failure to meet Cryptosporidium site specific condition requirements - system must install filtration within 18 months. Do not report a violation, but change the inventory record/code from "unfiltered avoiding" to "unfiltered required to filter". Report a 42 code violation if filtration has not been installed after 18 months.	January 1, 2002

_		r ·				· · · · · · · · · · · · · · · · · · ·
	Initial Compliance Date	7	January 1, 2002	January 1, 2002	January 1, 2002	January 1, 2002
Violations	Violation	9	Failure to produce and/or report to the state an individual filter profile within 7 days of a turbidity exceedance (> 0.5 NTU in 2 consecutive measurements taken 15 minutes apart after the first 4 hours of operation after filter backwash or otherwise taken offline) if the PWS is not able to identify an obvious reason for abnormal filter performance	Failure to produce and/or report to the state an individual filter profile within 7 days of a turbidity exceedance (> 1.0 NTU in 2 consecutive measurements taken 15 minutes apart) if the PWS is not able to identify an obvious reason for abnormal filter performance	Failure to conduct and/or report to the state a self-assessment of an individual filter within 14 days of a turbidity exceedance (> 1.0 NTU in 2 consecutive measurements taken 15 minutes apart in each of 3 consecutive months)	Failure to have a comprehensive performance evaluation conducted by the state or a third party no later than 30 days after a turbidity exceedance (> 2.0 NTU in 2 consecutive measurements taken 15 minutes apart in 2 consecutive months) and have the evaluation completed and submitted to the state no later than 90 days following the exceedance
Monitoring and Reporting Violations	System Size and Type Affected	S.	Subpart H systems serving > 10,000 using conventional or direct filtration	Subpart H systems serving > 10,000 using conventional or direct filtration	Subpart H. systems serving > 10,000 using conventional or direct filtration	Subpart H systems serving > 10,000 using conventional or direct filtration
fonitoring a	Violation Type	4	M/R Major	M/R Major	M/R Major	M/R Major
4	Citation	3	§141.175(b)(2)	§141.175(b)(1)	§141.175(b)(3)	§141.175(b)(4)
	Regulated Contaminant/ Requirement	2	Filtration - Response to Individual Filter Trigger	Filtration - Response to Individual Filter Trigger	Filtration - Response to Individual Filter Trigger	Filtration - Response to Individual Filter Trigger
	SDWIS Reporting Code	-	29/0300	29/0300	29/0300	29/0300

		X	Conitoring ar	Monitoring and Reporting Violations	Violations	
SDWIS Reporting Code	Regulated Contaminant/ Requirement	Citation	Violation Type	System Size and Type Affected	Violation	Initial Compliance Date
1	2	3	4	5	9	7
38/0300	Filtration/ combined filter effluent	§141.75(a) §141.74	M/R Major Failure to collect and report at least 90 % of required samples. M/R Minor Any other failure to monitor or report.	Subpart H systems serving > 10,000 using conventional or direct filtration	Failure to sample combined filter effluent for turbidity at required frequency using required collection and analytical methods and report the following within 10 days after the end of each month the PWS serves water to the public: 1. total number of samples taken, the number and percentage of samples less than or equal to the limits specified in §141.73 or §141.173; and/or 2. date and level of any measurements over 1 NTU for conventional or direct filtration or which exceed the maximum level set by the state for alternative filtration technologies	January 1, 2002
38/0300	Filtration	§141.175(b)	M/R Major	Subpart H systems serving > 10,000 using conventional or direct filtration	Failure to report that the system has conducted all individual filter monitoring to the state within 10 days after the end of each month	January 1, 2002

Monitoring and Reporting Violations	lated Citation Type Affected Compilar Date	3 4 5 6 7	M/R Major All Subpart H Failure to report that the system has exceeded 1 NTU January 1, 2002 in representative samples by the end of the next serving at least business day if the PWS uses conventional filtration treatment or direct filtration, or	Failure to report that the system has exceeded the maximum level set by the state under §141.173(b) for filtration technologies other that conventional filtration, direction filtration, slow sand, or diatomaceous earth filtration in representative
	Regulated Contaminant/ Requirement	2 3	Filtration §141.175(c)	
	SDWIS Reporting Code	-	38/0300 F	

			Record	Recordkeeping Violations	ions	
SDWIS Reporting Code	Regulated Contaminant/	Citation	Violation Type	System Size and Type Affected	Violation	Initial Compliance Date
 -	2	3	4	'n	9	7
	Filtration	§141.175(b)	Recordkeeping	Subpart H systems serving ≥ 10,000 using conventional or direct filtration	Failure to maintain the results of individual filter monitoring for at least 3 years, documenting that the system has collected and recorded individual filter results every 15 minutes	January 1, 2002

	•	Public Notificatio	n Violatior	18 (Note: The revis	Public Notification Violations (Note: The revised PN rule supercedes §141.32)	
SDWIS Reporting Code	Regulated Contaminant/ Requirement	Citation	Violation Type	Violation System Size and Type Affected	Violation	Initial Compliance Date
-	2	3	4	S.	9	7
06/0300	Filtration and Disinfection	§141.32	PN	All Subpart H serving at least 10,000 people	Failure to notify public and use approved public notification language when there is a violation of the treatment technique and/or monitoring requirements for filtration and disinfection in Subpart H or Subpart P	January 1, 2002

June 2001

II-B. SNC Definitions for the IESWTR

Significant non-compliers (SNCs) are community, non-transient non-community and transient non-community water systems that have more serious, frequent, or persistent violations. The criteria which designate a system as a SNC vary by contaminant. Once a system is designated as a SNC, it is subject to EPA's timely and appropriate policy. SNCs that have not returned to compliance or are not addressed timely and appropriately are called Exceptions. Timeliness for SNCs is eight months after the system became a SNC. (Two months for the state to determine, and become aware of, the system's SNC status and six months in which to complete the follow-up/enforcement action). The types of actions considered appropriate include the issuance of a formal state or federal administrative or compliance order, a civil or criminal referral to state Attorney General or Department of Justice, or state bilateral compliance agreement signed by both the state and the violator. The following are SNC definitions for the IESWTR.

NOTE: SNC definitions for the Surface Water Treatment Rule continue to remain in effect.

UNFILTERED AVOIDING FILTRATION

- Systems which fail avoidance criteria must filter. See 6/27/90 Surface Water Treatment Rule
 Implementation Manual. Systems become an SNC if filtration is not installed within 18 months of
 any failure of the avoidance criteria.
- A system that has three (3) or more Major M/R violations in any 12 consecutive months.
- A system that has a combination of five (5) or more Major M/R violations and Minor M/R violations in any 12 consecutive months.

FILTERED

- A system that has four (4) or more TT violations in any 12 consecutive months.
- A system that has a combination of six (6) or more TT violations and Major M/R violations in any 12 consecutive months.
- A system that has a combination of ten (10) or more TT violations, Major M/R violations, and Minor M/R violations in any 12 consecutive months.

DISINFECTION PROFILING (if required)

 Failure to consult with the state before making a significant disinfection change if required to develop a disinfection profile.

UNCOVERED RESERVOIRS

• Beginning construction of any uncovered finished water storage facility after February 16, 1999.

Section III. State Primacy Revision Applications

Changes to the Primacy Revision Process

40 CFR 142 sets out requirements for states to obtain and/or retain primary enforcement responsibility (primacy) for the Public Water System Supervision (PWSS) program as authorized by §1413 of the Safe Drinking Water Act (SDWA). The 1996 SDWA Amendments create an additional requirement and modify the process for states to obtain and/or retain primacy. On April 28, 1998, EPA promulgated the Primacy Rule to reflect these statutory changes (63 FR 23361).

For consistency with the Amendments to §1413, the Primacy Rule makes the following changes to the existing regulations in 40 CFR 142:

- 1) Administrative Penalty Authority—As a condition of primacy, states must now have administrative penalty authority for all violations of their approved primacy program, unless prohibited by the states' constitution. This encompasses applicable requirements in 40 CFR 141 and 142 including, but not limited to, National Primary Drinking Water Regulations, variances and exemptions, if applicable, and public notification requirements.
- 2) Interim Primacy—The Primacy Rule also codifies the new process which grants primary enforcement authority to states while their applications to modify their primacy programs are under review (interim primacy). New section 142.12(e) explains that any state already having primacy for all existing national primary drinking water regulations in effect when a new regulation is promulgated is considered to have interim primacy for a new or revised regulation, once it has submitted a complete and final primacy revision application. This interim enforcement authority begins on the date of submission of a complete and final primacy revision application or the effective date of the new or revised state regulation, whichever is later, and ends when EPA makes a final determination.
- 3) Time increases for rule adoptions—The rule also increases the time for a state to adopt new or revised federal regulations from 18 months to 2 years.
- 4) **Examples of emergencies**—Finally, the Primacy Rule adds examples of circumstances that require an emergency plan for the provision of safe drinking water. Emergencies include earthquakes, floods, hurricanes, and other natural disasters.

For consistency with the Amendments to §1401(4), the Primacy Rule expands the definition of a public water system (PWS) to include not only systems which provide water for human consumption through pipes, but also systems which provide water for human consumption through "other constructed conveyances."

III-A. State Primacy Program Revision

Pursuant to §142.12, **Revision of State Programs**, complete and final requests for approval of program revisions to adopt new or revised EPA regulations must be submitted to the Administrator no later than 2 years after promulgation of the new or revised federal regulations (see Table III-1). Until those applications are approved, EPA Regions have responsibility for directly implementing the IESWTR. The state and EPA can agree to implement the rule together during this period. However, if a state is eligible for interim primacy, once it submits a complete and final revision package, it will have full implementation and enforcement authority. A state may be granted additional time, up to two years, to submit its application package. During this period, an extension agreement outlining the state's and EPA's responsibilities is required.

Table III-1: State Rule Implementation and Revision Timetable

EPA/State Action	Time Frame
IESWTR published by EPA	December 16, 1998
State and Region establish a process and agree upon a schedule for application review and approval	May 1999
State, at its option, submits <i>draft</i> program revision package including: Preliminary Approval Request Draft State Regulations and/or Statutes Regulation Crosswalk	September 1999 (Suggested)
Regional (and Headquarters if necessary) review of draft	Completed within 90 days of state submittal of Draft
State submits final program revision package including: Adopted State Regulations Regulation Crosswalk 40 CFR 142.10 Primacy Update Checklist 40 CFR 142.14 and 142.15 Reporting and Recordkeeping 40 CFR 142.16 Special Primacy Requirements Attorney General's Enforceability Certification	By September 16, 2000*
EPA final review and determination: Regional review (program and ORC) Headquarters concurrence and waivers (OGWDW, OECA, OGC) Public Notice Opportunity for hearing EPA's Determination	Completed within 90 days of state submittal of final 45 days Region 45 days Headquarters
Rule Effective Date	January 1, 2002

^{*} EPA suggests submitting an application by September 2000, to ensure timely approval. EPA regulations allow until December 16, 2000 for this submittal. An extension of up to 2 additional years may be requested by the state.

III-A.1 The Revision Process

The approval of state program revisions is recommended to be a two-step process comprised of submission of a draft request (optional) and then submission of a complete and final request for program approval. Figure III-1 diagrams these processes and their timing.


Draft Request—At the state's option, it may submit a draft request for EPA review and tentative determination. The request should contain drafts of all required primacy application materials. A draft request should be submitted by 9 months after rule promulgation. EPA will make a tentative determination on whether the state program meets the applicable requirements. The tentative determination should be made within 90 days.

Complete and Final Request—This submission must be in accordance with §142.12(c)(1) and (2) and include the Attorney General's statement. If the state has submitted a draft request for EPA review the state must also address comments and/or program deficiencies identified in the tentative determination in their final submission. Regions should make states aware that submission of only a final request may make it more difficult for the states to address any necessary changes within the allowable time for state rule adoption.

EPA requests that states submit their complete and final revision package within 21 months of rule promulgation. This will ensure that states will have interim primacy within 24 months and will prevent states from becoming backlogged with revision applications to adopt future federal requirements.

The state and Region should agree to a plan and timetable for submitting the state primacy revision application as soon as possible after rule promulgation—ideally within 5 months of promulgation.

Figure III-1: Recommended Review Process for State Request for Approval of Program Revisions

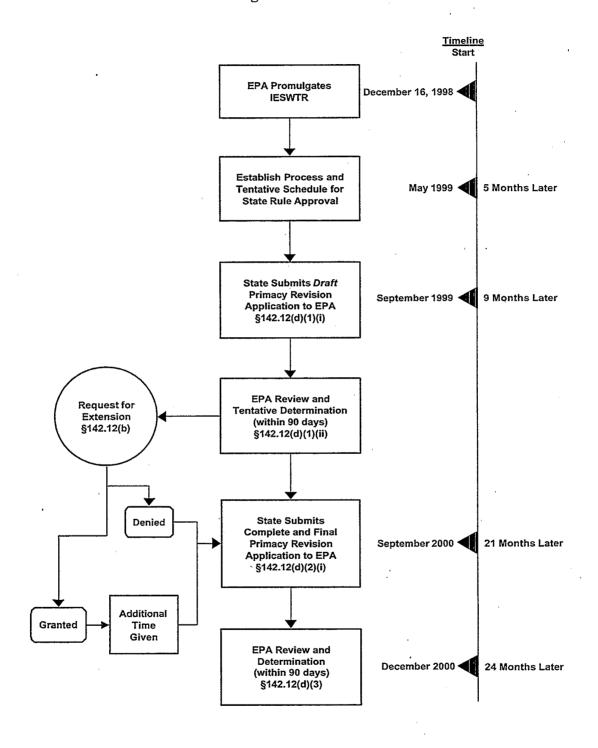

III-A.2 The Final Review Process

Once a state application is complete and final, EPA has a regulatory (and statutory) deadline of 90 days to review and approve or disapprove of the revised program. The Offices of Ground Water and Drinking Water (OGWDW) and Enforcement and Compliance Assurance (OECA) will conduct detailed reviews of the first state package from each Region. The Region should submit their comments with the state's package for Headquarter's review. Where the Region has identified all significant issues, OGWDW and OECA will waive concurrence on all other state programs in that Region, although HQ will retain the option to review additional state programs with cause. The Office of General Counsel (OGC) has delegated its review and approval to the Office of Regional Counsel (ORC).

In order to meet the 90 day deadline for packages undergoing Headquarters' review, the review period will be equally split giving both the Regions and Headquarters 45 days to conduct their respective reviews. For the first package in each Region, Regions should forward copies of the primacy revision applications and their comments to the director of the Drinking Water Protection Division (DWPD) in OGWDW. The DWPD Director will take the lead on the review process. OGWDW will provide OECA with a copy for their concurrent review. OECA will concur on OGWDW approvals.

III-B. State Primacy Program Revision Extensions (40 CFR 142.12(b))

III-B.1 The Extension Process

Under §142.12(b), states may request that the 2-year deadline for submitting the complete and final request for EPA approval of program revisions be extended for up to 2 additional years in certain circumstances. The extension request must be submitted to EPA within 2 years of the date that EPA published the regulation. The Regional Administrator has been delegated authority to approve extension applications. Headquarters concurrence on extensions is not required.

III-B.2 Criteria that an Extension Request Must Meet

For an extension to be granted under § 142.12(b), the state must demonstrate that it is requesting the extension because it cannot meet the original deadline for reasons beyond its control, despite a good faith effort to do so. A critical part of the extension application is the state's proposed schedule for submission of its complete and final request for approval of a revised primacy program. The application must also demonstrate at least one of the following:

- (i) That the state currently lacks the legislative or regulatory authority to enforce the new or revised requirements; or,
- (ii) That the state currently lacks the program capability adequate to implement the new or revised requirements; or,
- (iii) That the state is requesting the extension to group two or more program revisions in a single legislative or regulatory action.

In addition, the state must be implementing the EPA requirements to be adopted in its program revision within the scope of its current authority and capabilities.

III-B.3 Conditions of the Extension

If an extension is granted, the Region and state will negotiate certain conditions that must be met during the extension period. These conditions will be determined during the extension approval process and are decided on a case-by-case basis. The conditions must be included in an extension agreement between the state and the EPA Regional office. Appendix B contains a sample extension agreement.

Conditions of an extension agreement may include:

- Informing PWSs of the new EPA (and upcoming state) requirements and that the Region will be overseeing implementation of the requirements until they approve the state program revisions or until the state submits a complete and final revision package if the state qualifies for interim primacy;
- Collecting, storing and managing laboratory results, public notices, and other compliance and operation data required by the EPA regulations;
- Assisting the Region in the development of the technical aspects of enforcement actions and conducting informal follow-up on violations (telephone calls, letters, etc.);
- Providing technical assistance to public water systems;
- For states whose request for an extension is based on a current lack of program capability
 adequate to implement the new requirements, taking steps agreed to by the Region and the
 state during the extension period to remedy the deficiency;
- Providing the Region with all the information required under §142.15 on state reporting.

Figure III-2 provides a checklist the Region can use to review state extensions.

Figure III-2: Extension Request Checklist

I. Reason for Sta	te Request
- - - - -	Clustering of Program Revisions Statutory Barrier Regulatory Barrier Lack of Program Capability Insufficient Resources Funding Level Staffing Lack of Adequately Trained Staff Inadequate Procedures, Guidelines, and Policies Other
II. Actions Taken	by the State to Justify an Extension
 	Schedule Dates (or attachments) Seeking Increases in Program Resources Training Existing Personnel/Revising Training Programs Revising State Regulations or Statutes Developing Revised/New Procedures, Guidelines, Policies Other
III. Extension De	cision
· _	Extension Request Approved Date: _ / /_
	Period of Extension Request: // to//_
_	Extension Request Denied Date: _ / /_
	Reason Cited:
IV. Conditions of	the Extension
During the ext	Inform public water systems of the new requirements and the fact that EPA will be overseeing their implementation until the state's program is approved or submitted if state qualifies for interim primacy Collect and store laboratory results and other compliance data Provide technical assistance to public water systems Provide EPA with the information required under section 142.15 of the primacy rule Other

III-C. State Primacy Package

The primacy revision application package should consist of the following sections:

III-C.1 Section I—The State Primacy Revision Checklist (40 CFR 142.10)

This section is a checklist of general primacy requirements, taken from 40 CFR 142.10, as shown in Table III-2. In completing this checklist, the state must identify the program elements that it has revised in response to new federal requirements. If an element has been revised the state should indicate a "Yes" answer in the second column next to the list of program elements and should submit appropriate documentation. For elements that need not be revised, the state need only list the citation and date of adoption in the second column. During the application review process, EPA will insert findings and comments in the third column.

Table III-2: State Primacy Revision Checklist

R	Required Program Elements Revision to State Program Findings/Comme		Required Program Elements		EPA Findings/Comments
§142.10	Primary Enforcement - Definition of Public Water System*		,		
§142.10(a)	Regulations No Less Stringent				
§142.10(b)(1)	Maintain Inventory				
§142.10(b)(2)	Sanitary Survey Program				
§142.10(b)(3)	Laboratory Certification Program				
§142.10(b)(4)	Laboratory Capability				
§142.10(b)(5)	Plan Review Program				
§142.10(b)(6)(i)	Authority to apply regulations				
§142.10(b)(6)(ii)	Authority to sue in courts of competent jurisdiction				
§142.10(b)(6)(iii)	Right of Entry				
§142.10(b)(6)(iv)	Authority to require records				
§142.10(b)(6)(v)	Authority to require public notification				
§142.10(b)(6)(vi)	Authority to assess civil and criminal penalties				
§142.10(b)(6)(vii)	Authority to require CWSs to provide CCRs				
§142.10(c) .	Maintenance of Records	·			
§142.10(d)	Variance/Exemption Conditions (if applicable)**				
§142.10(e)	Emergency Plans				
§142.10(f)	Administrative Penalty Authority*				

^{*} New requirement from the 1996 Amendments. Regulations published in the April 28, 1998 Federal Register.

^{**} New regulations published in the August 14, 1998 Federal Register.

The 1996 SDWA Amendments include new provisions for PWS definition and administrative penalty authority. States must adopt provisions at least as stringent as these new provisions, now codified at 40 CFR 142.2 and 142.10. Failure to revise primacy for these new provisions can affect primacy for the IESWTR. However, states may still receive primacy for the IESWTR even if they have not yet revised their base program to comply with the new statutory requirements provided that the time to adopt these requirements (including the extension period if applicable) has not expired (April 2000 and April 2002 with extension).

Rule Bundling—States may bundle the new PWS definition, administrative penalty authority, variance and exemption requirements or any other drinking water regulation with the IESWTR primacy revision packages so long as the submittal date (two years plus two year extension) has not lapsed. If states choose to bundle these requirements, the state needs to include the text of the state regulation/statute. The Attorney General statement should reference these new requirements.

III-C.2 Section II—Text of the State's Regulation (40 CFR 142.10)

Each primacy application package must include the text of the state regulation.

III-C.3 Section III—Primacy Revision Crosswalk

The Primacy Revision Crosswalk, found in Appendix A, should be completed by states in order to identify state statutory or regulatory provisions that correspond to each federal requirement. If the state's provisions differ from federal requirements, the state should explain how its requirements are "no less stringent." For the "early requirements" of the IESWTR that will be completed prior to state rule adoption, a state regulation that does not include these requirements will still be considered as stringent as the federal requirements.

III-C.4 Section IV—State Reporting and Recordkeeping Checklists (40 CFR 142.14 and 142.15)

This section addresses state reporting and recordkeeping requirements. The state should use these checklists to explain how state reporting and recordkeeping requirements are consistent with federal requirements. If state requirements are inconsistent with federal requirements, the state must explain how its requirements are "no less stringent" as per §142.10. The checklist for the IESWTR is presented in Table III-3.

Table III-3: Reporting and Recordkeeping Checklist for the IESWTR

Requirement	Are state policies consistent with federal requirements? If not, please explain.
Each state that has primary enforcement responsibility must keep records of turbidity measurements for not less than 1 year; information retained must be set forth in a form which makes possible comparison with turbidity limits specified in §§141.71, 141.73, 141.175.	
Each state that has primary enforcement responsibility must keep records of disinfectant residual measurements and other parameters necessary to document disinfection effectiveness in accordance with §§141.72 and 141.74, and the reporting requirements of §§141.75 and 141.175; records must be kept for not less than 1 year.	
Each state that has primary enforcement responsibility must keep written records of decisions made on a system-by-system and case-by-case basis under the provisions of 40 CFR 141, subpart H or subpart P.	
Each state that has primary enforcement responsibility must keep records of systems consulting with the state concerning a modification to a disinfection practice under §141.172(c) including the status of the consultation.	,
Each state that has primary enforcement responsibility must keep records of decisions that a system using alternative filtration technologies as allowed under §141.173(b) can consistently achieve 99% removal of <i>Cryptosporidium</i> oocysts; decisions must include state-set enforceable turbidity limits for each system; copy of the decision must be kept until the decision is reversed or revised; state must provide a copy of the decision to the system.	
Each state that has primary enforcement responsibility must keep records of systems required to do filter self-assessment, CPE, or CCP under the requirements of §141.175.	
Each state that has primary enforcement responsibility will keep a list of Subpart H systems that have had a sanitary survey completed during the previous year and an evaluation of the state's program for conducting sanitary surveys under §1.41.16(b)(3).	

III-C.5 Section V—Special Primacy Requirements (40 CFR 142.16)

See section D. This section provides guidance on how states may choose to meet each special primacy requirement.

III-C.6 Section VI—Attorney General's Statement of Enforceability (40 CFR 142.11)

The complete and final primacy revision application must include an Attorney General statement certifying that the state regulations were duly adopted and are enforceable. The Attorney General statement should

also certify that the state does not have any audit privilege or immunity laws, or if it has such laws, that these laws do not prevent the state from meeting the requirements of the Safe Drinking Water Act. If a state has submitted this certification with a previous revision package, then the state should indicate the date of submittal and the Attorney General need only certify that the status of the audit laws has not changed since the prior submittal. An example of an Attorney General statement is presented in Figure III-3.

Figure III-3: Example of Attorney General Statement

Model Language

I hereby certify, pursuant to my authority as (1) and in accordance with the Safe Drinking Water Act as amended, and (2), that in my opinion the laws of the [state / commonwealth of (3)] [or tribal ordinances of (4)] to carry out the program set forth in the "Program Description" submitted by the (5) have been duly adopted and are enforceable. The specific authorities provided are contained in statutes or regulations that are lawfully adopted at the time this Statement is approved and signed, and will be fully effective by the time the program is approved.

Guidance For States on Audit Privilege and/or Immunity Laws

In order for EPA to properly evaluate the state's request for approval, the state Attorney General or independent legal counsel should certify that the state's environmental audit immunity and/or privilege and immunity law does not affect its ability to meet enforcement and information gathering requirements under the Safe Drinking Water Act. This certification should be reasonably consistent with the wording of the state audit laws and should demonstrate how state program approval criteria are satisfied.

EPA will apply the criteria outlined in its "Statement of Principles" memo issued on 2/14/97 (See Appendix C) in determining whether states with audit laws have retained adequate enforcement authority for any authorized federal programs. The principles articulated in the guidance are based on the requirements of federal law, specifically the enforcement and compliance and state program approval provisions of environmental statutes and their corresponding regulations. The Principles provide that if provisions of state law are ambiguous, it will be important to obtain opinions from the state Attorney General or independent legal counsel interpreting the law as meeting specific federal requirements. If the law cannot be so interpreted, changes to state laws may be necessary to obtain federal program approval. Before submitting a package for approval, states with audit privilege and/or immunity laws should initiate communications with appropriate EPA Regional Offices to identify and discuss the issues raised by the state's audit privilege and/or immunity law.

I. For States with No Audit Privilege and/or Immunity Laws

Furthermore, I certify that [state / commonwealth of (3)] has not enacted any environmental audit privilege and/or immunity laws.

II. For States with Audit Laws that do Not Apply to the State Agency Administering the Safe Drinking Water Act

Furthermore, I certify that the environmental [audit privilege and/or immunity law] of the [state / commonwealth of (3)] does not affect (3) ability to meet enforcement and information gathering requirements under the Safe Drinking Water Act because the [audit privilege and/or immunity law] does not apply to the program set forth in the "Program Description." The Safe Drinking Water Act program set forth in the "Program Description" is administered by (5); the [audit privilege and/or immunity law] does not affect programs implemented by (5), thus the program set forth in the "Program Description" is unaffected by the provisions of [state / commonwealth of (3)] [audit privilege and/or immunity law].

III. For States with Audit Privilege and/or Immunity Laws that Worked with EPA to Satisfy Requirements for Federally Authorized, Delegated or Approved Environmental Programs

Furthermore, I certify that the environmental [audit privilege and/or immunity law] of the [state / commonwealth of (3)] does not affect (3) ability to meet enforcement and information gathering requirements under the Safe Drinking Water Act because [state / commonwealth of (3)] has enacted statutory revisions and/or issued a clarifying Attorney General's statement to satisfy requirements for federally authorized, delegated or approved environmental programs.

Signature		
Name and Title		
 Date	····	

- (1) State Attorney General or attorney for the primacy agency if it has independent legal counsel
- (2) 40 CFR 142.11(a)(6)(i) for initial primacy applications or 142.12(c)(1)(iii) for primacy program revision applications..
- (3) Name of state or commonwealth
- (4) Name of tribe
- (5) Name of primacy agency

III-D. Guidance for IESWTR Special Primacy Requirements

This section contains guidance states can use when addressing the special primacy requirements of 40 CFR 142.16. It specifically addresses the special primacy conditions added for implementation of the Interim Enhanced Surface Water Treatment Rule (IESWTR). The guidance addresses special primacy conditions in the same order that they occur in the rule.

States should note that, in several sections, the guidance makes suggestions and offers alternatives that go beyond the minimum requirements indicated by reading the subsections of §142.16. EPA does this to provide states with information and/or suggestions that may be helpful to states' implementation efforts. Such suggestions are prefaced by "may" or "should" and are to be considered advisory. They are not required elements of states' applications for program revision.

§142.16 Special primacy requirements. (b)(1)Enforceable requirements. (ii): States must have the appropriate rules or other authority to assure PWSs respond in writing to significant deficiencies outlined in sanitary survey reports required under paragraph (b)(3) of this section no later than 45 days after receipt of report, indicating how and on what schedule the system will address significant deficiencies noted in the survey.

Guidance

This special primacy requirement can be satisfied by a description of statutes, rules, and other authorities the state can use to assure PWSs take the necessary actions as outlined above. The appropriate section(s) of each source of authority must be cited and copies of the written documents must be included in the program revision application package.

In their applications, states may also wish to address their authority to take administrative and/or legal actions and assess penalties. Additionally, states may include a description of the plan for using their appropriate rules and/or other authority to achieve the desired actions on the part of PWSs. The plan may include the following:

- A cover letter that would be included with the sanitary survey report that lists each
 significant deficiency and provides notice to the system of the regulatory requirements. The
 cover letter would state the date by which the system's response would be required and
 explain that the response would have to indicate how and on what schedule the system
 plans to address each significant deficiency.
- Establishment of a "tickler" file to ensure state follow up.
- Follow-up actions for non-responding systems or systems that provide inadequate responses.

§142.16 Special primacy requirements. (b)(1) Enforceable requirements. (iii): States must have the appropriate rules or other authority to assure that PWSs take necessary steps to address significant deficiencies identified in sanitary survey reports required under paragraph (b)(3) of this section, if such deficiencies are within the control of the PWS and its governing body.

Guidance

This special primacy requirement can be satisfied by a description of statutes, rules, and other authority the state can use to assure PWSs take action necessary to address significant deficiencies. The appropriate section(s) of each source of authority must be cited and copies of the written documents must be included in the revision application package. EPA does not believe that the state's existing authority to address imminent and substantial endangerment is sufficient to meet this special primacy requirement.

In addition, states may wish to address their authority to take administrative and/or legal actions and assess penalties. Additionally, states may wish to include a description of how the appropriate rules and/or other authority, including formal enforcement actions, will be used to ensure that the PWSs take the steps necessary to correct significant deficiencies within their control.

EPA believes that many states have existing authorities that are adequate to comply with the intent of this special primacy requirement. These authorities can often be found in broad statutory language designed to provide public health protection.

§142.16 Special primacy requirements. (b)(3) Sanitary survey: In addition to the general requirements for sanitary surveys contained in §142.10.(b)(2), an application must describe how the state will implement a sanitary survey program that meets the requirements in paragraphs (b)(3)(i) through (v) of this section. For the purposes of this paragraph, "sanitary survey" means an onsite review of the water source (identifying sources of contamination using results of source water assessments where available), facilities, equipment, operation, maintenance, and monitoring compliance of a public water system to evaluate the adequacy of the system, its sources and operations and the distribution of safe drinking water.

Guidance

The special primacy requirements of §142.16(b)(3) describe several additional provisions states must apply to their sanitary survey programs for systems using surface water or ground water under the direct influence of surface water as a source. These provisions address the aspects of PWSs that must be evaluated during the sanitary survey, minimum frequencies for conducting the sanitary surveys, review of disinfection profiles, and identification of "significant deficiencies" that require immediate corrective action. It also offers states the flexibility to allow some post-1995 sanitary surveys to serve as the first set required under the IESWTR; to reduce the frequency of sanitary surveys necessary for community surface water systems deemed by the state to have outstanding performance; and to conduct sanitary surveys in a phased or staged manner.

The following guidance addresses each subsection of §142.16(b)(3) (i) through (v) in order. The arrangement and structure of the state's description, however, is discretionary, provided the state gives sufficient detail to demonstrate that its strategy and capacity are adequate for meeting the special primacy conditions.

References for more detailed guidance

Guidance Manual for Sanitary Surveys, USEPA, April 1999 (EPA 815-R-99-016)
 Available from:

§142.16 Special primacy requirements. (b)(3) Sanitary survey (i): The state must conduct sanitary surveys for all surface water systems (including groundwater under the influence) that address the eight sanitary survey components listed in paragraphs (b)(3)(i)(A) through (H) of this section no less frequently than every three years for community systems and no less frequently than every five years for noncommunity systems. The state may allow sanitary surveys conducted after December 1995 to serve as the first set of required sanitary surveys if the surveys address the eight sanitary survey components listed in paragraphs (b)(3)(i)(A) through (H) of this section.

- (A) Source.
- (B) Treatment.
- (C) Distribution system.
- (D) Finished water storage.
- (E) Pumps, pump facilities, and controls.
- (F) Monitoring and reporting and data verification.
- (G) System management and operation.
- (H) Operator compliance with state requirements.

Guidance

This special primacy requirement addresses both the scope of the state's sanitary surveys (eight components must be included) and the minimum frequency for conducting surveys. States should have adequate resources to comply with these requirements. States must address scope and frequency of sanitary surveys in their primacy revision application and are encouraged to address capacity and implementation as well.

Scope and frequency of sanitary surveys

The state must provide adequate information to demonstrate that the sanitary surveys to be performed address, at a minimum, the eight components listed above. In cases where the state is currently performing sanitary surveys that meet these minimum requirements, example sanitary survey forms and completed reports can be used to demonstrate that all eight elements are addressed. If the state does not believe that it currently performs sanitary surveys that meet the minimum requirements, the revision application must include details of a plan for upgrading its procedures, as necessary, including examples of sanitary survey forms that will be used and a description of training for staff in performance of sanitary surveys.

The state must show that sanitary surveys will be conducted no less frequently than every three years for community systems and no less frequently than every five years for noncommunity systems. EPA believes that in order to ensure that these surveys will be conducted as an effective preventive tool to identify and correct water system deficiencies that could pose a threat to public health, states should conduct surveys three (or five) years from the year the survey was last conducted. Thus, if a sanitary survey for a system on a three-year cycle is conducted on June 11, 2003, the next survey should be completed by December 2006.

Capacity

The state's revision application should address capacity for conducting appropriate sanitary surveys at, or in excess of, the frequency outlined in §142.16(b)(3)(i). When such capacity exists and the above requirements are being met or exceeded by an existing program, a summary of the state's sanitary survey program, including a brief description of past and future schedules, should be sufficient to demonstrate adequate capacity.

A state that does not have an existing sanitary survey program that meets these requirements should describe its proposed program and estimate the resources directed toward sanitary surveys. The state should explain how the new requirements will affect its program and whether existing resources will be adequate. When existing resources are clearly inadequate, the state should provide EPA with a plan for obtaining additional support before the compliance dates of the rule.

Implementation

Finally, the state should provide EPA with a brief description of its plan for meeting the requirements of §142.16(b)(3)(i) given existing or planned resources, the number of affected surface water systems, anticipated follow-up technical assistance and enforcement needs, and other program demands.

References for more detailed guidance

2. Guidance Manual for Sanitary Surveys, USEPA, April 1999 (EPA 815-R-99-016) Available from:

§142.16 Special primacy requirements. (b)(3) Sanitary survey (ii): For community systems determined by the state to have outstanding performance based on prior sanitary surveys, subsequent sanitary surveys may be conducted not less than every five years. In its primacy application, the state must describe how it will decide whether a system has outstanding performance and is thus eligible for sanitary surveys at a reduced frequency.

Guidance

This special primacy requirement allows the state to decrease the frequency of sanitary surveys for some community surface water systems from once every 3 years to once every 5 years. The provision is designed to allow states to direct their limited resources toward those systems that have the greatest potential for posing public health risks, *i.e.*, those *not* achieving outstanding performance. States must have a procedure for determining whether a system should be considered to have outstanding performance that must be integrated into the sanitary survey process. The procedure should provide inspectors with enough guidance to ensure consistent implementation.

Criteria states may wish to consider in determining outstanding performance can be found in Section 4.5 of Guidance Manual for Conducting Sanitary Surveys for Public Water Systems: Surface Water and Ground Water Under Direct Influence (GWUDI).

References for more detailed guidance

1. Guidance Manual for Sanitary Surveys: Surface Water and Ground Water Under Direct Influence (GWUDI), USEPA, April 1999 (EPA 815-R-99-016)

Available from:

§142.16 Special primacy requirements. (b)(3) Sanitary survey (iii): Components of a sanitary survey may be completed as part of a staged or phased state review process within the established frequency.

Guidance

Section 142.16(b)(3) requires states to conduct sanitary surveys for surface water systems including groundwater under the direct influence that address eight components. In view of the fact that states often have inspections and evaluations conducted on one or more of these PWS components in program efforts separate from the sanitary surveys, the rule allows for those evaluations and inspections to be used in a staged or phased review process as long as all eight components are addressed within the required frequency. For example, the annual onsite inspection required for unfiltered systems, as one criterion to remain unfiltered, can be used to supplement a full sanitary survey. Other programs whose activities may serve to address one or more of the components include the following:

- Source Water Assessment and Protection Program
- Wellhead Protection Area Program
- Watershed Control Program
- The Composite Correction Program
- Comprehensive Performance Evaluations
- Operator Training and Certification Programs
- Technical Assistance Programs
- Capacity Development Programs

If a state wishes to conduct sanitary surveys in a staged or phased process, the primacy revision application should contain a description of relevant programs and activities, how they will be coordinated, and who the responsible parties will be for follow-up technical assistance and enforcement in response to deficiencies.

References for more detailed guidance

1. Guidance Manual for Sanitary Surveys: Surface Water and Ground Water Under Direct Influence (GWUDI), USEPA, April 1999 (EPA 815-R-99-016)

Available from:

§142.16 Special primacy requirements. (b)(3) Sanitary survey (iv): When conducting sanitary surveys for systems required to comply with the disinfection profiling requirements in §141.172 of this chapter, the state must also review the disinfection profile as part of the sanitary survey.

Guidance

EPA suggests that states address this provision under the treatment component of the general description of their existing or planned sanitary survey programs. The description should include information on how the systems that are required to prepare disinfection profiles will be identified and tracked so inspectors will know when this review is needed. Inspectors should know what format the state will expect the data to be presented in and how the state will consult with PWSs to evaluate modifications to disinfection practices so these issues can be discussed during the sanitary survey (see §142.16(g)(2)).

References for more detailed guidance

1. Disinfection Profiling and Benchmarking Guidance Manual, USEPA, August 1999 (EPA 815-R-99-013). Available from:

www.epa.gov/safewater/mdbp/implement.html; and Safe Drinking Water Hotline: 1-800-426-4791

3. Guidance Manual for Compliance With the Filtration and Disinfection Requirements for Public Water Systems Using Surface Water Sources, USEPA, March 1991 (PB93-222933).

Available from:

NTIS 5282 Port Royal Road Springfield, VA 22161 Phone: 1-800-533-6847

or

AWWA 6666 West Quincy Avenue Denver, CO 80235 Phone: 1-800-926-7337

4. Guidance Manual for Sanitary Surveys: Surface Water and Ground Water Under Direct Influence (GWUDI), USEPA, April 1999 (EPA 815-R-99-016)

Available from:

§142.16 Special primacy requirements. (b)(3) Sanitary survey (v): In its primacy application, the state must describe how it will decide whether a deficiency identified during a sanitary survey is significant for the purposes of paragraph (b)(1)(ii) of this section.

Guidance

During sanitary surveys inspectors often discover a wide range of deficiencies. Some are minor and have little near-term potential to pose risks to public health or safety. At the other end of the spectrum are those that are currently supplying drinking water that is unsafe or operating in a manner that threatens the safety of operators or the public. States must establish procedures for inspectors to use to determine the point where deficiencies become "significant."

The first step in this process should be to define a "significant deficiency." Many public health professionals believe that any aspect of a PWS (source, transmission, pumping, treatment, storage, distribution, operation, maintenance, management, etc.) that may cause, or have potential to cause, risks to public health or safety should be considered a significant deficiency. EPA does not specify the definition states must use; rather, it suggests that states use their best professional judgement and expertise to develop their own definitions. One potential definition that might be used is the following:

Significant deficiency: Any defect in a system's design, operation, maintenance, or administration, as well as any failure or malfunction of any system component, that the state determines to cause, or have the potential to cause, an unacceptable risk to health or that could affect the reliable delivery of safe drinking water.

The second step may be for the state to develop a procedure whereby inspectors can evaluate system defects and make a determination regarding "significance" (i.e., does it meet the state definition?). The procedure might begin with questions to be asked about each defect. A few examples (not intended to be complete) of questions that may help inspectors in making determinations include the following:

- Does the deficiency cause the potential for contaminants to be introduced to the drinking water?
- If left uncorrected will the deficiency cause the potential for the introduction of contaminants at some point in the future?
- Does the deficiency affect treatment in an unacceptable manner?
- Does the deficiency pose risks to the safety of the public or operators?

Finally, it should be helpful for states to develop a list of the most commonly found deficiencies that are significant and that require immediate corrective actions. EPA would expect the list to be expanded and modified over time based upon state experience. The following are some examples, organized by each of the eight sanitary survey components, of system defects that states may consider to be significant and require immediate corrective action (also not intended to be complete).

Source

- Raw water quality monitoring that is indicative of an immediate sanitary risk.
- Activities or pollution sources in the immediate source water area that will cause sanitary risks.
- Location of a well making it vulnerable to surface water runoff.

- A well that is not properly sealed (details of what is expected should be offered regarding, sanitary seals, vents, grouting, etc.).
- Spring boxes that are poorly constructed and/or subject to flooding.

Treatment

- The disinfection contact time is inadequate.
- One or more of the unit processes is incapable of producing water that meets standards under all conditions of raw water quality.
- There are no provisions to warn operators of membrane failures.
- No disinfection profile is available for review (for systems required to develop a disinfection profile).

Distribution and transmission

- Customers are receiving, and using for drinking water, raw water from the raw water transmission main.
- The raw water transmission main is equipped with a bypass around the treatment plant and the bypass does not have an air gap to prevent unintended bypass of untreated water.
- Disinfection residuals in the distribution system regularly do not meet state requirements.
- Pressures in parts of the distribution system fall below 20 psi during peak flows.
- High leakage rates pose unacceptable risks of back siphonage.

Finished water storage

- The elevation of the storage facilities is such that pressures within the distribution system fall below 20 psi during peak demands.
- The tank is not adequately sealed to prevent entry of contamination (unscreened or poorly designed vents, overflows, hatches, etc.).
- The elevated tank has not been inspected for sanitary defects for x years.

Pumps, pump facilities, and controls

- The pumping station is used for storage of materials that offer unacceptable potential for contamination of the water.
- The pumping station is used for storage of materials that pose safety risks to operators.
- Cross connections are present.
- Auxiliary power is needed to keep pressures above 20 psi during commonly experienced power outages.

Monitoring, reporting and data verification

- The system has been found to be in significant non-compliance (SNC) for one or more contaminants or for disinfectant residuals, or is approaching SNC status.
- Operators are using improper procedures and/or methods when conducting onsite lab analyses.
- The system is not using a certified laboratory.
- The system has been falsifying data

System management and operation

- The system has inadequate personnel to keep the plant manned as required by state regulations.
- The system has not developed a plan for provision of water during emergencies.

Operator compliance with state requirements

- The system has no certified operator.
- The system's certified operator is not complying with the state's continuing education requirements.

States should note that the above lists of significant deficiencies are provided in this guidance as examples of deficiencies that states may determine to be significant. The final determination of what constitutes a significant deficiency will be determined by each state on a case by case basis.

References for more detailed guidance

 Guidance Manual for Conducting Sanitary Surveys for Public Water Systems: Surface Water and Ground Water Under Direct Influence (GWUDI), USEPA, April 1999 (EPA 815-R-99-016). Available from:

www.epa.gov/safewater/mdbp/implement.html; and Safe Drinking Water Hotline: 1-800-426-4791

 How to Conduct a Sanitary Survey of Small Water Systems, University of Florida Training, Research and Education for Environmental Occupations Center (developed under EPA Training Grant T902854), 1998.

Available from:

National Environmental Training Association 5320 North 16th St, Suite 114 Phoenix, AZ 85016

Phone: 602-956-6099

3. State Sanitary Survey Resource Directory, AKA EPA/State Joint Guidance on Sanitary Surveys, Association of State Drinking Water Administrators, 1995.

Available from:

www.asdwa.org; or

ASDWA

1025 Connecticut Ave NW, Suite 903

Washington, DC 20036

4. Guidance Manual for Compliance With the Filtration and Disinfection Requirements for Public Water Systems Using Surface Water Sources, USEPA, March 1991 (PB93-222933).

Available from:

NTIS

5282 Port Royal Road Springfield, VA 22161

Phone: 1-800-533-6847

or

AWWA

6666 West Quincy Avenue

Denver, CO 80235

Phone: 1-800-926-7337

§142.16 Special primacy requirements. (g)(1) Enforceable requirements: States must have the appropriate rules or other authority to require PWSs to conduct a Composite Correction Program (CCP) and to assure that PWSs implement any follow up recommendations that result as part of the CCP (See the rule for a description of the CCP components).

Background

Many states have raised a concern regarding the interpretation of this special primacy condition and asked EPA to clarify the intent. Some states have interpreted this special primacy condition to mean the state must have the authority to require systems to implement recommendations. EPA hereby clarifies that the intent of this special primacy condition is to ask the state to describe a procedure to assure follow-up on the outcome of the CCP.

As discussed in the handbook Optimizing Water Treatment Plant Performance Using the Composite Correction Program, the CCP has been developed and demonstrated as a method of optimizing surface water treatment plant performance with respect to protection from microbial pathogens. The approach is based on establishing effective use of the available water treatment process barriers against passage of particles to the finished water. The CCP is composed of two components: 1.) Comprehensive Performance Evaluation (CPE) and 2.) Comprehensive Technical Assistance. A CPE is a through review and analysis of a plant's performance-based capabilities and associated administrative, operation, and maintenance practices as they relate to achieving optimum performance from the facility. A CPE does not identify recommendations or solutions. A CPE identifies performance limiting factors. A CTA is the performance improvement phase that is implemented if the CPE results indicate performance improvement potential.

Guidance

The first part of the special primacy requirement can be satisfied by a description of statutes, rules, and other authority (other than their imminent and substantial endangerment authority) the state can use to require PWSs to conduct a Composite Correction Program (CCP). The appropriate section(s) of each source of authority should be cited and copies of the written documents must be included in the revision application package. The state should explain how the authorities will be used to require CCPs. States may also wish to address their authority to take administrative and/or legal actions and assess penalties. The second part of this special primacy requirement can be satisfied with a description of a procedure that will be used to assure follow up on the outcome of a CCP.

Additionally, states should note that this requirement of the IESWTR is intended to ensure that states have authority to require comprehensive performance evaluations or comprehensive technical assistance in situations beyond those in which the IESWTR establishes the requirement for CPEs. Therefore, states may wish to consider other circumstances under which the requirement for performing a CPE or CTA might be desirable. States should consider development of prioritization procedures for targeting systems that need CPEs and should determine what performance-limiting factors (A, B, or C factors) should be corrected. To obtain the authority to ensure that systems conduct a CTA when necessary, states may want to add a requirement in their regulations that would require systems to go through with a CTA when the CPE required by the triggers in §141.175 of the rule show that a CTA would be beneficial.

Another consideration for states is that §141.175 of the IESWTR requires systems, under certain circumstances, to have a CPE conducted by the state or a third party approved by the state. If a state does not have adequate resources to conduct the expected CPEs, it may wish to begin development of a procedure for approving third parties that have the necessary expertise and meet other criteria established by the state.

References for more detailed guidance

1. Optimizing Water Treatment Plant Performance Using the Composite Correction Program, USEPA, Revised August 1998 (EPA/625/6-91/027).

Available from:

Safe Drinking Water Hotline: 1-800-426-4791

2. Optimizing Water Treatment Plant Performance Using the Composite Correction Program, USEPA, February 1991 (EPA/625/6-91/027).

Available from:

Safe Drinking Water Hotline: 1-800-426-4791

3. Summary Report: Optimizing Water Treatment Plant Performance With the Composite Correction Program, USEPA, 1990 (EPA/625/8-90/017).

Available from:

Safe Drinking Water Hotline: 1-800-426-4791

§142.16 Special primacy requirements. (g)(2) State practices or procedures. (i): Section 141.172(a)(3) of this chapter—How the state will approve a more representative annual data set other than the data set determined under §141.172(a)(1) or (2) of this chapter for the purpose of determining applicability of the requirements of §141.172 of this chapter.

*NOTE: Systems which requested the use of a more representative annual data set must have had this request approved by the state such that applicable systems would begin disinfection profiling by April 1, 2000. This one-time provision occurs prior to the date which states are required to submit their primacy application. Therefore, a state's primacy application which does not address the above provision (§142.16(g)(2)(i)) will still be considered complete. However, if a state chooses to address the above special primacy condition, the guidance below will aid the state in doing so.

Guidance

Section 141.172(a)(3) allows systems to request the state to approve their use of a more representative data set for determining if the system is required to develop a disinfection profile. Requests for approval to use a more representative data set may occur when a system has modified its treatment in a manner such that the data collected pursuant to §141.172(a)(1) or (2) no longer reflect the potential for production of disinfection byproducts. Use of a more representative data set would also be appropriate if the sampling, handling, and/or analysis of the data collected pursuant to §141.172(a)(1) or (2) were of questionable quality. Alternative data may also be necessary due to atypical climatological events or changes in source water.

EPA believes that requests for use of alternative data sets are best handled by states on a case-by-case basis. Therefore, to meet this special primacy requirement, states' applications for program revision must demonstrate that each request for use of a more representative data set will be evaluated on its merits and approved only when a data set exists, or can be collected within the established time frame, that is more representative of the system's potential for production of disinfection byproducts.

References for more detailed guidance

1. Disinfection Profiling and Benchmarking Guidance Manual, USEPA, August 1999 (EPA 815-R-99-013).

Available from:

www.epa.gov/safewater/mdbp/implement.html; and Safe Drinking Water Hotline: 1-800-426-4791

2. Microbial and Disinfection Byproduct Rules Simultaneous Compliance Guidance Manual, USEPA, August 1999 (EPA 815-R-99-015).

Available from:

www.epa.gov/safewater/mdbp/implement.html; and Safe Drinking Water Hotline: 1-800-426-4791

§ 142.16 Special primacy requirements. (g)(2) State practices or procedures. (ii): Section 141.172(b)(5) of this chapter—How the state will approve a method to calculate the logs of inactivation for viruses for a system that uses either chloramines or ozone for primary disinfection.

Guidance

Section 141.172(b)(5) of the IESWTR requires systems that use ozone or chloramines as primary disinfectants to calculate the logs of inactivation of viruses using a method approved by the state. This calculation is in addition to the calculation of the logs inactivation for *Giardia lamblia* and is required because, for these disinfectants, EPA expects greater CT will be necessary to achieve the necessary virus inactivation than will be necessary for inactivation of *Giardia lamblia*. In their primacy revision applications, states must describe how they will approve a method to calculate the logs of inactivation for viruses.

When determining virus inactivation, PWSs will be required to calculate the total CT from the point(s) of disinfectant application to the first customer. This procedure for determining CT for purposes of disinfection profiling under the IESWTR is outlined in §141.172(b) of the rule. It differs from that of the Surface Water Treatment Rule (SWTR) guidance which simply required a demonstration that minimum inactivation requirements were being met but did not require a demonstration of the extent to which the requirements were exceeded.

After the PWS has determined its daily peak hour's CT, it must determine the logs of inactivation for viruses. EPA suggests that states, to the extent practicable, use the Guidance Manual for Compliance With the Filtration and Disinfection Requirements for Public Water Systems Using Surface Water Sources (SWTR Guidance Manual) for determining how systems should calculate the logs of inactivation of viruses, and thus meet this special primacy requirement. Suggested methods of doing so are as follows:

For systems using chloramines as a primary disinfectant

Table E-13 of the SWTR Guidance Manual presents CT values for 2 log, 3 log, and 4 log inactivation of viruses by chloramine at temperatures ranging from <1° C to 25° C. The table is appropriate for use by systems that add chlorine prior to ammonia and, therefore, get some benefit of a short-lived free chlorine residual. The basis for the inactivation values in Table E-13, is discussed in Appendix F (Section F.2.3 Chloramines) of the manual. Systems that add the two chemicals concurrently, or those adding ammonia first, have little free chlorine and cannot use Table E-13 but may determine viral inactivation efficiencies by using the protocol found in Appendix G of the manual.

For systems using ozone as a primary disinfectant

Table E-11 of the SWTR Guidance Manual shows CT values for 2 log, 3 log, and 4 log inactivation of viruses by ozone over a temperature range of <1° C to 25° C. EPA believes it to be appropriate for states to have PWSs use Table E-11 for calculating the logs of inactivation of viruses. Appendix F (F.2.4 Ozone) of the SWTR Guidance Manual offers a short discussion of the basis for the values in the table.

Other methods

States may approve other methods for calculation of the logs of inactivation for viruses for systems using ozone or chloramines as long as the methods are adequately explained in the primacy revision application and are technically correct.

References for more detailed guidance

 Guidance Manual for Compliance With the Filtration and Disinfection Requirements for Public Water Systems Using Surface Water Sources, USEPA, March 1991 (PB93-222933). Available from:

NTIS

5282 Port Royal Road Springfield, VA 22161 Phone: 1-800-533-6847

or

AWWA

6666 West Quincy Avenue

Denver, CO 80235 Phone: 1-800-926-7337

2. Alternative Disinfectants and Oxidants Guidance Manual, USEPA, April 1999 (EPA 815-R-99-014). Available from:

www.epa.gov/safewater/mdbp/implement.html; and Safe Drinking Water Hotline: 1-800-426-4791

§142.16 Special primacy requirements. (g)(2) State practices or procedures. (iii): Section 141.172(c) of this chapter—How the state will consult with PWSs to evaluate modifications to disinfection practice.

Guidance

The IESWTR requires systems to develop a disinfection profile if they have concentrations of TTHM or HAA5 at or above 80 percent of the respective maximum contaminant levels. Systems that are required to develop disinfection profiles, and that later want to make a significant change to their disinfection practice, must consult with the state prior to making such change. As described in §141.172(c)(1) of the IESWTR, significant changes include:

- Changes to the point of disinfection
- Changes to the disinfectant(s) used in the treatment plant
- Changes to the disinfection process
- Any other modification identified by the state

Examples of state-identified modifications may include source water, pretreatment, contact basin geometry and baffling, or in some instances changes in pH.

This requirement of the IESWTR is intended to ensure that systems attempting to reduce disinfection byproduct production do not make changes that cause unintended and unacceptable increases in microbial risks. In order for §141.172(c)(1) of the IESWTR to be effective, states must identify all systems that are required to develop a disinfection profile and provide them with guidance in terms of when, and under what circumstances, consultation is necessary. It should be noted that the IESWTR requires "consultation" with the state but does not prescribe the outcome of the consultation.

In their applications for program revision, states must explain how they will consult with systems to evaluate changes in disinfection practices. EPA suggests that states, in the consultation process, consider the following:²

- Why the change is being proposed.
- The positive impacts of the change.
- The negative impacts of the change.
- The alternative benchmark.
- Are there alternatives that achieve the desired goal and, if so, have they been evaluated?

Finally, the state should work with the PWS in an effort to reach a conclusion that considers, weighs, and balances the risks of microbial contaminants and disinfection byproducts. Ultimately, the state and system should jointly make a public-health-based decision using all available information.

References for more detailed guidance

 Disinfection Profiling and Benchmarking Guidance Manual, USEPA, August 1999 (EPA 815-R-99-013). Available from:

www.epa.gov/safewater/mdbp/implement.html; and Safe Drinking Water Hotline: 1-800-426-4791

2. Microbial and Disinfection Byproduct Rules Simultaneous Compliance Guidance Manual, USEPA, August 1999 (EPA 815-R-99-015).

Available from:

www.epa.gov/safewater/mdbp/implement.html; and Safe Drinking Water Hotline: 1-800-426-4791

² More detailed guidance and strategies for simultaneous achievement of acute and chronic public health protection are addressed in the two listed EPA references.

§142.16 Special primacy requirements. (g)(2) State practices or procedures. (iv): Section 141.173(b) of this chapter—For filtration technologies other than conventional filtration treatment, direct filtration, slow sand filtration, or diatomaceous earth filtration, how the state will determine that a public water system may use a filtration technology if the PWS demonstrates to the state, using pilot plant studies or other means, that the alternative filtration technology, in combination with disinfection treatment that meets the requirements of §141.172(b) of this chapter, consistently achieves 99.9 percent removal and/or inactivation of Giardia lamblia cysts and 99.99 percent removal and/or inactivation of viruses, and 99 percent removal of Cryptosporidium oocysts. For a system that makes this demonstration, how the state will set turbidity performance requirements that the system must meet 95% of the time and that the system may not exceed at any time at a level that consistently achieves 99.9 percent removal and/or inactivation of Giardia lamblia cysts, 99.99 percent removal and/or inactivation of viruses, and 99 percent removal of Cryptosporidium oocysts.

Guidance

The SWTR and IESWTR establish performance standards for several long-established types of surface water treatment technologies, including conventional treatment, direct filtration, slow sand filtration, and diatomaceous earth filtration. These technologies, when properly designed and operated, used in conjunction with disinfection and contact time, and applied to appropriate surface waters, are capable of protecting against the health risks associated with *Giardia lamblia*, *Legionella*, viruses, *Cryptosporidium*, and other pathogens. Section 141.173(b) of the IESWTR allows PWSs to use technologies other than those mentioned above if they demonstrate to the state's satisfaction that the chosen technology consistently meets the rule's minimum removal and inactivation requirements, and the state approves the use of the technology. When the state grants approval for the use of alternative technologies, it must establish a turbidity performance limit the system must meet at least 95 percent of the time and a turbidity limit the system may not exceed at any time. The state must set the turbidity limits at levels that ensure the removal and/or inactivation requirements are consistently achieved.

To qualify for the authority to use the discretion provided for by §141.173(b) of the IESWTR, states must, in their primacy revision application, describe how they will determine whether a PWS will or will not be granted approval for use of an alternative technology *and* how the state will establish the requisite turbidity performance standards.

Most states have a review and approval process that addresses all significant modifications to PWSs (not just alternative technologies). In their review of treatment technologies, states generally consider all relevant components necessary to provide consistently safe drinking water including raw water quality and its variability, pretreatment needs, design flow rates, disinfection, storage, monitoring, and operation and maintenance requirements. Because alternative technologies generally do not have long performance histories to base approval/permitting decisions upon, states may wish to apply an additional margin of scrutiny in their review process. The technologies should be evaluated not only on the basis of finished water quality, but also with consideration of operational complexities, the potential for cross connections, redundancy, the ability to handle variable raw water qualities, leaching of contaminants, and long term reliability. Pilot studies are often necessary to adequately demonstrate that an alternative technology is appropriate for use at a particular site.

Guidance has been developed for states to use in determining how to grant approvals for alternative technologies. This guidance generally does not address the current concern for *Cryptosporidium*. The protocols that have been developed and used to assess the performance of technologies in terms of *Giardia lamblia* removal may, however, be revised for *Cryptosporidium* removal evaluations. EPA recommends that states consider the guidance on these issues presented in Section 4.3.7 and Appendix M of the SWTR Guidance Manual (reference 3) as well as the Western States Workgroup's *Consensus Protocol for Evaluation and Acceptance of Alternate Surface Water Filtration Technologies in Small System Applications*, 1992 (reference 1). The protocol developed by the Western States Workgroup establishes a

procedure and criteria for evaluation of alternative filtration technologies and should be particularly useful. The following is an outline of the protocol's procedural steps.

1) System component evaluation for leaching of contaminants.

2) Demonstration of Giardia (and Cryptosporidium) removal performance.

a. Microscopic Particulate Analyses (MPA).

- b. Giardia/Cryptosporidium surrogate particle removal evaluations.
- c. Particle size analysis demonstration for Giardia (and Cryptosporidium) removal credit.

d. Live Giardia/Cryptosporidium challenge studies.

- 3) On-site demonstration of performance effectiveness.
 - a. Prior testing of an identical system on a similar water.
 - b. Conditional acceptance with a performance bond.
 - c. Pilot testing with MPAs, appropriate monitoring, and final engineering report.

The final step in the process is for states to establish turbidity limits for the technologies. This was not necessary under the SWTR's requirements because the limits for alternative technologies defaulted to the performance limits established for slow sand filtration. When establishing the performance limits, states should give consideration to, among other things, cyst removal efficiencies, potential for interference with disinfection, potential for interference with bacteriological testing, and the technology (failure indicators) redundant components.

References for more detailed guidance

 Consensus Protocol for Evaluation and Acceptance of Alternate Surface Water Filtration Technologies in Small System Applications, Western States Workgroup, April 1992.
 Available from:

Safe Drinking Water Hotline: 1-800-426-4791

2. State Alternative Technology Approval Protocol, Association of State Drinking Water Administrators/USEPA, 1996.

Available from:

www.asdwa.org; or ASDWA 1025 Connecticut Avenue, NW Suite 903 Washington, DC 20036

 Guidance Manual for Compliance With the Filtration and Disinfection Requirements for Public Water Systems Using Surface Water Sources, USEPA, March 1991 (PB93-222933).

Available from:

NTIS 5282 Port Royal Road Springfield, VA 22161 Phone: 1-800-533-6847

or

AWWA 6666 West Quincy Avenue Denver, CO 80235 Phone: 1-800-926-7337 Section IV.

Other Resources and Guidance

This page is left intentionally blank.

IV-A. Technical Information Available on the IESWTR

A series of guidance manuals support the IESWTR. The manuals will aid EPA, state agencies, and affected PWSs in implementing this rule and will help ensure that implementation among these groups is consistent. Summaries of the manuals and information on how to obtain them are provided below. The six technical guidance manuals associated with the IESWTR are:

- ✓ Disinfection Profiling and Benchmarking Guidance Manual
- ✓ Guidance Manual for Compliance with the Interim Enhanced Surface Water Treatment Rule: Turbidity Provisions
- ✓ Alternative Disinfectants and Oxidants Guidance Manual
- ✓ Guidance Manual for Conducting Sanitary Surveys of Public Water Systems
- Uncovered Finished Water Reservoirs Manual
- ✓ Microbial and Disinfection Byproducts Rules Simultaneous Compliance Guidance Manual

Disinfection Profiling and Benchmarking Guidance Manual (EPA 815-R-99-013)

Objective:

Help determine if a disinfection profile (an evaluation of current disinfection practices) is required and how to do one; when a disinfection benchmark must be determined and how to extract it from the profile, and; how a PWS must use the benchmark, in consultation with the state, to assure protection from microbial risk is maintained when the system changes its disinfection practice.

Contents:

The manual provides detailed information on the following subjects: applicability of the profiling and benchmarking requirements to public water systems; procedures for generating a disinfection profile, including example profiles; methods for calculating the disinfection benchmark, including example calculations; the use of the benchmark in modifying disinfection practices, communication with the state, and assessing significant changes to disinfection practices; the development of the profiling and benchmarking regulations; the significance of the log inactivation concept and CT values for inactivations achieved by various disinfectants; and the determination of contact time.

Guidance Manual for Compliance with the Interim Enhanced Surface Water Treatment Rule: Turbidity Provisions (EPA 815-R-99-010)

Objective:

The first section provides information regarding specific requirements of the IESWTR relating to turbidity and is intended for experienced operators and others in the regulated community. The second section of the document provides background on concepts surrounding turbidity and serves as a primer for less experienced operators and individuals.

Contents:

The first section contains key regulatory requirements, including combined filter effluent monitoring and individual filter monitoring; recordkeeping and reporting requirements; additional compliance issues, such as compliance schedules, public notification, variances/exemptions, and follow-up action requirements; approved methods and additional methods and additional measurement and calibration issues; components and description of a filter self-assessment, and; components and description of a Comprehensive Performance Evaluation. The second section of the manual includes more basic information on turbidity; description of the particles (both natural and man-made) that typically contribute to turbidity; discussion of typical steps in a treatment process and how turbidity is removed or created in each step; discussion of turbidity in different source waters with an emphasis of how changes in source water affect turbidity, and; basic turbidimeter design.

Alternative Disinfectants and Oxidants Guidance Manual (EPA 815-R-99-014)

Objective: To provide technical data and engineering information on disinfectants and oxidants that are

not as commonly used as chlorine so that systems can evaluate their options for developing disinfection schemes to control water quality problems such as zebra mussels and Asiatic clams, and oxidation to control water quality problems associated with iron and manganese.

Contents: The manual discusses six disinfectants and oxidants: ozone, chlorine dioxide, potassium

permanganate, chloramines, ozone/hydrogen peroxide combinations, and ultraviolet light. A decision tree is provided to assist in evaluating which disinfectant, or disinfectants, is most appropriate given certain site-specific conditions (e.g., water quality conditions, existing treatment, and operator skill). The manual also contains a summary of existing alternative disinfectants used in the U.S. and cost estimates for the use of alternative disinfectants.

Guidance Manual for Conducting Sanitary Surveys of Public Water Systems (EPA 815-R-99-016)

Objective: Provides an overview of how to conduct a sanitary survey of all water systems using

surface water and ground water under the direct influence of surface water. It is intended to

help state agencies improve their sanitary survey programs where needed.

Contents: The manual provides information about the objective and regulatory context of sanitary

surveys. It covers four principal stages of a sanitary survey: planning, including preparatory steps to be taken by inspectors before conducting the on-site portion conducting the on-site

survey, compiling a sanitary survey report, and performing follow-up activities.

Uncovered Finished Water Reservoirs Manual (EPA 815-R-99-011)

Objective: To provide information on ways to limit water quality degradation in existing uncovered

finished water reservoirs.

Contents: Provides detailed information on the following subjects: developing and implementing

comprehensive open finished water reservoir management plans based on site-specific conditions; identifying potential sources of contamination in open finished water reservoirs and potential mitigation measures; employing different methods to control the degradation of water quality while it resides in the reservoir; monitoring schemes that can be used to characterize water quality and identify water quality degradation before it becomes severe

and difficult to correct.

Microbial and Disinfection Byproducts Rules Simultaneous Compliance Guidance Manual (EPA 815-R-99-015)

Objective: To assist PWSs on complying simultaneously with various drinking water regulations (e.g.,

Stage 1 DBPR, IESWTR, Lead and Copper Rule, and the Total Coliform Rule). The manual discusses operational problems systems may encounter when implementing these

rule.

Contents: The manual provides detailed information on the requirements in the Stage 1 DBPR and

the IESWTR.

Links to these manuals can be found at the website: www.epa.gov/safewater/mdbp/implement.html.

They are also available free of charge (while supplies last) from:

- The National Service for Environmental Publications (NSCEP, formerly NCEPI) at 1.800.490.9198
- The Office of Water Resource Center at 1.202.260.7786.

Customers can purchase these documents for a fee from:

The National Technical Information Service (NTIS) at 1.800.553.6847.

For more information, contact EPA's Safe Drinking Water Hotline at 1.800.426.4791.

IV-B. Profiling Spreadsheet

An electronic spreadsheet to assist PWSs performing disinfection profiles is available on the EPA web site (see http://www.epa.gov/safewater/mdbp/implement.html).

IV-C. List of Labs Approved to Perform Analysis for the ICR

For an updated list, please refer to the Safe Drinking Water Hotline (1.800.426.4791) or the EPA web site (www.epa.gov/ogwdw/lablist/lname.html).

IV-D. Rule Presentation

A presentation that can be used for workshops for the IESWTR is available in Power Point format on the Drinking Water Academy web site.

(http://www.epa.gov/safewater/dwa/electronic/M-DBPmodule.html).

IV-E. Fact Sheets

The following pages are fact sheets on the rules. They may be useful in conveying information to water systems, new personnel, and for educating stakeholders about the rules. The fact sheets are included in this section are:

- ✓ Drinking Water Priority Rulemaking: Microbial and Disinfection Byproduct Rules
- ✓ Interim Enhanced Surface Water Treatment Rule
- ✓ Disinfection Profiling and Benchmarking
- ✓ Interim Enhanced Surface Water Treatment Rule: Quick Reference Guide

This page is left intentionally blank.



Drinking Water Priority Rulemaking: Microbial and Disinfection Byproduct Rules

Disinfection of drinking water is one of the major public health advances in the 20th century. One hundred years ago, typhoid and cholera epidemics were common throughout American cities and disinfection was a major factor in reducing these epidemics. However, the disinfectants themselves can react with naturally-occurring materials in the water to form unintended byproducts which may pose health risks.

Over the past ten years, we have also learned that there are specific microbial pathogens, such as *Cryptosporidium*, that are highly resistant to traditional disinfection practices. In 1993, *Cryptosporidium* caused 400,000 people in Milwaukee to experience intestinal illness. More than 4,000 were hospitalized, and at least 50 deaths have been attributed to the disease. There have also been cryptosporidiosis outbreaks in Nevada, Oregon, and Georgia over the past several years.

A major challenge for water suppliers is how to balance the risks from microbial pathogens and disinfection byproducts. It is important to provide protection from these microbial pathogens while simultaneously ensuring decreasing health risks to the population from disinfection byproducts (DBPs). The Safe Drinking Water Act (SDWA) Amendments, signed by President Clinton in August 1996, required EPA to develop rules to achieve these goals.

These new rules are a product of six years of collaboration between the water industry, environmental and public health groups, and local, state and federal government. This fact sheet contains general information about the two new rules and others that are a part of the Microbial-Disinfectants and Disinfection Byproducts (M-DBP) Rules. Separate fact sheets focus on the Interim Enhanced Surface Water Treatment Rule (EPA 816-F-01-013) and the Stage 1 Disinfectants and Disinfection Byproducts Rule (EPA 816-F-01-014).

Schedule of M-DBP Rules

December 16, 1998 – Final Rule	Interim Enhanced Surface Water Treatment Rule and Stage 1 Disinfectants and Disinfection Byproducts Rule
June 8, 2001 – Final Rule	Filter Backwash Recycling Rule
Summer 2001 – Final Rule	Long Term 1 Enhanced Surface Water Treatment Rule
Spring/Summer 2002 - Final Rule	Ground Water Rule
May 2002 – Final Rule	Long Term 2 Enhanced Surface Water Treatment Rule and Stage 2 Disinfectants and Disinfection Byproducts Rule

PUBLIC HEALTH CONCERNS

Most Americans drink tap water that meets all existing health standards all the time. These new rules will further strengthen existing drinking water standards and thus increase protection for many water systems.

In 1990, EPA's Science Advisory Board concluded that exposure to microbial contaminants such as bacteria, viruses, and protozoa (e.g., *Giardia lamblia* and *Cryptosporidium*) was likely the greatest remaining health risk management challenge for drinking water suppliers. Acute health effects from exposure to microbial pathogens is documented and associated illness can range from mild to moderate cases lasting only a few days to more severe infections that can last several weeks and may result in death for those with weakened immune systems.

While disinfectants are effective in controlling many microorganisms, they react with natural organic and inorganic matter in source water and the distribution system to form potentially harmful DBPs. Many of these DBPs have been shown to cause cancer and reproductive and developmental effects in laboratory animals. More than 200 million people consume water that has been disinfected. Because of the large population exposed, health risks associated with DBPs, even if small, need to be taken seriously.

EXISTING REGULATIONS

- Surface Water Treatment Rule The Surface Water Treatment Rule, promulgated in 1989, applies to all public water systems using surface water sources or ground water sources under the direct influence of surface water. It establishes maximum contaminant level goals (MCLGs) for viruses, bacteria and Giardia lamblia. It also includes treatment technique requirements for filtered and unfiltered systems that are specifically designed to protect against the adverse health effects of exposure to these microbial pathogens.
- <u>Total Coliform Rule</u> The Total Coliform Rule, revised in 1989, applies to all PWSs and establishes a maximum contaminant level (MCL) for total coliforms.
- <u>Total Trihalomethane Rule</u> In 1979, EPA set an interim MCL for total trihalomethanes of 0.10 mg/l as an annual average. This applies to any community water system serving at least 10,000 people that adds a disinfectant to the drinking water during any part of the treatment process.
- <u>Information Collection Rule</u> The Information Collection Rule, promulgated in 1996, established monitoring and data reporting requirements for large public water systems serving at least 100,000 people to support the M-DBP rulemaking process. This rule was intended to provide EPA with information on the occurrence in drinking water of microbial pathogens and DBPs. In addition, EPA collected engineering data on how PWSs currently control such contaminants.

INTERIM ENHANCED SURFACE WATER TREATMENT RULE AND STAGE 1 DISINFECTANTS AND DISINFECTION BYPRODUCTS RULE

EPA published the Interim Enhanced Surface Water Treatment Rule and Stage 1 Disinfectants and Disinfection Byproducts Rule in December 1998. The final rules resulted from formal regulatory negotiations with a wide range of stakeholders that took place in 1992-93 and 1997.

Interim Enhanced Surface Water Treatment Rule

The Interim Enhanced Surface Water Treatment Rule applies to systems using surface water, or ground water under the direct influence of surface water, that serve 10,000 or more persons. The rule also includes provisions for states to conduct sanitary surveys for surface water systems regardless of system size. The rule builds upon the treatment technique requirements of the Surface Water Treatment Rule with the following key additions and modifications:

- Maximum contaminant level goal (MCLG) of zero for Cryptosporidium.
- 2-log Cryptosporidium removal requirements for systems that filter.
- Strengthened combined filter effluent turbidity performance standards.
- Individual filter turbidity monitoring provisions.
- Disinfection profiling and benchmarking provisions.
- Systems using ground water under the direct influence of surface water now subject to the new rules dealing with *Cryptosporidium*.
- Inclusion of Cryptosporidium in the watershed control requirements for unfiltered public water systems.
- Requirements for covers on new finished water storage facilities.
- Sanitary surveys, conducted by states, for all surface water systems regardless of size.

The Interim Enhanced Surface Water Treatment Rule, with tightened turbidity performance criteria and required individual filter monitoring, is designed to optimize treatment reliability and to enhance physical removal efficiencies to minimize the *Cryptosporidium* levels in finished water. In addition, the rule includes disinfection benchmark provisions to assure continued levels of microbial protection while facilities take the necessary steps to comply with new DBP standards.

Stage 1 Disinfectants and Disinfection Byproducts Rule

The final Stage 1 Disinfectants and Disinfection Byproducts Rule applies to community water systems and non-transient non-community systems and transient noncommunity systems using chlorine dioxide, (including systems serving fewer than 10,000 people), that add a disinfectant to the drinking water during any part of the treatment process.

The Stage 1 Disinfectants and Disinfection Byproducts Rule includes the following key provisions:

- Maximum residual disinfectant level goals (MRDLGs) for chlorine (4 mg/L), chloramines (4 mg/L), and chlorine dioxide (0.8 mg/L).
- Maximum contaminant level goals (MCLGs) for three trihalomethanes (bromodichloromethane (zero), dibromochloromethane (0.06 mg/L), and bromoform (zero)), two haloacetic acids (dichloroacetic acid (zero) and trichloroacetic acid (0.3 mg/L)), bromate (zero), and chlorite (0.8 mg/L).
- MRDLs for three disinfectants (chlorine (4.0 mg/L), chloramines (4.0 mg/L), and chlorine dioxide (0.8 mg/L)).
- MCLs for total trihalomethanes (0.080 mg/L) a sum of the three listed above plus chloroform, haloacetic acids (HAA5) (0.060 mg/L)- a sum of the two listed above plus monochloroacetic acid and mono- and dibromoacetic acids), and two inorganic disinfection byproducts (chlorite (1.0 mg/L)) and bromate (0.010 mg/L)).
- A treatment technique for removal of DBP precursor material.

The terms MRDLG and MRDL, which are not included in the SDWA, were created during the negotiations to distinguish disinfectants (because of their beneficial use) from contaminants. The rule also includes monitoring, reporting, and public notification requirements for these compounds and describes the best available technology (BAT) upon which the MRDLs and MCLs are based.

FUTURE RULES

Long Term 1 Enhanced Surface Water Treatment Rule

While the Stage 1 Disinfectants and Disinfection Byproducts Rule will apply to systems of all sizes, the Interim Enhanced Surface Water Treatment Rule only applies to systems serving 10,000 or more people. The Long Term 1 Enhanced Surface Water Treatment Rule, expected in 2001, will strengthen microbial controls for small systems (i.e. those systems serving fewer than 10,000 people). The rule will also prevent significant increase in microbial risk where small systems take steps to implement the Stage 1 Disinfectants and Disinfection Byproducts Rule.

EPA believes that the rule will generally track the approaches in the Interim Enhanced Surface Water Treatment Rule for improved turbidity control, including individual filter monitoring and reporting. The rule will also address disinfection profiling and benchmarking.

Long Term 2 Enhanced Surface Water Treatment Rule and Stage 2 Disinfectants and Disinfection Byproduct Rule

The SDWA, as amended in 1996, requires EPA to finalize a Stage 2 Disinfectants and Disinfection Byproducts Rule by May 2002. Although the 1996 Amendments do not require EPA to finalize a Long Term 2 Enhanced Surface Water Treatment Rule along with the Stage 2 Disinfectants and Disinfection Byproducts Rule, EPA believes it is important to finalize these rules together to ensure a proper balance between microbial and DBP risks.

EPA began discussions with stakeholders in December 1998 on the direction for these rules. EPA anticipates proposed rules in 2001. The intent of the rules is to provide additional public health protection, if needed, from DBPs and microbial pathogens.

Ground Water Rule

EPA is finalizing the Ground Water Rule which specifies the appropriate use of disinfection and, just as importantly, addresses other components of ground water systems to ensure public health protection. There are more than 158,000 public ground water systems. Almost 89 million people are served by community ground water systems, and 20 million people are served by non-community ground water systems. Ninety-nine percent (157,000) of ground water systems serve fewer than 10,000 people. However, systems serving more than 10,000 people serve 55 percent (more than 60 million) of all people who get their drinking water from public ground water systems.

Filter Backwash Recycling Rule

The Filter Backwash Recycling Rule establishes a standard to return all recycle flows to a point that incorporates all treatment processes of the system's existing conventional or direct filtration systems or at an alternate location approved by the state. The regulation will apply to public water systems that use surface water or ground water under the direct influence of surface water, practice conventional or direct filtration, and recycle spent filter backwash, sludge thickener supernatant, or liquids from dewatering processes. The rule was promulgated on June 8, 2001.

ADDITIONAL INFORMATION

EPA encourages public input into regulation development. Public meetings and opportunities for public comment on M-DBP rules are announced in the *Federal Register*. EPA's Office of Ground Water and Drinking Water also provides this information for the M-DBP rules and other programs in its online Calendar of Events.

For more information, contact EPA's Safe Drinking Water Hotline, 1-800-426-4791, or see the Office of Ground Water and Drinking Water web page at http://www.epa.gov/safewater/standards.html.

This page is left intentionally blank.

Interim Enhanced Surface Water Treatment Rule

Disinfection of drinking water is one of the major public health advances in the 20th century. One hundred years ago, typhoid and cholera epidemics were common through American cities and disinfection was a major factor in reducing these epidemics. However, the disinfectants themselves can react with naturally-occurring materials in the water to form unintended byproducts which may pose health risks.

In the past ten years, however, we have learned that there are specific microbial pathogens, such as *Cryptosporidium*, that are resistant to traditional disinfection practices. In 1993, *Cryptosporidium* caused 400,000 people in Milwaukee to experience intestinal illness. More than 4,000 were hospitalized, and at least 50 deaths have been attributed to the disease. There have also been cryptosporidiosis outbreaks in Nevada, Oregon, and Georgia over the past several years.

Amendments to SDWA in 1996 require EPA to develop rules to balance the risks. It is important to strengthen protection against microbial contaminants, especially *Cryptosporidium*, and at the same time, reduce potential health risks from disinfection byproducts. The new Interim Enhanced Surface Water Treatment Rule and Stage 1 Disinfectants and Disinfection Byproducts Rule are among the first of a set of rules under the Amendments. This fact sheet focuses on the Interim Enhanced Surface Water Treatment Rule. A separate fact sheet focuses on the Stage 1 Disinfectants and Disinfection Byproducts Rule (EPA 816-F-01-014).

PUBLIC HEALTH CONCERNS FROM MICROBIAL CONTAMINANTS IN DRINKING WATER

In 1990, EPA's Science Advisory Board concluded that exposure to microbial contaminants such as bacteria, viruses, and protozoa (e.g., *Giardia lamblia* and *Cryptosporidium*) was likely the greatest remaining health risk management challenge for drinking water suppliers. Acute health effects from exposure to microbial pathogens is documented and associated illness can range from mild to moderate cases lasting only a few days to more severe infections that can last several weeks and may result in death for those with weakened immune systems.

WHO MUST COMPLY WITH THE

The Interim Enhanced Surface Water Treatment Rule applies to public water systems that use surface water or ground water under the direct influence of surface water (GWUDI) and serve at least 10,000 people. In addition, states are required to conduct sanitary surveys for all surface water and GWUDI systems, including those that serve fewer than 10,000 people.

WHAT DOES THE RULE REQUIRE?

The Interim Enhanced Surface Water Treatment Rule amends the existing Surface Water Treatment Rule to strengthen microbial protection, including provisions specifically to address *Cryptosporidium*, and to address risk trade-offs with disinfection byproducts. The final rule includes treatment requirements for the waterborne pathogen *Cryptosporidium*. In addition, systems must continue to meet existing requirements for *Giardia lamblia* and viruses. Specifically, the rule includes:

- Maximum contaminant level goal (MCLG) of zero for Cryptosporidium.
- 2-log Cryptosporidium removal requirements for systems that filter.
- Strengthened combined filter effluent turbidity performance standards for systems using conventional and direct filtration.
- · Individual filter turbidity monitoring provisions for systems using conventional and direct filtration.
- Disinfection profiling and benchmarking provisions.
- Systems using ground water under the direct influence of surface water now subject to the new rules dealing with *Cryptosporidium*.
- Inclusion of Cryptosporidium in the watershed control requirements for unfiltered public water systems.
- Requirements for covers on new finished water storage facilities.
- · Sanitary surveys, conducted by states, for all surface water systems regardless of size.

The rule, with tightened turbidity performance criteria and individual filter monitoring requirements, is designed to optimize treatment reliability and to enhance physical removal efficiencies to minimize the *Cryptosporidium* levels in finished water. Turbidity requirements for combined filter effluent will remain at least every four hours, but continuous monitoring (record results every 15 minutes) will be required for individual filters at conventional and direct filtration plants. In addition, the rule includes disinfection profiling and benchmarking provisions to assure continued levels of microbial protection while facilities take the necessary steps to comply with new DBP standards.

WHAT ARE THE COMPLIANCE DEADLINES?

States have until December 16, 2000 to adopt and implement the requirements of this regulation. States may request up to a two year extension to adopt the rule. Simultaneous compliance with the Stage 1 Disinfectants and Disinfection Byproduct Rule, promulgated at the same time as IESWTR, will be achieved as follows:

Public water systems that use surface water or ground water under the direct influence of surface water, either in whole or in part, and serve a population of 10,000 or more generally must comply with requirements of this rule by January 1, 2002. Systems with elevated levels of disinfection by-products were required to develop a disinfection profile beginning no later than March 31, 2000. In cases where capital improvements are needed to comply with the rule, states may grant systems up to an additional two years to comply.

WHAT ARE THE COSTS AND BENEFITS OF THE RULE?

EPA estimates that implementation of the Interim Enhanced Surface Water Treatment Rule will:

- Improvements in filtration at water systems will increase public health protection by reducing the level of exposure to *Cryptosporidium* and other pathogens (i.e., *Giardia*, or other waterborne bacterial or viral pathogens) in drinking water supplies;
- Decrease the likelihood of endemic (constant low-level presence of a disease or infection) illness from
 Cryptosporidium by 110,000 to 463,000 cases annually and related health costs, as well as incidences
 of illness from Giardia and other waterborne pathogens; and,
- Reduce the likelihood of the occurrence of outbreaks of cryptosporidiosis (illness from
 Cryptosporidium) and their associated economic costs by providing a larger margin of safety against
 such outbreaks for some systems.

The total annualized national cost for implementing the Interim Enhanced Surface Water Treatment Rule is \$307 million. EPA believes that the benefits exceed the costs. The rule will result in increased costs to public water systems for improved turbidity treatment, monitoring, disinfection benchmarking and covering new finished water storage facilities, as well as state implementation costs.

EPA estimates that 92 percent of households will incur an increase in their water bill of less than \$1 per month; 7 percent of households will incur an increase in their water bills of between \$1 - \$5 per month; and less than 1 percent will incur an increase of between \$5-8 per month.

WHAT TECHNICAL INFORMATION WILL BE AVAILABLE ON THE RULE?

A series of guidance manuals have been developed to support the Interim Enhanced Surface Water Treatment Rule. The manuals will aid EPA, state agencies and affected public water systems in implementing the IESWTR. The guidance manual are available on EPA's website at www.epa.gov/safewater/mdbp/implement.html.

Disinfection Benchmarking Guidance Manual

Objective: To help determine if a disinfection profile (an evaluation of current disinfection practice) is required and how to do one; when a disinfection benchmark must be determined and how to extract it from the profile; and how a public water system must use the benchmark, in consultation with the state, to assure protection from microbial risk is maintained when the system changes disinfection practice.

Contents: The manual provides detailed information on the following subjects: applicability of the profiling and benchmarking requirements to public water systems; procedures for generating a disinfection profile, including example profiles; methods for calculating the disinfection benchmark, including example calculations; the use of the benchmark in modifying disinfection practices, communicating with the state, and assessing significant changes to disinfection practices; the development of the profiling and benchmarking regulations; the significance of the log inactivation concept and CT values for inactivations achieved by various disinfectants; and the determination of contact time.

Guidance Manual for Compliance with the Interim Enhanced Surface Water Treatment Rule: Turbidity Provisions

Objective: The first section provides technical information regarding specific requirements of the Interim Enhanced Surface Water Treatment Rule relating to turbidity and is intended for experienced operators and others in the regulated community. The second section of the document provides background on concepts surrounding turbidity and serves as a primer for less experienced operators and individuals.

Contents: The first section contains key regulatory requirements including combined filter effluent monitoring and individual filter monitoring; recordkeeping and reporting requirements; additional compliance issues such as compliance schedule, public notification, variances/exemptions, and follow-up action requirements; approved methods and additional measurement and calibration issues; components and description of an filter self-assessment; and components and description of a Comprehensive Performance Evaluation. The second section of the manual includes more basic information on turbidity; description of the particles (both natural and man-made) which typically contribute to turbidity; discussion of typical steps in a treatment process and how turbidity is removed or created in each step; discussion of turbidity in different source waters with an emphasis of how changes in source water effect turbidity; and basic turbidimeter design.

Alternative Disinfectants and Oxidants Guidance Manual

Objective: To provide technical data and engineering information on disinfectants and oxidants that are not as commonly used as chlorine, so that systems can evaluate their options for developing disinfection schemes to control water quality problems such as zebra mussels and Asiatic clams, and oxidation to control water quality problems associated with iron and manganese.

Contents: The manual discusses six disinfectants and oxidants: ozone, chlorine dioxide, potassium permanganate, chloramines, ozone/hydrogen peroxide combinations, and ultraviolet light. A decision tree is provided to assist in evaluating which disinfectant(s) is most appropriate given certain site-specific conditions (e.g., water quality conditions, existing treatment and operator skill). The manual also contains a summary of existing alternative disinfectants use in the United States and cost estimates for the use of alternative disinfectants.

Microbial and Disinfection Byproducts Simultaneous Compliance Manual

Objective: To assist public water systems on complying simultaneously with various drinking water regulations (e.g., Stage 1 Disinfectants and Disinfection Byproducts Rule, Interim Enhanced Surface Water Treatment Rule, Lead and Copper Rule and the Total Coliform Rule). The manual discusses operational problems systems may encounter when implementing these rules.

Contents: The manual provides detailed information on the requirements in the Stage 1 Disinfectants and Disinfection Byproducts Rule and the Interim Enhanced Surface Water Treatment Rule and issues involved with simultaneously complying with other rules.

Guidance Manual for Conducting Sanitary Surveys of Public Water Systems

Objective: The guidance manual provides an overview of how to conduct a sanitary survey of all water systems using surface water and ground water under the direct influence of surface water. It is intended to help state agencies improve their sanitary survey programs where needed.

Contents: The manual provides information about the objective and regulatory context of sanitary surveys. It covers four principal stages of a sanitary survey: planning, including preparatory steps to be taken by inspectors before conducting the onsite portion; conducting the onsite survey; compiling a sanitary survey report; and performing follow-up activities.

Uncovered Finished Water Reservoirs

Contents: The manual provides detailed information on the following subjects: developing and implementing comprehensive open finished water reservoir management plans based on site-specific conditions; identifying potential sources of contamination in open finished water reservoirs and potential mitigation measures; employing different methods to control the degradation of water quality while it resides in the reservoir; monitoring schemes that can be used to characterize water quality and identify water quality degradation before it becomes severe and is difficult to correct.

For more information, contact EPA's Safe Drinking Water Hotline, 1.800.426.4791, or see the Office of Ground Water and Drinking Water web page at http://www.epa.gov/safewater/standards.html.

This page is left intentionally blank.



Fact Sheet: Disinfection Profiling and Benchmarking

The Interim Enhanced Surface Water Treatment Rule (IESWTR) requires certain public water systems (PWSs) to evaluate their disinfection practices and work with the state to assure there are no unintended reductions in microbial protection

Is your PWS affected?

Your PWS is affected if it is a surface water or GWUDI* system that—

- Serves 10,000 or more people; and,
- Has Total Trihalomethanes ≥ 0.064 mg/L or Haloacetic Acids ≥ 0.048 mg/L.

The process consists of the following 3 steps:

- Determining if a PWS must develop a disinfection profile—§141.172 (a)
- Developing the disinfection profile—§141.172 (b)

^{*} Ground water under the direct influence (of surface water)

1 Determining if a PWS Must Develop a Disinfection Profile

How can a PWS determine if it must develop a disinfection profile?

A PWS determines if it must establish a disinfection profile using 4 consecutive quarters of TTHM and HAA5 data. If the PWS has an annual average level of TTHM ≥ 0.064 mg/L or an annual average level of HAA5 ≥ 0.048 mg/L, it must then develop a disinfection profile.

Alternatively, a PWS may choose to develop a disinfection profile and not collect these data.

How should a PWS collect TTHM and HAA5 data?

۵	Most PWSs serving 100,000 or more people have collection Rule (ICR). These systems medetermine if they must profile, unless the state determine use. PWSs must submit these data to the state no later than December 1999 (Timeline Milestone ②).	ust u	se these data (from calendar year 1998) to
		W	nich labs may conduct analyses for HAA5?
۵	A PWS that has not collected data under the ICR but has 4 consecutive quarters of TTHM compliance	٥	Any lab that received approval under the 1996 ICR
	data and HAA5 occurrence data may use these data to determine if it must profile. The PWS must	a	Any lab using ICR-approved methods
	submit these data to the state for approval no later than April 1999 (Timeline Milestone ①).		
a	A PWS that has no data or inadequate data for TTHM data. The PWS should submit these data to the state and profile no later than March 2000 (Timeline Milestone ®	dete	HAA5 should collect 4 consecutive quarters of rmine whether or not to develop a disinfection
13	That are the monitoring requirements for TTHM and HAA	data	?
a	TTHM and HAA5 data must be collected during the same of	luarte	er.

routine monitoring requirements under 40 CFR 141.12 and 141.30.
 At least 25 percent of the samples for TTHM and HAA5 shall be taken at locations within the distribution system reflecting maximum residence time of the water in the system.


40 CFR 141.12 and 141.30. For HAA5, at least 4 samples must be taken per plant per quarter in accordance with

Government For TTHM, samples must be taken in accordance with current TTHM monitoring requirements under

The remaining 75 percent of the samples for TTHM and HAA5 shall be taken at representative locations in the distribution system, taking into account the number of people served, the different sources of water, and the different treatment methods employed.

Analytical Methods and Handling Requirements

TTHM: EPA 502.2 HAA5: EPA 552.1 EPA 524.2 EPA 551 Std. 6251 B

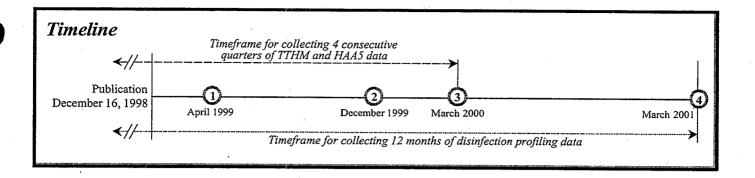

2 Developing the Disinfection Profile

How does a PWS develop a disinfection profile?

- The disinfection profile is developed by compiling daily *Giardia lamblia* log inactivations computed over a period of **12 months**. In addition, a disinfection profile for daily virus log inactivations must be developed for PWSs that use either chloramines or ozone for primary disinfection. The log inactivation values are calculated using daily measurements of operational data collected during peak-hour flows. This disinfection profiling must be completed no later than **March 2001** (Timeline Milestone ③).
- A PWS that has 3 years of existing operational data may use these data to develop a disinfection profile as long as the state has determined that these data are substantially equivalent to data that would be collected under the IESWTR.
- The PWS must keep the disinfection profile on file to be reviewed during its Sanitary Survey.

3 Calculating the Disinfection Benchmark and Consulting with the State

A PWS required to develop a disinfection profile that subsequently decides to make a significant modification to its disinfection practice must calculate a disinfection benchmark and consult with the state prior to implementing such a change. The state consultation process helps assure that the PWS will meet the new disinfection byproduct standards without compromising protection from microbial contaminants.

How does a PWS calculate a disinfection benchmark?

A disinfection benchmark is an indicator of disinfection effectiveness and depends upon the inactivation of *Giardia lamblia* (or viruses). The benchmark is determined by calculating the average daily inactivation value for each of 12 consecutive months. The lowest monthly average becomes the disinfection benchmark. If the system has data from more than 1 year, it repeats this calculation for each year. The benchmark is the average of the lowest month's value for each of the years.

What are significant modifications to a disinfection practice?

Significant modifications	s to	disinfec	tion	practices	inch	ıde
---------------------------	------	----------	------	-----------	------	-----

Changes to the point of disinfection	Changes to the disinfectant(s) used in the treatment plant
Changes to the disinfection process	Any other modification identified by the state

.

PLEASE LOOK INSIDE:

Your water system is expected to be affected by the requirements of the new IESWTR

More information can be obtained from:

- Your state's primacy agency
- The EPA Safe Drinking Water Hotline, Telephone: 1.800.426.4791

\$EPA

United States Environmental Protection Agency (4101) Washington, DC 20460

Official Business Penalty for Private Use \$300 Bulk Rate Postage and Fees Paid EPA





Interim Enhanced Surface Water Treatment Rule: A Quick Reference Guide

Overvie	w of the Rule
Title	Interim Enhanced Surface Water Treatment Rule (IESWTR) 63 FR 69478 - 69521, December 16, 1998, Vol. 63, No. 241 Revisions to the Interim Enhanced Surface Water Treatment Rule (IESWTR), the Stage 1 Disinfectants and Disinfection Byproducts Rule (Stage 1 DBPR), and Revisions to State Primacy Requirements to Implement the Safe Drinking Water Act (SDWA) Amendments 66 FR 3770, January 16, 2001, Vol 66, No. 29
Purpose	Improve public health control of microbial contaminants, particularly <i>Cryptosporidium</i> . Prevent significant increases in microbial risk that might otherwise occur when systems implement the Stage 1 Disinfectants and Disinfection Byproducts Rule.
General Description	Builds upon treatment technique approach and requirements of the 1989 Surface Water Treatment Rule. Relies on existing technologies currently in use at water treatment plants.
Utilities Covered	Sanitary survey requirements apply to all public water systems using surface water or ground water under the direct influence of surface water, regardless of size. All remaining requirements apply to public water systems that use surface water or ground water under the direct influence of surface water and serve 10,000 or more people.

Major Provision	on s
Regulated Conta	minants — — — — — — — — — — — — — — — — — — —
Cryptosporidium	Maximum contaminant level goal (MCLG) of zero. 99 percent (2-log) physical removal for systems that filter. Include in watershed control program for unfiltered systems.
Turbidity Performance Standards	Conventional and direct filtration combined filter effluent: ► ≤ 0.3 nephelometric turbidity units (NTU) in at least 95 percent of measurements taken each month. ► Maximum level of 1 NTU.
Turbidity Monito (Conventional and L	oring Requirements Direct Filtration)
Combined Filter Effluent	Performed every 4 hours to ensure compliance with turbidity performance standards.
Individual Filter Effluent	Performed continuously (every 15 minutes) to assist treatment plant operators in understanding and assessing filter performance.
Additional Requi	rements
Disinfection profiling and	hanchmarking





- Disinfection profiling and benchmarking.
- Construction of new uncovered finished water storage facilities prohibited.
- Sanitary surveys, conducted by the state, for all surface water and ground water under the direct influence of surface water systems regardless of size (every 3 years for community water systems and every 5 years for noncommunity water systems).

For additional information on the IESWTR

Call the Safe Drinking Water Hotline at 1-800-426-4791; visit the EPA web site at www.epa.gov/safewater; or contact your State drinking water representative.

Additional material is available at www.epa.gov/ safewater/mdbp/ implement.html.

Profiling and Benchmarking

Public water systems must evaluate impacts on microbial risk before changing disinfection practices to ensure adequate protection is maintained. The three major steps are:

- Determine if a public water system needs to profile based on TTHM and HAA5 levels (applicability monitoring)
- Develop a disinfection profile that reflects daily *Giardia lamblia* inactivation for at least a year (systems using ozone or chloramines must also calculate inactivation of viruses)
- Calculate a disinfection benchmark (lowest monthly inactivation) based on the profile and consult with the state prior to making a significant change to disinfection practices

Critical Deadlines and Requirements				
For Drinking Wat	For Drinking Water Systems			
February 16, 1999	Construction of uncovered finished water reservoirs is prohibited.			
March 1999	Public water systems lacking ICR or other occurrence data begin 4 quarters of applicability monitoring for TTHM and HAA5 to determine if disinfection profiling is necessary.			
April 16, 1999	Systems that have 4 consecutive quarters of HAA5 occurrence data that meet the TTHM monitoring requirements must submit data to the state to determine if disinfection profiling is necessary.			
December 31, 1999	Public water systems with ICR data must submit it to states to determine if disinfection profiling is necessary.			
April 1, 2000	Public water systems must begin developing a disinfection profile if their annual average (based on 4 quarters of data) for TTHM is greater than or equal to 0.064 mg/L.			
March 31, 2001	Disinfection profile must be complete.			
January 1, 2002	Surface water systems or ground water under the direct influence of surface water systems serving 10,000 or more people must comply with all IESWTR provisions (e.g., turbidity standards, individual filter monitoring).			
For States				
December 16, 2000	States submit IESWTR primacy revision applications to EPA (triggers interim primacy).			
January 2002	States begin first round of sanitary surveys.			
December 16, 2002	Primacy extension deadline - all states with an extension must submit primacy revision applications to EPA.			
December 2004	States must complete first round of sanitary surveys for community water systems.			
December 2006	States must complete first round of sanitary surveys for noncommunity water systems.			

Public Heal	Public Health Benefits		
Implementation of the IESWTR will result in	Increased protection against gastrointestinal illnesses from Cryptosporidium and other pathogens through improvements in filtration.		
	Reduced likelihood of endemic illness from <i>Cryptosporidium</i> by 110,000 to 463,000 cases annually.		
·	Reduced likelihood of outbreaks of cryptosporidiosis.		
Estimated impacts of the IESWTR	National total annualized cost: \$307 million		
include	92 percent of households will incur an increase of less than \$1 per month.		
	Less than 1 percent of households will incur an increase of more than \$5 per month (about \$8 per month).		

IV-F. Frequently Asked Questions

TABLE OF CONTENTS

1.0	Interim Enh	anced Surface Water Treatment Rule	. 27
	1.1	Cryptosporidium	. 27
	1.2	Disinfection Profiling And Benchmarking	. 28
	1.3	Turbidity Standards (Combined Filter Effluent)	. 32
	1.4	Individual Filter Provisions	. 32
	1.5	Alternative Filtration Technologies	. 34
2.0	General Pro	ogram Requirements	35
	2.1	Primacy	35
	2.2	Violations, SDWIS Reporting and SNC Definitions	36
	2.3	Qualified Operators	37

This page is left intentionally blank.

1.1 Cryptosporidium

Citation	Part Title
§141.32(e)(10)	Public Notification
§141.201	Public Notification of Drinking Water Violations
§141.52	Maximum Contaminant Level Goals for Microbiological Contaminants

- **Q:** Why do filtered systems have a Cryptosporidium removal requirement and unfiltered systems do not?
- A: Systems that have met the SWTR filtration avoidance criteria must now incorporate Cryptosporidium into their watershed protection programs. If a system meeting the SWTR avoidance criteria fails to address Cryptosporidium under the IESWTR, they will be required to filter within 18 months to meet the removal requirements. As before, any failure to meet the SWTR avoidance criteria requires filtration within 18 months. More stringent requirements may be placed on systems avoiding filtration in future regulations.
- Q: Can a system use UV for Cryptosporidium inactivation and receive credit for it under the IESWTR?
- A: A system may use UV; however, it cannot use UV to meet the requirements of the IESWTR. A system must physically remove 99 percent of oocysts using filtration *alone*.
- Q: Is an oocyst that is not viable considered to be Cryptosporidium or not?
- A: Since the rule requires systems to measure turbidity, not the viability of oocysts, it is not relevant to the enforceable requirements of the rule. Present analytical methods cannot reliably distinguish between oocysts that are infective or viable and those that are not.
- Q: What does EPA have in mind in terms of Cryptosporidium controls on the watershed?
- A: The same types of prevention measures that have been taken to address *Giardia* may be used to address *Cryptosporidium*. Whether or not additional steps are needed will be determined by an onsite assessment of each watershed, currently conducted by the states on an annual basis. Each water system should assess potential sources of *Cryptosporidium* in its watershed and identify and carry out measures to control the potential adverse impacts on water quality from these sources. Ultimately monitoring should help to determine if these measures have been successful in controlling the sources, but monitoring is not currently required by the regulations due to limitations of the analytical methods.
- Q: Does the Cryptosporidium MCLG of zero apply to all species or just Cryptosporidium parvum?
- A: The MCLG was set at the genus level because EPA believes that adequate data are not available to determine that only *Cryptosporidium parvum* infects humans.

1.2 Disinfection Profiling And Benchmarking

Citation	Part Title	
§141.172(a)	Disinfection Profiling and Benchmarking (Determination of systems required to profile)	
§141.172(b)	Disinfection Profiling and Benchmarking (Disinfection profiling)	
§141.172(c)	Disinfection Profiling and Benchmarking (Disinfection benchmarking)	

- **Q:** Why are systems required to collect TTHM and HAA5 data to determine applicability for disinfection profiling under the IESWTR?
- A: For surface water systems that chlorinate, and most do, some of the conditions (e.g. increased disinfectant dose and increased contact time) that accelerate creation of TTHMs and HAA5 are identical to those that increase inactivation ratios for viruses and *Giardia lamblia* cysts. Therefore, it is logical that surface water systems that have elevated TTHMs and/or HAA5 will consider adjusting these variables to reduce the level of disinfection byproducts. Disinfection profiling and benchmarking is designed to ensure such adjustments are not made without giving full consideration of the positive and negative impacts.
- Q: Can the TTHM and HAA5 data collected for applicability monitoring be used to qualify for reduced monitoring for the Stage 1 DBPR?
- A: The data can be used if the samples were collected at the appropriate location and frequency as required by §141.132(b)(1)(i) (i.e. routine monitoring) and were analyzed by a certified laboratory using approved methods under §141.132 or approved ICR methods. Samples collected for applicability monitoring only do not have to be analyzed by a certified lab, but the lab must use approved ICR analytical methods.
- Q: What exactly is meant by consultation with the state for systems making changes to their disinfection process?
- A: EPA believes that states will consult relatively extensively with systems making significant changes to disinfection. Most states have extensive procedures in place for approval of water system modifications. The rule does not require the consultation to be a specific process or require specific types of documentation, however, states must describe "how they will consult" in their primacy revision application (§ 142.16(h)).
- **Q:** Will systems be required to calculate another disinfection benchmark after implementation of enhanced coagulation under the Stage 1 DBPR begins?
- A: Benchmarking is a one-time provision under the IESWTR. It does not have to be repeated when processes are changed a second time. EPA believes a similar process will be carried out in most states for every change in disinfection.
- **Q:** What if you use one watershed with low levels of DBPPs for \underline{x} months and then switch to another watershed with higher levels of DBPPs?
- A: The system should discuss the change in source with the state and the state should determine if the disinfection profile is representative of normal operating conditions. Although not required by the regulation, the state may choose to have the system perform an additional profile before allowing modifications. Also, the state and system should review the data together to determine its value for decision making and use it accordingly.

- Q: May a system use data from many years ago (e.g., 7 or 8 years ago) to develop a disinfection profile under the IESWTR?
- A: The rule does not specify which years of data can be grandfathered for profiling, however, a state should carefully review older data to determine if it is still representative of normal operating conditions. The profile must reflect inactivation through the entire treatment plant.
- **Q:** If a system does not have to submit its profile to the state upon completion, how can the state determine if the system is in compliance with this provision?
- A: A state will determine system compliance with this provision during the system's sanitary survey.
- Q: Does a water system serving 10,000 or more people, which purchases water from a Subpart H system that has decided to go directly to profiling, need to perform applicability monitoring?
- A: No, as long as the purchased water is the only Subpart H source serving the system. Both the seller and the purchaser need to inform the state of this decision by December 31, 1999, and should clearly indicate that the purchaser is not performing the applicability monitoring because the seller has decided to go directly to profiling. The state should have documentation that there is an agreement between the seller and purchaser.
- Q: How should a system develop a disinfection profile under the IESWTR if it experiences emergency conditions requiring addition of high levels of disinfectants while gathering data?
- A: As part of the consultation with the state, the system should note any effect on the benchmark caused by the emergency. An emergency that is only a few hours or days in duration will likely be averaged out, since daily results are part of an average. The system and state should put any unusual situation in proper prospective when consulting over the benchmark and make decisions accordingly.
- Q: If a system does not normally operate for 12 consecutive months, how will it collect 4 quarters of applicability monitoring data necessary to determine whether the system is required to profile?
- A: Seasonal systems should collect samples for the quarters they operate and base the applicability determination on all available sample data. The system has the option to forego TTHM/HAA5 applicability monitoring and conduct profiling. The disinfection profile would be developed for the months the system is operational.
- Q: Is there an advantage for systems to begin monitoring early for TTHM and HAA5?
- A: Yes. In addition to addressing the early requirements of the IESWTR for Subpart H systems serving ≥10,000, systems will know more about their treatment process, and seasonal variations. EPA would also encourage systems with conventional treatment to initiate TOC monitoring to assess the need to meet treatment technique requirements of the Stage 1 DBPR.
- Q: Is switching from gas to liquid (or vice versa) chlorine considered a "significant change" for the purposes of setting a benchmark and consulting with the state?
- A: No, switching from gas to liquid, or liquid to gas, chlorine would not be considered a significant change, but states may require notification of such change.
- Q: What happens when ICR data has missing values or the state believes the data is not representative? Must this "bad data" still be used to determine if a disinfection profile must be developed?
- A: The state may determine whether or not to consider the ICR data "bad." If the state determines that TTHM and HAA5 data are not representative, the state should inform the system and ask the system to collect TTHM and HAA5 data to determine if profiling is necessary.

- Q: If a system is planning to switch to ozone for protozoan control and will, as a result, decrease virus inactivation, should the state discourage the system from making this switch?
- A: Not necessarily. The state should carefully examine the treatment operations in the system and the source water. The ultimate determination should be made on a case-by-case basis. The Disinfection Profiling and Benchmarking Guidance Manual contains more detailed information.
- **Q:** Will there be an electronic template for calculating CT values?
- A: An electronic template has been developed and is available with other technical assistance materials related to these rules on EPA's Website (www.epa.gov/safewater/mdbp/implement.html).
- Q: Since we are putting a burden on the system to develop a disinfection profile can we limit the time of year that monitoring is required to focus on the worst case?
- A: No. Affected systems serve 10,000 or more people and generally already collect all or most of the information necessary for developing a profile. Regardless of whether or not they already have the data, the rule requires systems to develop a 1-year disinfection profile (unless the system does not operate year-round; then the profile is developed for the months the seasonal system is operational). The full year is necessary to examine the maximum possible disinfection, water use, and water quality scenarios. In addition, the full year of data will provide information to the systems on seasonal strategies to achieve compliance.
- Q: If a system is on reduced monitoring for TTHM, does it have to return to routine monitoring for the applicability monitoring under the IESWTR?
- A: No, for the purpose of applicability monitoring, the system may remain on reduced monitoring for TTHM samples. EPA believes that the samples, because they are taken at a point in the distribution system that represents the maximum residence time, are a worst case sample. Systems are however, required to take 4 quarters of routine samples for HAA5 for the profiling applicability monitoring, as most non-ICR systems have not monitored for HAA5.
- **Q:** What if a system has some HAA5 data but not four samples per plant (incomplete data)? Do they have to collect more samples to see if disinfection profiling is necessary?
- A: The system would have to collect a full data set meeting the requirements of the rule or notify the state by December 31, 1999 that they will go directly to profiling.
- Q: If initial TTHM and HAA5 levels suggest that the final annual average will exceed the levels that trigger disinfection profiling, can a system go directly to profiling, or must they complete the monitoring?
- A: The system can go directly to profiling. It must, however, notify the state in writing of its intent to do so by December 31, 1999.
- Q: Is there any difference in the requirements for calculation of Giardia lamblia and virus inactivation between the IESWTR's disinfection profiling requirements and the SWTR's requirements?
- A: The Surface Water Treatment Rule requires Subpart H systems to show they meet a minimum level of inactivation for *Giardia lamblia* and viruses, but only unfiltered systems are required to use the CT procedure. However, many systems exceed the minimum requirements by a large margin.
 - The IESWTR, on the other hand, requires systems to show the inactivation achievable through the entire treatment plant (from point(s) of disinfectant application to the first user). When systems are considering changes to disinfection practices, this showing of full inactivation potential is important for ascertaining the full impact of those changes on microbial protection.

- Q: If a system needs to temporarily increase its chlorine levels in response to an emergency during the year of the disinfection profile—is the profile still valid?
- A: Yes, the profile would still be valid. The profile should cover each day the system is operating and short-term increases in disinfectant levels should have little effect on the final benchmark. Systems and states can put unusual circumstances in perspective when they consult over a disinfection benchmark.
- Q: Under the disinfection profiling and benchmarking provisions of the IESWTR, must a system take TTHM and HAA5 samples at the same time? If the system wishes to use grandfathered data, do the data have to have been collected at the same time?
- A: EPA intends to liberally interpret the "at the same time" provisions of §141.172 such that TTHM and HAA5 samples would be deemed acceptable for applicability determinations if they are collected during the same four quarters.
- **Q:** What is the consequence of "failure to develop a profile"?
- A: If a system is required to develop a disinfection profile under the provisions of §141.172 and fails to do so, this failure would constitute a treatment technique violation.
- Q: Can a state approve a treatment change while the profiling requirement is in place but before profiling is complete? What about treatment changes already approved?
- A: The requirement to prepare a disinfection profile is triggered by elevated levels of TTHMs or HAA5 pursuant to §141.172(a)(6), or by notification of the state of its intent to comply with the disinfection profiling requirement as if the applicability monitoring had been conducted and the results required the preparation of the disinfection profile. Once the profiling requirement has been triggered, no significant changes can be made to the system's disinfection practices without consultation with the state. However, the state can consult with the system and allow changes they determine to be appropriate prior to beginning or completing the disinfection profile. The EPA recognizes that it may not always be practical to postpone necessary changes in disinfection practices until completion of the profile.
- Q: Can a system use 6 months of ICR data and 6 months of monitoring data if the state approves it as better than the final 12 months of ICR data?
- A: Yes, a system would be able to use this data if approved by the state as a more representative data set under the provisions of §141.172 (a)(4) or (5)(v).
- Q: Under §141.172(b)(2), a system with more than one point of disinfection must conduct monitoring at each disinfection segment to measure pH, temperature, and CT values. Can a system use data from a worst case scenario (maximum flow) to satisfy this requirement?
- A: The rule requires that monitoring be performed at each disinfection segment. The Disinfection Profiling and Benchmarking Guidance Manual contains more detailed information.
- Q: Can states use a different method to calculate a disinfection profile?
- A: States must require systems to develop disinfection profiles as provided in §141.172(b)(4) and (5). States always have the option to adopt rules that are equally or more stringent to those of EPA. This option offers the possibility that state's might develop alternative procedures that EPA could find to be equally stringent and protective of public health.
- Q: There is a note in the Guidance Manual for Compliance With the Filtration and Disinfection Requirements for PWSs Using Surface Water Sources that the CT values for inactivation of viruses by chloramines expressed in Table E-13 are suitable for use only with systems that add chlorine prior to ammonia. Is this true and, if so, why?
- A: The above referenced guidance manual was specifically designed to aid systems in complying with the SWTR, not the IESWTR. As explained in the guidance, the CT values in Table E-13

were based directly on experimental data developed using preformed chloramines to determine inactivation of Hepatitis A Virus (HAV). HAV is less resistant to preformed chloramines than are some other viruses including rotavirus. Rotavirus is, on the other hand, very sensitive to free chlorine and, in field practices where chlorine is added prior to ammonia, it was assumed there would be sufficient contact time with free chlorine to inactivate the rotavirus. When preformed chloramines are used or when ammonia is added prior to chlorine, the free chlorine will not be available for inactivation of rotavirus. For these reasons, Table E-13 should not be used to determine compliance with the inactivation requirements of the SWTR when ammonia is added prior to chlorine or when preformed chloramines are used. The guidance manual suggests that inactivation studies be performed in these cases to ensure adequate inactivation of viruses. The IESWTR, however, requires development of a disinfection profile so a disinfection benchmark can be calculated. Changes in disinfection practices are then to be measured against the benchmark to ensure that there is no unintended reduction in microbial protection when systems change disinfection practices to comply with the Stage 1 DBPR. For the purpose of developing a disinfection profile, the data in Table E-13 is acceptable as long as all profiles and subsequent benchmarks are developed in a similar manner so that comparisons of benchmarks are consistent.

1.3 Turbidity Standards (Combined Filter Effluent)

For further information, see the following rule sections:

Citation	Part Title
§141.73(a)(3)	Filtration
§141.173(a), (b)	Filtration

- **Q:** In terms of compliance with the combined filter effluent turbidity levels, does 0.3 NTU really mean 0.349 NTU and does 1 NTU really mean 1.49 NTU?
- A: Yes, due to rounding of significant figures.
- Q: A system may substitute continuous turbidity monitoring for grab sample monitoring every four hours. Which results of the continuous monitoring would the system report?
- A: The system is required to record results every four hours. Each month, the system must report the total number of filtered water turbidity measurements recorded, the number and percentage of the recorded measurements taken which are less than or equal to 0.3 NTU, and the date and value of recorded measurements greater than 1 NTU.

1.4 Individual Filter Provisions

Citation	Part Title
§141.174(a), (b)	Filtration Sampling Requirements
§141.175(a), (b)	Reporting and Recordkeeping Requirements
§142.16(g)(1)	Special Primacy Requirements

- Q: As a system brings filters on line, at different times, do they need separate timers on each filter or can they take all readings on the quarter hour (i.e. 3:00, 3:15, 3:30, etc.)?
- A: Taking all readings on the quarter hour would meet the intent of the rule.

- Q: Is particle counting an adequate substitute for continuous turbidity monitoring?
- A: No, particle counting may not be used as a substitute for continuous turbidity monitoring. However, EPA encourages the use of particle counters for optimization of process control.
- Q: Some package plants and/or filters are constructed so that it is not possible to install the continuous turbidimeters on each filter bed and perform this monitoring. How do you resolve this issue?
- A: Individual filter monitoring is a requirement of the rule for all Subpart H systems serving 10,000 or more persons that use conventional or direct filtration. This is to ensure public health protection for the maximum number of people. Configurations which do not allow for such plumbing, such as a Greenleaf Filter Plant or certain automatic backwash filters, can be considered one filter and can monitor the combined effluent from the unit every 15 minutes to determine compliance with the individual filter requirements. Systems which believe that they fall under this category should consult with the state. However, it is likely that some of these plants/filters are plumbed such that they can install turbidimeters on individual filters, and therefore should.
- **Q:** What if a plant exceeds a turbidity trigger for an individual filter while performing filter to waste? Does this need to be reported? Is it a violation?
- A: The turbidity requirements apply only to water that will become part of the combined filter effluent of the plant. Filtered wastewater turbidity does not need to be measured or reported and should not have violations associated with it.
- **Q:** Does each filter need its own turbidimeter or can several filters be connected to one turbidimeter?
- A: The rule doesn't preclude the use of a single turbidimeter to measure and record the turbidity of multiple filters. A state would have to find that this would be an appropriate methodology for measuring and recording compliance with the individual filter reporting and recordkeeping requirements.
- Q: When a system exceeds the rule-established individual filter turbidity trigger levels in two consecutive measurements taken 15 minutes apart, certain corrective actions are required to be completed within designated time frames. When does the clock start running on those time limits?
- A: The time for completing the necessary corrective actions begins immediately after the second of the two measurements that exceed the "trigger" level.
- Q: How should a system deal with spiked turbidimeter readings for hours (sometimes as many as 12 hours) after the turbidimeter (not the filter it is monitoring) has been cleaned?
- A: EPA believes that the duration of these kinds of spiked readings should normally be a matter of minutes, not hours. A turbidimeter returning inaccurate readings for more than a few minutes should be overhauled or replaced. In the event that inaccurate spikes lasted for a longer period of time, the system would have the option of measuring and recording turbidity at 15 minute intervals using a bench top turbidimeter until the on-line unit returned to normal.
- Q: If a system is required to have a Comprehensive Performance Evaluation (CPE) conducted by the state or a third party, is the system liable if the state or third party does not conduct the CPE within 90 days (and the delay is clearly the fault of the state or third party, not the system)?
- A: If the Comprehensive Performance Evaluation is not completed and the report submitted to the state within 90 days, a violation is triggered and must be reported. However, the state can exercise its discretion on what enforcement action is taken.

When the state chooses to perform the CPE and is unable to do so within the time frame established by the rule, it has the authority to issue an administrative order that includes the establishment of a more appropriate compliance schedule.

Q: Is there a limit to the number of CPEs that can be triggered by ongoing compliance problems?
A: The rule does not specify the number of CPEs that are required in response to turbidity limits that trigger Section 141.175(b)(4) multiple times for problems with individual filters (turbidity levels of > 2.0 NTU in two consecutive measurements in each of two consecutive months.) One CPE is adequate until that CPE has been completed and the appropriate corrective actions taken. The CPE must be completed within the time limits established by the rule for the initial exceedence.

In cases where the causes of individual filter turbidity problems are not easily and quickly correctable, the system should consider negotiating with the state to enter into an enforcement action such as an administrative order with a mutually agreeable set of actions leading to compliance within an established compliance schedule. Compliance with the administrative order would limit the system's liability for having additional CPEs conducted after one had been done to identify performance limiting factors.

- **Q:** If a turbidity exceedence is caused by a failure of the turbidimeter, does it still have to be reported?
- A: High turbidity readings that are caused by cleaning and purging a turbidimeter, etc. and that are not indicative of finished water quality do not have to be reported as treatment technique violations and do not trigger the corrective actions of §141.175(b)(1) (4). However, the system must keep a written record of the readings, the cause of the turbidimeter failure, and why the readings have been deemed inaccurate. When possible, bench top measurements should be made to provide confirmation of the system's reasons for deleting and/or replacing measurements.

1.5 Alternative Filtration Technologies

Citation	Part Title
§141.73(d)	Filtration
§141.173(b)	Filtration

- Q: Why are diatomaceous earth and slow sand filters not required to meet the more stringent turbidity requirements of the IESWTR?
- A: Slow sand and DE systems, because of their filtration effectiveness, are assumed to already meet the 2-log removal for *Cryptosporidium* under the existing requirements of the SWTR. Therefore, they are not required to meet more stringent requirements under the IESWTR.
- **Q:** Will a state have to re-evaluate alternative filtration technologies previously approved under the 1989 SWTR for the purposes of the Cryptosporidium removal requirements of the IESWTR?
- A: Yes, states will have to re-evaluate alternative filtration technologies previously approved under the SWTR in order to determine whether they are capable of 2 log removal of *Cryptosporidium* cysts. The rule only requires this re-evaluation for alternative technologies that have been approved at Subpart H systems serving 10,000 or more people.

- **Q:** How will a state approve an alternative filtration technology that reduces the turbidity to levels that cannot be reliably measured using turbidimeters? How will the PWS determine compliance with the IESWTR turbidity requirements?
- A: States are required by §142.16(g)(iv) to explain how they plan to approve alternative technologies and establish turbidity performance requirements for such technologies. The state would approve the above-referenced alternative filtration technology in the same manner it would use for other technologies that might be less effective in terms of turbidity removal and would then establish performance standards that would ensure appropriate inactivation/removal of *Giardia lamblia* and viruses and removal of *Cryptosporidium*. For purposes of compliance it would not be necessary to measure down to the level of actual turbidity removal. It is only necessary to accurately measure turbidity at the levels established by the state as performance standards for the technology. The state may require an equally stringent performance requirement such as frequent integrity testing for membrane systems.
- Q: Can states allow log removal credit for GWUDI systems for natural filtration? Can EPA develop a criteria for providing credit for natural filtration?
- A: States have the discretion to consider "natural filtration" an alternative technology. Examples where this might be appropriate are well designed off-stream infiltration galleries and Ranney collectors. Pursuant to §141.173(b) the system would have to demonstrate to the state that it consistently achieves 99.9 percent removal and/or inactivation of Giardia lamblia cysts, 99.99 percent removal and/or inactivation of viruses, and 99 percent removal of Cryptosporidium oocysts. The state would then have to establish performance standards that ensure the removal and inactivation requirements are achieved.

 EPA has not developed guidance for establishing criteria for providing credit for natural filtration.
- **Q:** Are contact absorption clarifiers and dissolved air floatation considered sedimentation in the conventional filtration process as defined in 141.2?
- A: The state has the flexibility to consider these processes as part of the conventional filtration process. However, once the process has been categorized, the state should be consistent in implementation for all their systems. If these processes are not classified as part of conventional filtration, they are considered alternative filtration technologies and must meet the regulatory provisions that address those technologies.

2.0 General Program Requirements

2.1 Primacy

- Q: If the state has a blanket letter from the Attorney General that covers all regulations, does it have to get a new letter specifically for the IESWTR?
- A: Yes. States would not be able to use a letter from the Attorney General that provided certification of rules not in existence at the time the certification letter was written. The certification would also have to confirm that there are no state audit laws preventing enforcement of the rules.
- **Q:** Do you need to adopt the PWS definition (if applicable) and obtain administrative penalty authority in order to receive interim primacy for the IESWTR?
- A: A state is eligible for interim primacy for new regulations provided they have primacy or interim primacy for all existing regulations. At a time when multiple regulations are being promulgated, a state qualifies for interim primacy for each rule as the rules are adopted by the state as long as the time period allowed for adoption (two years plus up to a two year extension, if applicable) has not expired. For example, even though the CCR was promulgated before the IESWTR, a state can obtain interim primacy for the IESWTR before the CCR, as long as the deadline to adopt the

- CCR has not passed. However, if time period allow for adoption of the CCR has passed and the state has not adopted the CCR, then the state would not be eligible for interim primacy for the IESWTR.
- Q: Are states going to have to revisit their GWUDI determinations due to the addition of Cryptosporidium to the definition of GWUDI and the Cryptosporidium removal requirements of the IESWTR?
- A: No, the processes used by states to identify GWUDI under the existing SWTR would still apply. When identifying GWUDI, states use a process that considers indicators that cysts might be present and does not look specifically for cysts. Even though *Cryptosporidium* oocysts are different from *Giardia* cysts, the process is not required to be updated.
- Q: Can states "bundle" regulations in their primacy revision package?
- A: Yes, states may combine two or more rules in one primacy revision package provided that the states' adoption of the rules falls within the statutory two year period and two year extension period, if applicable.
- **Q:** May a state adopt the IESWTR by reference?
- A: Yes, if the state law allows this. However, the state will still need to address the special primacy requirements which give the state flexibility and discretion in meeting certain requirements.
- Q: Our State's Attorney General does not have the authority to approve regulations. Will this be a problem for us in terms of obtaining primacy for new rules?
- A: EPA does not require the state's Attorney General to provide approval of regulations adopted for purposes of the state achieving primacy under these rules. The requirement is for a statement by the Attorney General, or the primacy agency's attorney if it has independent legal council, that the laws and regulations adopted by the state were duly adopted and are enforceable.

2.2 Violations, SDWIS Reporting and SNC Definitions

- Q: If a system receives 2 treatment technique violations in 1 month, is that counted as two TT violations toward SNC?
- A: Yes.
- **Q:** How frequently are SNC determinations made? Can a system potentially receive a SNC designation every month? every quarter? every year?
- A: Significant Non-Compliance (SNC) determinations for all rules, including the Interim Enhanced Surface Water Treatment Rule (IESWTR) and the Stage 1 Disinfectants/Disinfection Byproducts Rule (DBPR), are made once per quarter, compounding over a rolling four quarter period. SDWIS guidance states that these determinations are made on the first day of the month following the end of the quarter which covers the 12 month compliance period which ended the previous quarter.
- Q: The IESWTR does not require systems to gather applicability data. How can you give a system a M/R violation for not doing so?
- A: Failure to gather applicability data is not a federally reportable monitoring and reporting violation. However, if a system does not conduct applicability monitoring, it must notify the state of this election, in writing, not later than December 31, 1999 and must (1) begin developing a disinfection profile not later than March 31, 2000, or (2) obtain state approval to use three years of existing operational data to create a profile. Failure to profile is a treatment technique violation.
- **Q:** If a system does not profile and is required to, what kind of violation is it?
- A: Failure to profile is a treatment technique violation.

- Q: If a system can receive an SNC designation for failure to conduct disinfection profiling under the IESWTR, how can the system return to compliance if profiling is a one-time provision?
- A: Failure to develop a disinfection profile during the required timeframe is a treatment technique violation. A system can return to compliance by developing a disinfection profile. Once completed, the system must retain the disinfection profile data in an acceptable format for review as part of the sanitary surveys and consult with the state before making a significant change to its disinfection practice.

2.3 Qualified Operators

- Q: There is a requirement of the SWTR that the systems be operated by qualified personnel. What if the system has a membrane plant that is not operated on a full time basis? EPA has not mandated the number of hours in a operating cycle and systems have been installing membrane plants to prevent being required to have a full-time operator.
- A: Both the Surface Water Treatment Rule and the Stage 1 Disinfectants/Disinfection Byproducts Rule require regulated systems to be operated by qualified personnel who meet the requirements specified by the state and are included in a state register of qualified operators. The rules do not, however, address the amount of time qualified operators are required to spend on site at the plant. EPA believes that this type of determinations should be left to the states' discretion.
- Q: Who in the state must maintain the list of qualified operators? Is it acceptable if the Public Water Supply Supervision Program (PWSS) does not maintain the list, but another agency in the state does?
- A: Yes, it is acceptable for a state agency other than the primacy agency to maintain the state's register of qualified operators. It is essential, however, for the PWSS Program to have access to that register.

This page is left intentionally blank.

Appendix A

Primacy Revision Crosswalks

The Primacy revision crosswalk for the Interim Enhanced Surface Water Treatment Rule (IESWTR) is presented on the following pages and includes the amendments published on January 16, 2001. Regulatory language which was amended on January 16, 2001 appears underlined in the following table.

Under 40 CFR 142.12, states must adopt the requirements of the IESWTR within 2 years of the final rule's publication, or by December 16, 2000. While states may find it easier to combine the amendments to the IESWTR with the original IESWTR, the amendments must be adopted within 2 years their publication or by January 16, 2003.

Please note there have been many changes to the Public Notice (PN) and Consumer Confidence Report (CCR) rules since the publication of IESWTR. Additional information on these changes is available at www.epa.gov/safewater/pn.html and www.epa.gov/safewater/ccr1.html.

PRIMACY REVISION CROSSWALK FOR THE IESWTR

Federal Requirement	Federal Citation	State Citation (document title, requirement? Explain page number, section/paragraph) on separate sheet	om Fed. ? Explain
SUBPART A—GENERAL			
§ 141.2 DEFINITIONS			
Comprehensive performance evaluation (CPE)	§ 141.2		
Disinfection profile	\$ 141.2		
Filter profile	§ 141.2		
Ground water under the direct influence of surface water	\$ 141.2		
Uncovered finished water storage facility	\$ 141.2		
SUBPART D & SUBPART Q—REPORTING, PUBLIC NOTIFICATION AND RECORDKEEPING INCOME. If the revised PN rule, published on May 4, 2000 (65 FR 25981), has already been adopted, the state is not required to adopt §141.32(e)(10). The revised PN rule has not been adopted, the state must satisfy, §141.32(e)(10).	SLIC NOTIFICATIC	REPORTING, PUBLIC:NOTIFICATION AND RECORDKEEPING 00 (65 FR 25981), has already been adopted, the state is not required to adopt §141.32(e)(10). The revised PN rule supercedes §141.32. If it satisfy, §141.32(e)(10).	
§ 141.32 Public Notification	:		
Microbiological contaminants	§ 141.32(e)(10)		
SUBPART F—MAXIMUM CONTAMINANT LEVEL GOALS	EL GOALS ¹		
§ 141.52 MAXIMUM CONTAMINANT LEVEL GOALS I	INANT LEVEL GOALS FOR MICROBIOLOGICAL CONTAMINANTS	AL CONTAMINANTS	
MCLG of zero for Cryptosporidium	§ 141.52(5)		
SUBPART H—FILTRATION AND DISINFECTION			
§ 141.70 GENERAL REQUIREMENTS			
PWSs serving at least 10,000 people must comply with additional requirements in Subpart P	§ 141.70(d)		

'States do not need to have a corresponding MCLG.

Federal Requirement	Federal Citation	State Citation (document title, page number, section/paragraph)	Different from Fed. requirement? Explain on separate sheet
§ 141.71 Criteria for Avoiding Filtration			
PWS must comply with requirements for TTHMs in §141.12 and §141.30 until December 31, 2001; after December 31, 2001 PWSs must comply with the Subpart L requirements for TTHMs, HAA5, bromate, chlorite, chlorine, chloramines, chlorine dioxide	§ 141.71(b)(6)		
§ 141.73 FILTRATION			,
PWSs serving at least 10,000 people must meet turbidity requirements in §141.173(a) beginning January 1, 2002	§ 141.73(a)(3)		
PWS may use alternative filtration technology if it demonstrates that it removes 99.9% of <i>Giardia lamblia</i> and 99.99% of viruses; for a system that makes this demonstration the requirements of §141.172(b) apply; beginning January 1. 2002 systems serving at least 10,000 people must meet the requirements for other filtration technologies in §141.173(b)	§ 141.73(d)		
SUBPART O—CONSUMER CONFIDENCE REPORTS NOTE: If the CCR rule has not been adopted, is it not expected that the Subpart O provision will be adopted with the IESWTR	IRTS Subpart O provision will be	idopted with the IESWTR;	
§ 141.153 CONTENT OF THE REPORTS			
When it is reported pursuant to §141.73 or §141.173: highest single measurement and lowest monthly percentage of samples meeting the turbidity limits specified in §141.73 or §141.173 for the filtration technology being used	§ 141.153(d)(4)(v)(C)		
SUBPART P—ENHANCED FILTRATION AND DISINFECTION	SINFECTION		
§ 141.170 GENERAL REQUIREMENTS			
Requirements are NPDWR	§ 141.170(a)	٠	
Subpart P regulations establish requirements for filtration and . disinfection that are in addition to criteria in Subpart H	§ 141.170(a)		
Applicable to Subpart H systems serving at least 10,000 people beginning January 1, 2002	§ 141.170(a)		

Federal Requirement	Federal Citation	State Citation (document title, page number, section/paragraph)	Different from Fed. requirement? Explain on separate sheet
Treatment techniques employed must reliably achieve 99% removal of Cryptosporidium for filtered systems; or Cryptosporidium control must be included in the watershed control plan for unfiltered systems	§ 141.170(a)(1)		
Compliance with the profiling and benchmark requirements under the provisions of §141.172	§ 141.170(a)(2)		
PWS is considered in compliance if it meets the requirements for avoiding filtration in §141.71 and §141.171 and the disinfection requirements in §141.72 and §141.172	§ 141.170(b)(1)		
PWS is in compliance if it meets the applicable filtration requirements in §141.173 or §141.73 and the disinfection requirements in §141.72 and §141.172	§ 141.170(b)(2)		
PWSs are not permitted to begin construction of an uncovered finished water storage facility beginning February 16, 1999	§ 141.170(c)		-
§ 141.171 CRITERIA FOR AVOIDING FILTRATION			
System that does not filter must maintain watershed control program under § 141.71(b)(2) to minimize potential contamination by <i>Cryptosporidium</i>	§ 141.171(a)		
System that does not filter must identify watershed characteristics and activities for <i>Cryptosporidium</i> that may have an adverse effect on source water quality	§ 141.171(a)(1)		
System that does not filter must monitor the occurrence of activities that may have an adverse effect on source water quality with respect to Cryptosporidium	§ 141.171(a)(2) ⁻		
State determines during onsite inspection whether watershed control program is adequate to limit potential contamination by Cryptosporidium	§ 141.171(b)	,	

Federal Requirement	Federal Citation	State Citation (document title, page number, section/paragraph)	Different from Fed. requirement? Explain on separate sheet
§ 141.172 DISINFECTION PROFILING AND BENCHMARKING	RKING	•	
Subpart H systems serving at least 10,000 people must determine its TTHM and HAA5 annual averages using procedures in (a)(1) and (a)(2)	§ 141.172(a)		
TTHM annual average must be the annual average during the same period as is used for the HAAS annual average	§ 141.172(a)(1)		
Systems that collected ICR data must use the results of samples collected during the last 4 quarters of monitoring under §141.142	§ 141.172(a)(1)(i)		
Systems that use "grandfathered" HAA5 occurrence data that meet the provisions of (a)(2)(ii) must use TTHM data collected at the same time under the provisions of §141.12 and §141.30	§ 141.172(a)(1)(ii)		
Systems that use HAA5 occurrence data that meet the provisions of (a)(2)(iii)(A) must use TTHM data collected at the same time under the provisions of §141.12 and §141.30	§ 141.172(a)(1)(iii)		
HAAS annual average must be the annual average during the same period as is used for the TTHM annual average	§ 141.172(a)(2)		
Systems that collected ICR data must use the results of samples collected during the last 4 quarters of monitoring under §141.142	§ 141.172(a)(2)(i)		
Four quarters of HAA5 occurrence data that meet routine monitoring sample number and location requirements in §141.12 and §141.130 and the analytical methods requirements in §141.142 (b)(1) may be used to determine if this section applies	§ 141.172(a)(2)(ii)		
Systems that have not collected 4 quarters of HAA5 occurrence data that meet either (a)(2)(i) or (a)(2)(ii) must begin to conduct monitoring for HAA5 to determine if the requirements of (b) apply by March 16, 1999; applicability must be determined no later than March 31, 2000 after publication	§ 141.172(a)(2)(iii)(A)		

² For requirements that will be completed prior to state rule adoption, a state regulation does not need to include these requirements to still be considered as stringent as the Federal requirements.



June 2001

Federal Requirement	Federal Citation	State Citation (document title, page number, section/paragraph)	Different from Fed. requirement? Explain on separate sheet
Systems that do not conduct monitoring in (A) must comply with all other provisions of this section as if HAA5 monitoring had been conducted and the results required compliance with (b) of this section	§ 141.172(a)(2)(iii)(B)		
System may request that state approve a more representative annual data set than the data set determined under (a)(1) or (a)(2) for the purposes of determining applicability of the requirements of this section	§ 141.172(a)(3)		
State may require that the system use a more representative annual data set than the data set determined under (a)(1) or (a)(2) for the purposes of determining applicability with this section	§ 141.172(a)(4)		
System must submit applicability data to the state on the schedule in (a)(5)(i) through (v)	§ 141.172(a)(5)		
Systems that collected TTHM and HAA5 data under the provisions of the ICR must submit the results of the samples collected during the last 12 months of monitoring under §141.142 no later than <u>December 31</u> , 1999	§ 141.172(a)(5)(i)		
Systems that collected 4 quarters of HAA5 occurrence data that meet the monitoring sample number and location for TTHM in §141.12 and §141.30 and handling and analytical methods requirements of §141.142(b)(1) must submit these data to the state no later than April 16, 1999; until the data has been approved the system must conduct monitoring for HAA5 using the monitoring requirements in (a)(2)(iii)	§ 141.172(a)(5)(ii)		,
Systems that conducted monitoring for HAA5 using monitoring requirements specified in (a)(1)(iii) and (a)(2)(iii)(A) must submit these data no later than March 31, 2000	§ 141.172(a)(5)(iii)		
Systems that elect to comply with all other provisions of this section as if HAA5 monitoring had been conducted and the results required compliance with this section must notify the state in writing of their election no later than December 31, 1999	§ 141.172(a)(5)(iv)		
Systems that elect to request that the state approve a more representative annual data set must submit their requests in writing no later than December 31, 1999	§ 141.172(a)(5)(v)		

Federal Requirement	Federal Citation	State Citation (document title, page number, section/paragraph)	Different from Fed. requirement? Explain on separate sheet
Any system having a TTHM annual average >0.064 mg/L or an HAA5 annual average >0.048 mg/L during the period in (a)(1) and (2) must develop a disinfection profile as described in (b)	§ 141.172(a)(6)		
System that meets applicability criteria in (a)(6) must develop a disinfection profile for its disinfection practice for period of up to 3 years	§ 141.172(b)(1)		
System must monitor daily for a period of 12 consecutive calendar months to determine total logs of inactivation for each day of operation; based on CT99.9 in §141.74(b); must begin monitoring no later than <u>April 1, 2000</u> ; system with single point of disinfectant application must conduct monitoring in (b)(2)(i) through (iv); system with more than one point of disinfectant application must conduct monitoring in (b)(2)(i) through (iv) for each disinfection segment; system must monitor necessary parameters to determine total inactivation ratios using analytical methods in §141.74(a)	§ 141.172(b)(2)		
Temperature of disinfected water must be measured once per day at each residual disinfectant concentration sampling point during peak hourly flow	§ 141.172(b)(2)(i)		
pH of disinfected water must be measured once per day at each disinfectant residual concentration sampling point during peak hourly flow if system uses chlorine	§ 141.172(b)(2)(ii)		
Disinfectant contact time(s) ("T") must be determined for each day during peak hourly flow	§ 141.172(b)(2)(iii)		
Residual disinfection concentration(s) ("C") of the water before or at first customer prior to each additional point of disinfection must be measured each day during peak hourly flow	§ 141.172(b)(2)(iv)		
In lieu of the monitoring under (b)(2) to develop a profile a system may elect to meet requirements of $(b)(3)(i)$	§ 141.172(b)(3)		

June 2001

IESWTR Implementation Guidance



Federal Requirement	Federal Citation	State Citation (document title, page number, section/paragraph)	Different from Fed. requirement? Explain on separate sheet
PWS that has 3 years of existing operational data may submit those data, a profile generated using those data, and a request that the state approve use of these data in lieu of monitoring under (b)(2) no later than March 31, 2000; state must determine if the data are substantially equivalent to the data collected under (b)(2); data must be representative of Giardia lamblia inactivation through the entire treatment plant; until state approves the data set the system is required to conduct monitoring under (b)(2)	§ 141.172(b)(3)(i)		
PWS that has existing operational data may use those data to develop a disinfection profile for additional years; systems may use the additional yearly disinfection profiles to develop a benchmark under (c); state must determine whether the operational data are substantially equivalent to the data collected under (b)(2); data must be representative of inactivation through entire the treatment plant	§ 141.172(b)(3)(ii)		
System must calculate the total inactivation ratio(s) as specified in (b)(4)(i) through (iii)	§ 141.172(b)(4)		
If the system uses 1 point of disinfection it may determine the total inactivation ratio based on either method in $(b)(4)(i)(A)$ or $(b)(4)(i)(B)$	§ 141.172(b)(4)(i)		
If the system uses 1 point of disinfection it may determine one inactivation ratio (CTcalc/CT _{99.9}) before or at the first customer during peak hourly flow.	§ 141.172(b)(4)(i)(A)		
If the system uses 1 point of disinfection it may determine successive CTcalc/CT99.9 values representing sequential inactivation ratios between the point of disinfectant application and a point before or at the first customer during peak hourly flow; system must calculate the total inactivation ratio by determining (CTcalc/CT _{99,9}) for each sequence and then adding (CTcalc/CT _{99,9}) values to determine (\(\subseteq \text{(CTcalc/CT _{99,9})}\)	§ 141.172(b)(4)(i)(B)		
If system uses more than 1 point of disinfectant application before the first customer the system must determine CT value of each-disinfection sequence immediately prior to the next point of disinfectant application, or for the final segment before or at the first customer during peak hourly flow; $(CTcalc/CT_{90,9})$ value of each sequence and $(\sum(CTcalc/CT_{90,9}))$ must be calculated using methods in $(b)(4)(i)$	§ 141.172(b)(4)(ii)		

Federal Requirement	Federal Citation	State Citation (document title, page number, section/paragraph)	Different from Fed. requirement? Explain on separate sheet
System must determine the total logs of inactivation by multiplying the value calculated in (b)(4)(i) or (ii) of this section by 3.0	§ 141.172(b)(4)(iii)		
System that uses chloramines or ozone for primary disinfection must also calculate the logs of inactivation for viruses using a method approved by the state	§ 141.172(b)(5)		
System must retain the disinfection profile data in graphic form, as a spreadsheet, or some other format acceptable to the state for review as part of sanitary surveys conducted by the state	§ 141.172(b)(6)		
System required to develop a disinfection profile under (a) and (b) that decides to make a significant change to its disinfection practice must consult with the state prior to making such a change	§ 141.172(c)(1)		
Significant change to disinfection practice: changes to point of disinfection	§ 141.172(c)(1)(i)		
Significant change to disinfection practice: changes to disinfectant(s) used in treatment plant	§ 141.172(c)(1)(ii)		
Significant change to disinfection practice: changes to disinfection process	§ 141.172(c)(1)(iii)		
Significant change to disinfection practice: any other modification identified by the state	§ 141.172(c)(1)(iv)		
System modifying disinfection practice must calculate disinfection benchmark using procedure specified in (c)(2)(i) through (ii)	§ 141.172(c)(2)		
For each year of profiling data collected in (b) the system must determine the lowest average monthly <i>Giardia lamblia</i> inactivation in each year of profiling data; system must determine average <i>Giardia lamblia</i> inactivation for each calendar month for each year of profiling data by dividing the sum of daily <i>Giardia lamblia</i> logs of inactivation by the number of values calculated for that month	§ 141.172(c)(2)(i)		
Disinfection benchmark is the lowest monthly average (systems with 1 year of profiling data) or the average of lowest monthly average values (systems with more than 1 year of profiling data) of monthly logs of Giardia lamblia inactivation in each year of profiling data	§ 141.172(c)(2)(ii)		

Federal Requirement	Federal Citation	State Citation (document title, page number, section/paragraph)	Different from Fed. requirement? Explain on separate sheet
System using chloramines or ozone for primary disinfection must also calculate disinfection benchmark for viruses using a method approved by the state	§ 141.172(c)(3)		
System must submit information in (c)(4)(i) through (iii) to the state as part of its consultation process	§ 141.172(c)(4)		- T
Consultation process: description of proposed change	§ 141.172(c)(4)(i)		
Consultation process: disinfection profile and benchmark for Giardia lamblia and viruses, if necessary	§ 141.172(c)(4)(ii)		
Consultation process: analysis of how the proposed change will affect the current level of disinfection	§ 141.172(c)(4)(iii)		
\$141.173 FILTRATION			
Subpart H system that does not meet all criteria for avoiding filtration must provide treatment consisting of disinfection (§141.72(b)) and a filtration treatment that complies with requirements of (a) or (b) or §141.73(b) or (c) by <u>December 31, 2001</u>	§ 141.173		
For systems using conventional/direct filtration the turbidity level of representative samples of a system's filtered water must be \le 0.3 NTU in at least 95% of monthly measurements measured as specified in §141.74(a) and (c)	§ 141.173(a)(1)		
For systems using conventional/direct filtration the turbidity level of representative samples of a system's filtered water must at no time exceed 1 NTU measured as specified in §141.74(a) and (c)	§ 141.173(a)(2)		
Systems that use lime softening may acidify representative samples prior to analysis using a protocol approved by the state	§ 141.173(a)(3)		

Federal Requirement	Federal Citation	State Citation (document title, page number, section/paragraph)	Different from Fed. requirement? Explain on separate sheet
For systems using other than conventional/direct/slow sand/diotomaceous earth filtration the system may use a filtration technology not listed in (a) or §141.73(b) or (c) if it demonstrates that the alternative filtration technology in combination with disinfection treatment that meets the requirements in §141.72(b) consistently removes/inactivates 99.9% of <i>Giardia lamblia</i> cysts, 99.99% of viruses, and 99% of <i>Cryptosporidium</i> occysts; state must approve the use of the technology; state will set turbidity performance requirements that the system must meet 95% of the time and the system may not at any time exceed a level that removes/inactivates 99.9% <i>Ciardia lamblia</i> , 99.99% viruses, 99% <i>Cryptosporidium</i>	§ 141.173(b)		,
§141.174 FILTRATION SAMPLING REQUIREMENTS			
Subpart H systems using conventional/direct filtration must conduct continuous turbidity monitoring for each individual filter using an approved method in §141.74(a) and must calibrate turbidimeters using the procedure specified by the manufacturer; system must record the results of individual filter monitoring every 15 minutes	§ 141.174(a)		
If there is a failure in continuous turbidity monitoring equipment the system must conduct grab sampling every 4 hours in lieu of continuous monitoring, but for no more than five working days following the failure of the equipment	§ 141.174(b)		
§ 141.175 REPORTING AND RECORDKEEPING REQUIREMENTS	IREMENTS		
In addition to requirements in §141.75, Subpart H systems using conventional/direct filtration must report monthly to the state the information in (a) and (b) beginning January 1, 2002; systems using alternative filtration technologies must report monthly to the state the information in (a) in lieu of reporting in (b)(1)	§ 141.175		
Turbidity measurements must be reported within 10 days after the end of each month the system serves water to the public	§ 141.175(a)		•
Information that must be reported: total number of filtered water turbidity measurements taken during the month	§ 141.175(a)(1)		

Federal Requirement	Federal Citation	State Citation (document title, page number, section/paragraph)	Different from Fed. requirement? Explain on separate sheet
Information that must be reported: number and percentage of filtered water turbidity measurements taken during the month that are less than or equal to the turbidity limits specified in §141.173(a) or (b)	§ 141.175(a)(2)		
Information that must be reported: date and value of any turbidity measurements taken during the month that exceed 1 NTU for systems using conventional/direct filtration or that exceed the maximum level set by the state under §141.173(b)	§ 141.175(a)(3)		
Systems must maintain the results of individual filter monitoring for at least 3 years; systems must report they have conducted individual filter monitoring within 10 days after the end of each month the system serves water to the public; system must report individual filter turbidity measurements within 10 days after the end of each month the system serves water to the public only if the measurements demonstrate 1 or more of the conditions in (b)(1) through (4); system using lime softening may apply to the state for alternative exceedance levels if they can demonstrate that the higher turbidity levels in individual filters are due to lime carryover and not to degraded filter performance	§ 141.175(b)		
For any individual filter that has measured a turbidity level of greater than 1.0 NTU in 2 consecutive measurements taken 15 minutes apart the system must report filter number, turbidity measurements, and date(s) of exceedance; system must produce a filter profile within 7 days of the exceedance and report that the profile has been produced OR report the obvious reason for the exceedance	§ 141.175(b)(1)		
For any individual filter that has measured a turbidity level of greater than 0.5 NTU in 2 consecutive measurements taken 15 minutes apart after the first four hours of continuous operation after filter has been backwashed or otherwise taken offline the system must report filter number, turbidity measurements, and date(s) of exceedance; system must produce a filter profile within 7 days of the exceedance and report that the profile has been produced OR report the obvious reason for the exceedance	§ 141.175(b)(2)		

Federal Requirement	Federal Citation	State Citation (document title, page number, section/paragraph)	Different from Fed. requirement? Explain on separate sheet
For any individual filter that has measured a turbidity level of greater than 1.0 NTU in 2 consecutive measurements taken 15 minutes apart in each of 3 consecutive months the system must report filter number, turbidity measurements, and date(s) of exceedance; system must conduct a self-assessment of the filter within 14 days of the exceedance and report that the self-assessment has been conducted; self-assessment must consist of an assessment of filter performance, development of a filter profile, identification and prioritization of factors that limit filter performance, an assessment of the applicability of corrections, preparation of a filter self-assessment report	§ 141.175(b)(3)		
For any individual filter that has measured a turbidity level of greater than 2.0 NTU in 2 consecutive measurements taken 15 minutes apart in 2 consecutive months the system must report filter number, turbidity measurements, and date(s) of exceedance, system must contact the state or a 3 st party to conduct a comprehensive performance evaluation no later than 30 days following the exceedance and have the evaluation completed and submitted to the state no later than 90 days following the exceedance	§ 141.175(b)(4)		
If at any time the turbidity exceeds 1 NTU in representative samples of filtered water in a system using conventional filtration treatment or direct filtration, the system must inform the state as soon as possible, but no later than the end of the next business day.	§ 141.175(c)(1)		
If at any time the turbidity in representative samples of filtered water exceeds the maximum level set by the state under 141.173 (b) for filtration technologies other than conventional filtration treatment, direct filtration, slow sand filtration, or diatomaceous earth filtration, the system must inform the state as soon as possible, but no later than the end of the next business day.	§ 141.175(c)(2)		

June 2001

PRIMACY REVISION CROSSWALK FOR THE IESWTR	SSWALK FOR THE IES	SWTR
Federal Requirement	Federal Citation	Explanation of State Policies and Procedures
SUBPART B—PRIMARY ENFORCEMENT RESPONSIBILITY	ITY	
§ 142.14 RECORDS KEPT BY STATES		
Records of turbidity measurements must be kept for not less than 1 year in a form that makes them comparable with the limits specified in §141.71, §141.73, §141.175	§ 142.14(a)(3)	
Records of disinfectant residual measurements and other parameters necessary to document disinfection effectiveness, in accordance with §141.72 and §141.74, must be kept for not less than 1 year	§ 142.14(a)(4)(i)	
Records of reporting requirements of §141.75 and §141.175 must be kept for no less than 1 year	§ 142.14(a)(4)(i)	
Records of decisions made on a system-by-system and case-by-case basis must be kept in writing and kept at the state	§ 142.14(a)(4)(ii)	
Records of systems consulting with the state concerning modification to their disinfection practices under §141.172(c) including status of the consultation must be kept	§ 142.14(a)(7)(i)	
Records of decisions that a system using alternative filtration technologies can consistently remove/inactivate 99% of Cryptosporidium, 99.9 percent removal and/or inactivation of Giardia lamblia, 99.99 percent removal and/or inactivation of viruses must be kept; decision must include state-set enforceable turbidity limits for each system; copy of decision must be kept until decision is reversed or revised; state must provide copy of decision to the system	§ 142.14(a)(7)(ii)	
Records of systems required to do filter self-assessment, CPE, or CCP under the requirements of §141.175 must be kept	§ 142.14(a)(7)(iii)	
§ 142.15 REPORTS BY STATES		
List of Subpart H systems that have had a sanitary survey completed during the previous year and an annual evaluation of the state's program for conducting sanitary surveys under §141.16(b)(3)	§ 142.15(c)(5)	

Federal Requirement	Federal Citation E	Explanation of State Policies and Procedures
§ 142.16 SPECIAL PRIMACY REQUIREMENTS		
States must have the appropriate rules or other authority to assure that PWSs respond to significant deficiencies outlined in sanitary survey reports no later than 45 days after receipt of the report indicating how and on what schedule the system will address significant deficiencies noted in the survey	§ 142.16(b)(1)(ii)	,
States must have the appropriate rules or other authority to assure that PWSs take the necessary steps to address significant deficiencies identified in the sanitary survey reports if such deficiencies are within the control of a PWS and its governing body	§ 142.16(b)(1)(iii)	
Application must describe how the state will implement a sanitary survey program that meets requirements in (b)(3)(i) through (v)	§ 142.16(b)(3)	
Conduct sanitary surveys that address the 8 sanitary survey components for all Subpart H systems no less frequently than every 3 years for CWS and no less than every 5 years for NCWS; state may allow sanitary surveys conducted after December 1995 to serve as the first set of required sanitary surveys if the surveys address the 8 sanitary survey components	§ 142.16(b)(3)(i)	
Sanitary survey component: source	§ 142.16(b)(3)(i)(A)	
Sanitary survey component: treatment	§ 142.16(b)(3)(i)(B)	
Sanitary survey component: distribution system	§ 142.16(b)(3)(i)(C)	
Sanitary survey component: finished water storage	§ 142.16(b)(3)(i)(D)	
Sanitary survey component: pumps, pump facilities, and controls	§ 142.16(b)(3)(i)(E)	
Sanitary survey component: monitoring, reporting, and data verification	§ 142.16(b)(3)(1)(F)	
Sanitary survey component: system management and operation	§ 142.16(b)(3)(i)(G)	
Sanitary survey component: operator compliance with state requirements	§ 142.16(b)(3)(i)(H)	
For CWSs determined by the state to have outstanding performance based on prior sanitary surveys, subsequent sanitary surveys may be conducted no less than every 5 years; state must describe how it will decide whether a system has outstanding performance and is eligible for sanitary surveys at a reduced frequency	§ 142.16(b)(3)(ii)	
Components of the sanitary survey may be completed as part of a staged or phased state review process within the established frequency	§ 142.16(b)(3)(iii)	

Federal Requirement	Federal Citation	Explanation of State Policies and Procedures
State must review the disinfection profile as part of the sanitary survey for systems that are required to comply with the profiling requirements in §141.172	§ 142.16(b)(3)(iv)	
State must describe how it will decide whether a deficiency identified during the sanitary survey is significant for purposes of (b)(1)(ii)	§ 142.16(b)(3)(v)	
States must have the appropriate rules or other authority to require PWSs to conduct a CCP and assure that PWSs implement the followup recommendations that result from a CCP	§ 142.16(g)(1)	•
How the state will a approve more representative annual data set than the data set for §141.172(a)(1) or (2) for the purposes of determining the applicability of the requirements of §141.172	§ 142.16(g)(2)(i)	
How the state will approve the method to calculate the logs of inactivation for viruses for a system that uses chloramines or ozone for primary disinfection	§ 142.16(g)(2)(ii)	
How the state will consult with PWSs to evaluate modifications to their disinfection practices	§ 142.16(g)(2)(iii)	1
How the state will determine that a PWS may use an alternative filtration technology if in combination with disinfection it achieves 99.9% removal/inactivation of <i>Giardia lamblia</i> , 99.99% of viruses, 99% of <i>Cryptosporidium</i> ; how the state will set the turbidity performance requirements that a system must meet 95% of the time and may not exceed at any time a level that consistently removes/inactivates 99.9% of <i>Giardia lamblia</i> , 99.99% of viruses, 99% of <i>Cryptosporidium</i>	§ 142.16(g)(2)(iv)	

Appendix B

Sample Extension Agreement

Under 40 CFR 142.12, states must adopt the requirements of the Interim Enhanced Surface Water Treatment Rule (IESWTR) within 2 years of the final rules' publication or by December 16, 2000.

An extension agreement will be necessary **only** when states have not submitted a complete and final primacy revision application package by December 16, 2000. For further detail, please refer to Section III B.

A sample extension agreement is presented on the following pages.

Extension Agreement

Name of State Agency U.S. Environmental Protection Agency Region ____ Extension Agreement for Implementation of the Interim Enhanced Surface Water Treatment Rule (IESWTR)

On December 16, 1998, the U.S. Environmental Protection Agency (EPA) published the final Interim Enhanced Surface Water Treatment Rule (IESWTR). This rule amends the National Primary Drinking Water Regulations, 40 CFR Part 141 and the regulations for implementation of the National Primary Drinking Water Regulations, 40 CFR Part 142. Most provisions of the rules take effect 36 to 60 months after publication. Some provisions however, affect public water systems (PWSs) earlier.

The April 28, 1998 revisions to the Primacy Rule extend the time allowed for States to adopt new Federal regulations from 18 months to 2 years. Therefore, the State must adopt regulations pertaining to the IESWTR and submit a complete and final primacy revision application by December 16, 2000 unless it requests an extension of up to 2 years to adopt the new or revised regulation.

This document records the terms of a Primacy Extension Agreement between the (Name of State Agency) (the State) and the EPA, Region _____ for the Interim Enhanced Surface Water Treatment Rule, and shall remain effective from the date (for State's eligible for interim primacy) this extension agreement is signed until either December 16, 2002 or the date the State's primacy application is submitted under 40 C.F.R. §142.12. To retain primacy the State must submit a final and approvable primacy revision application incorporating the above-referenced provisions of the Federal Register to EPA, Region _____ by December 16, 2000, or no later than December 16, 2002, if the State has been granted an extension.

Until the State primacy revision application has been submitted, for States eligible for interim primacy, or approved, the State and EPA, Region ____ will share responsibility for implementing the primary program elements as indicated below.

This Extension Agreement outlines the responsibilities of (Name of State Agency) and EPA, Region _____ as partners in this effort, working toward two very specific public health-related goals. The first goal is to achieve a high level of compliance with the regulation. The second goal is to facilitate successful implementation of the regulation during the transition period before the State has interim primacy for the rule. In order to accomplish these goals, education and training will need to be provided to water suppliers on their responsibilities under the IESWTR.

ACIIVIII	es to be carried out by the State or Region:
Q	Notify PWSs within 60 days of signing this extension agreement of the requirements of the IESWTR;
Q	Identify other State agencies that should receive copies of the IESWTR. Within 60 days of signing this extension agreement, provide EPA Region with the names, addresses, and phon numbers of contacts identified within those agencies;
۵	Train State staff and PWSs on the requirements of the IESWTR;
۵	Devise a tracking system for PWSs' monitoring and reporting performed pursuant to the IESWTR;
Ġ	Issue notices to PWSs that fail to meet requirements of the IESWTR;
۵	Provide copies of the IESWTR in response to public inquiries;
ū	Report IESWTR violation and enforcement information to SDWIS as required;
۵	Coordinate with water associations to increase awareness of requirements;
a	Assist with public outreach efforts to inform and educate PWSs;
Q	Prepare guidance as needed, or forward national guidance to the States;
ū	Keep States informed of SDWIS reporting requirements during development and implementation;
D	Compliance assistance; and,
۵	Notify States of all Federal enforcement actions.

Dated thisday of	, 2000	
Agency Director or Secretary		
Name of State Agency		
Dated thisday of	, 2000	
Regional Administrator EPA, Region		

This Extension Agreement will take effect upon the date of the last signature.

Appendix C

Statement of Principles—Guidance on Audit Law Issues



UNITED STATES ENVIRONMENTAL PROTECTION AGENCY WASHINGTON, D.C. 20468

FEB | 4 1997

MEMORANDUM

SUBJECT: Statement of Principles

Effect of State Audit Immunity/Privilege Laws
On Enforcement Authority for Federal Programs

TO: Regional Administrators

FROM: Steven A. Herman

Assistant Administrator, OECA

Robert Perciasepe
Assistant Administrate Differ Percentage

Mary Nichols Why All John Assistant Administrator, DAR

Timothy Fields Acting Assistant Administrator, OSWER

Under federal law, states must have adequate authority to enforce the requirements of any federal programs they are authorized to administer. Some state audit immunity/privilege laws place restrictions on the ability of states to obtain penalties and injunctive relief for violations of federal program requirements, or to obtain information that may be needed to determine compliance status. This statement of principles reflects EPA's orientation to approving new state programs or program modifications in the face of state audit laws that restrict state enforcement and information gathering authority. While such state laws may raise questions about other federal program requirements, this statement is limited to the question of when enforcement and information gathering authority may be considered adequate for the purpose of approving or delegating programs in states with audit privilege or immunity laws.

Printed on Regrand Paper

L Audit Immunity Laws

Federal law and regulation requires states to have authority to obtain injunctive relief, and civil and criminal penalties for any violation of program requirements. In determining whether to authorize or approve a program or program modification in a state with an audit immunity law, EPA must consider whether the state's enforcement authority meets federal program requirements. To maintain such authority while at the same time providing incentives for self-policing in appropriate circumstances, states should rely on policies rather than enact statutory immunities for any violations. However, in determining whether these requirements are met in states with laws pertaining to voluntary auditing, EPA will be particularly concerned, among other factors, with whether the state has the ability to:

- 1) Obtain immediate and complete injunctive relief;
- 2) Recover civil penalties for:
 - i) significant economic benefit;
 - ii) repeat violations and violations of judicial or administrative orders;
 - iii) serious harm;
 - iv) activities that may present imminent & substantial endangerment.
- 3) Obtain criminal fines/sanctions for wilful and knowing violations of federal law, and in addition for violations that result from gross negligence under the Clean Water Act.

The presumption is that each of these authorities must be present at a minimum before the state's enforcement authority may be considered adequate. However, other factors in the statute may eliminate or so narrow the scope of penalty immunity to the point where EPA's concerns are met. For example:

- 1) The immunity provided by the statute may be limited to minor violations and contain other restrictions that sharply limit its applicability to federal programs.
- 2) The statute may include explicit provisions that make it inapplicable to federal programs.

II. Audit Privilege Laws

Adequate civil and criminal enforcement authority means that the state must have the ability to obtain information needed to identify noncompliance and criminal conduct. In

determining whether to authorize or approve a program or program modification in a state with an audit privilege law, EPA expects the state to:

- 1) retain information gathering authority it is required to have under the specific, requirements of regulations governing authorized or delegated programs;
- avoid making the privilege applicable to criminal investigations, grand jury
 proceedings, and prosecutions, or exempt evidence of criminal conduct from the scope of
 privilege;
- 3) preserve the right of the public to obtain information about noncompliance, report violations and bring enforcement actions for violations of federal environmental law. For example, sanctions for whistleblowers or state laws that prevent citizens from obtaining information about noncompliance to which they are entitled under federal law appear to be inconsistent with this requirement.

III. Applicability of Principles

It is important for EPA to clearly communicate its position to states and to interpret the requirements for enforcement authority consistently. Accordingly, these principles will be applied in reviewing whether enforcement authority is adequate under the following programs:

- National Pollutant Discharge Elimination System (NPDES), Pretreatment and Worlands programs under the Clean Water Act;
- Public Water Supply Systems and Underground Injection Control programs under the Safe Drinking Water Act;
- 3) Hazardous Waste (Subtitle C) and Underground Storage Tank (Subtitle I) programs under the Resource Conservation Recovery Act;
- 4) Title V, New Source Performance Standards, National Emission Standards for Hazardous Air Pollutants, and New Source Review Programs under the Clean Air Act.

These principles are subject to three important qualifications:

- 1) While these principles will be consistently applied in reviewing state enforcement authority under federal programs, state laws vary in their detail. It will be important to scrudnize the provisions of such statutes closely in determining whether enforcement authority is provided.
- 2) Many provisions of state law may be ambiguous, and it will generally be important to obtain an opinion from the state Attorney General regarding the meaning of the state law

3) These principles are broadly applicable to the requirements for penalty and information gathering authority for each of the programs cited above. To the extent that different or more specific requirements for enforcement authority may be found in federal law or regulations, EPA will take these into account in conducting its review of state programs. In addition, this memorandum does not address other issues that could be raised by state audit laws, such as the scope of public participation or the availability to the public of information within the state's possession.

IV. Next Steps

Regional offices should, in consultation with OECA and national program offices, develop a state-by-state plan to work with states to remedy any problems identified pursuant to application of these principles. As a first step, regions should contact state attorneys general for an opinion regarding the effect of any audit privilege or immunity law on enforcement authority as discussed in these principles.

Appendix D IESWTR Plain English Summary

♦EPA The Interim Enhanced Surface Water Treatment Rule

What Does it Mean to You?

TABLE OF CONTENTS

De	etinitions and Abbreviations
1.	Introduction
	Purpose of the Guide
	Background
	Development of the Rule
	Benefits of the Rule
2.	Applicability and Compliance Dates
3.	Summary of Requirements9
	Disinfection profiling and benchmarking9
	Cryptosporidium
	Strengthened turbidity requirements
	Individual filter monitoring requirements
	Uncovered finished water storage facilities
	Public water system recordkeeping and reporting requirements
	Sanitary surveys
	Unfiltered Systems
4.	Additional Information
5.	Detailed regulatory requirements
	Combined filter effluent turbidity monitoring
	Individual filter turbidity monitoring
	Disinfection profiling and benchmarking

Definitions and Abbreviations

Definitions

Comprehensive performance evaluation (CPE) — is a thorough review and analysis of a treatment plant's performance-based capabilities and associated administrative, operation and maintenance practices. It is conducted to identify factors that may be adversely impacting a plant's capability to achieve compliance and emphasizes approaches that can be implemented without significant capital improvements.

Disinfection profile — is a summary of daily Giardia lamblia inactivation through the treatment plant.

Filter profile — is a graphical representation of individual filter performance, based on continuous turbidity measurements or total particle counts versus time for an entire filter run, from startup to backwash inclusively, that includes an assessment of filter performance while another filter is being backwashed.

Uncovered finished water storage facility ---- is a tank, reservoir, or other facility used to store water that will undergo no further treatment except residual disinfection and is open to the atmosphere.

Abbreviations Used in This Document

CCP: Composite Correction Program
CDC: Centers for Disease Control

CPE: Comprehensive Performance Evaluation

CTA: Comprehensive Technical Assistance

CWS: Community Water System
DBP: Disinfection Byproducts

DBPP: Disinfection Byproducts Precursors

DBPR: Disinfectants/Disinfection Byproducts Rule

EC: Enhanced Coagulation

EPA: United States Environmental Protection Agency

ES: Enhanced Softening

ESWTR: Enhanced Surface Water Treatment Rule

FACA: Federal Advisory Committee Act

FR: Federal Register

GAC10: Granular activated carbon with ten minute empty bed contact time and 180 day

reactivation frequency

GWR: Ground Water Rule

GWUDI: Ground Water Under the Direct Influence of Surface Water

HAA5: Haloacetic acids (Monochloroacetic, Dichloroacetic, Trichloroacetic,

Monobromoacetic and Dibromoacetic Acids)

hrs: Hours

ICR: Information Collection Rule

IESWTR: Interim Enhanced Surface Water Treatment Rule

Log Inactivation: Logarithm of (N₀/N_T)

Log: Logarithm (common, base 10)

LT1ESWTR: Long Term 1 Enhanced Surface Water Treatment Rule
LT2ESWTR: Long Term 2 Enhanced Surface Water Treatment Rule
LTESWTR: Long Term Enhanced Surface Water Treatment Rule

MCL: Maximum Contaminant Level

MCLG: Maximum Contaminant Level Goal

M-DBP: Microbial and Disinfectants/Disinfection Byproducts

MR: Monitoring/Reporting

MRDL: Maximum Residual Disinfectant Level
MRDLG: Maximum Residual Disinfectant Level Goal

NCWS: Non-Community Water System

NSCEP: National Service for Environmental Publications

NTIS: National Technical Information Service

NTNCWS: Non-Transient Non-Community Water System

NTU: Nephelometric Turbidity Unit

PWS: Public Water System
RegNeg.: Regulatory Negotiation
SDWA or "The Act": Safe Drinking Water Act

SDWIS: Safe Drinking Water Information System

Subpart H: PWS using surface water or ground water under the direct influence of surface

water

SUVA: Specific Ultraviolet Absorption SWTR: Surface Water Treatment Rule

TNCWS: Transient Non-Community Water System

TOC: Total Organic Carbon
TTHM: Total Trihalomethanes

x log removal: Reduction to 1/10^x of original concentration

1. Introduction

Purpose of the Guide

The purpose of this guide is to detail the regulatory requirements of the Interim Enhanced Surface Water Treatment Rule (IESWTR). The IESWTR, published in the *Federal Register* on December 16, 1998 (63 FR 69478; www.epa.gov/OGWDW/mdbp/ieswtrfr.html; 66 FR 3770; www.epa.gov/safewater/mdbp/iesfr.html; Appendix H—rule language only), is the first part of a series of rules, the "Microbial-Disinfectants/Disinfection Byproducts Cluster" (M-DBP Cluster), to be published over the next several years that are intended to control microbial pathogens while minimizing the public health risks of disinfectants and disinfection byproducts (DBPs). The IESWTR is designed to address the health risks from microbial contaminants without significantly increasing the potential risks from chemical contaminants. This rule was published concurrently with the Stage 1 Disinfectants/Disinfection

Background

The 1974 Safe Drinking Water Act (SDWA) called for EPA to regulate drinking water by creating the national interim primary drinking water regulations (NIPDWR). In 1979, the first interim standard addressing DBPs was set for total trihalomethanes (TTHMs), a group of four volatile organic chemicals which form when disinfectants react with natural organic matter in the water.

Byproducts Rule (Stage 1 DBPR), which addresses control of disinfectants and their byproducts.

Although SDWA was amended slightly in 1977, 1979, and 1980, the most significant changes to the 1974 law occurred when SDWA was reauthorized in 1986. Disease-causing microbial contamination had not been sufficiently controlled under the original Act. To safeguard public health, the 1986 Amendments required EPA to set health goals, or maximum contaminant level goals (MCLGs) and maximum contaminant levels (MCLs) for 83 named contaminants. EPA was also required to establish regulations within certain time frames, require disinfection of all public water supplies, specify filtration requirements for nearly all water systems that draw their water from surface sources, and develop additional programs to protect ground water supplies.

In 1989, EPA issued two important National Primary Drinking Water Regulations (NPDWR): The Total Coliform Rule (TCR) and the Surface Water Treatment Rule (SWTR). The TCR and SWTR provide the foundation for the M-DBP Cluster and are summarized below.

The TCR covers all public water systems. Since coliforms are easily detected in water, they are used to indicate a water system's vulnerability to pathogens in the water. In the TCR, EPA set a MCLG of zero for total coliforms. EPA also set a MCL for total coliforms. If more than 5.0 percent of the samples contain coliforms within a month, water system operators must report this violation to the state and the public. In addition, sanitary surveys are required every five or ten years (depending on the quality of the source water) for every system that collects fewer than five samples per month (typically systems that serve less than 4,100 people).

EPA issued the SWTR in response to Congress' mandate requiring disinfection, and where necessary, filtration of systems that draw their water from surface sources before distribution. The SWTR applies to all systems that use surface water or ground water under the direct influence of surface water (GWUDI). The rule sets MCLGs for *Legionella*, *Giardia lamblia*, and viruses at zero since any exposure to these contaminants presents some level of health risk.

Specifically, the rule requires that a surface water system have sufficient treatment to reduce the source water concentration of *Giardia lamblia* and viruses by at least 99.9 percent (3 log) and 99.99 percent (4 log), respectively. A detectable disinfection residual must be maintained throughout the entire distribution system. For systems that filter, the adequacy of the filtration process is determined by measuring the turbidity of the treated water since high levels of turbidity often indicate that the filtration process is not working properly. The goal of the SWTR is to reduce risk to less than one infection per year per 10,000 people. However, the SWTR does not account for systems with high pathogen concentrations that, when treated at the levels required under the rule, still may not meet this health goal, and the rule does not specifically control for the protozoan *Cryptosporidium*.

In 1990, EPA's Science Advisory Board, an independent panel of experts established by Congress, cited drinking water contamination as one of the most important environmental risks and indicated that disease-causing microbial contaminants (i.e., bacteria, protozoa, and viruses) are probably the greatest remaining health-risk management challenge for drinking water suppliers. Data from the Centers for Disease Control (CDC) confirm this concern and indicate that between 1980 and 1994, 379 waterborne disease outbreaks were reported, with over 500,000 cases of disease. During this period, a number of agents were implicated as the cause, including protozoa, viruses, bacteria, and several chemicals. Most of the cases (but not the outbreaks) were associated with surface water, including a single outbreak of cryptosporidiosis in Milwaukee (over 400,000 cases).

In response to these findings, the SDWA was further amended in 1996 to improve public health protection by incorporating new data on the adverse health effects of contaminants, the occurrence of contaminants in public water systems, and the estimated reduction in health risks that would result from further regulation. The Act also increased scientific research requirements and emphasized cost-benefit analyses in the regulatory decision process.

Based on prevailing scientific data, the M-DBP Cluster is intended to control microbial pathogens while minimizing the public health risk from disinfectants and DBPs. Since multiple threats require multiple barriers, the IESWTR and Stage 1 DBPR expand on the foundation of the TCR, SWTR, and TTHM standards to target health risk outliers unaddressed by prior regulations. By targeting these gaps, multiple threats can be minimized.

The IESWTR builds on the SWTR by adding protection from *Cryptosporidium* through strengthened combined filter effluent turbidity performance standards and individual filter turbidity provisions for filtered systems that serve greater than 10,000 people. For unfiltered systems, *Cryptosporidium* must be included in the watershed control requirements. In addition, the IESWTR builds on the TCR by requiring sanitary surveys for all public water systems using surface water and ground water under the direct influence of surface water. The IESWTR also requires covers for all new finished water storage facilities and includes disinfection benchmark provisions to ensure continued levels of microbial protection while taking the necessary steps to comply with the DBP standards. Collectively, the SWTR and IESWTR place stringent treatment requirements on systems using surface water as a source.

By building on the foundation set forth by the original SDWA, the quality of drinking water has improved and public health protection has increased. The IESWTR and Stage 1 DBP Rules are part of a series of rules designed to expand on the foundation of prior rulemaking efforts. By encompassing previously unaddressed health risks from microbials and disinfection byproducts, the M-DBP Cluster continues to maximize drinking water quality and public health protection.

Development of the Rule

The new rules are a product of 6 years of collaboration among the water supply industry, environmental and public health groups, and local, state, and federal governments. EPA first launched a rule-making process in 1992 and convened a Regulatory Negotiation (RegNeg) Advisory Committee under the Federal Advisory Committees Act (FACA), representing a range of stakeholders affected by possible regulation. The 1996 SDWA Amendments required EPA to develop rules to balance the risks between microbial pathogens and disinfection byproducts.

In 1997, a similar FACA process was implemented with the Microbial-Disinfectants/Disinfection Byproducts (M-DBP) Advisory Committee. The M-DBP Committee convened to collect, share, and analyze new information available since 1994, review previous assumptions made during the RegNeg process, as well as build consensus on the regulatory implications of this new information. Negotiations resulted in the following three proposals:

- A staged approach to regulation of DBPs (referred to as the Stage 1 and Stage 2 DBPRs) incorporating Maximum Contaminant Levels (MCLs), Maximum Residual Disinfectant Levels (MRDLs), and treatment technique requirements;
- A companion Interim Enhanced Surface Water Treatment Rule (IESWTR) designed to improve control of microbial pathogens and prevent inadvertent reductions in microbial safety as a result of DBP control efforts; and,
- An Information Collection Rule (ICR) to collect information necessary to reduce many key uncertainties prior to subsequent negotiations for the Stage 2 DBPR.

Benefits of the Rule

The IESWTR will improve public health by increasing the level of protection from exposure to *Cryptosporidium* and other pathogens in drinking water supplies through improvements in filtration at water systems. According to the risk assessment performed for the Regulatory Impact Analysis, the IESWTR decreases the likelihood of endemic illness (constant, low-level presence of a disease or infection) from *Cryptosporidium* by 110,000 to 463,000 cases annually. Based on these values, the estimated annual benefits of reducing the illness range from \$0.263 billion to \$1.240 billion per year. This calculation is based on a valuation of \$2,000 per incidence of cryptosporidiosis prevented. The IESWTR will also reduce the risk of more severe health impacts on sensitive populations, including the risk of mortality. Additionally, the IESWTR will reduce the likelihood of outbreaks of cryptosporidiosis and its associated costs by providing a larger margin of safety against such outbreaks in some systems.

2. Applicability and Compliance Dates

The IESWTR applies to public water systems (PWSs) that use surface water or ground water under the direct influence of surface water (GWUDI) as a source (also known as subpart H systems) and serve 10,000 or more people. Additionally, it establishes a schedule by which states are required to conduct sanitary surveys for all subpart H systems.

Subpart H systems serving at least 10,000 people must comply with the turbidity and monitoring requirements, the primary requirements of the IESWTR, no later than January 1, 2002. However, PWSs with elevated levels of DBPs (total trihalomethanes—TTHM; and five haloacetic acids—HAA5) are

required to develop an evaluation of their existing disinfection practices—a disinfection profile—no later than April 2001.

The timetable for the IESWTR is presented in Table 1. The compliance dates for the associated Stage 1 Disinfectants/Disinfection Byproducts Rule (Stage 1 DBPR) are January 2002 and January 2004. Subpart H systems that serve 10,000 or more people will have to comply with the provisions of the Stage 1 DBPR by January 2002. Subpart H systems that serve fewer than 10,000 people and all ground water systems will have to comply with the provisions of the rule by January 2004. The rules to provide additional microbial protection for small subpart H systems (Long Term 1 ESWTR) and ground water systems (Ground Water Rule) are scheduled to be finalized in Spring/Summer 2001, with compliance required by Spring/Summer 2004.

Table 1: Timetable for the IESWTR Requirements

Date	IESWTR Requirement
December 16, 1998	Rule is published in Federal Register [63 FR 241 69478].
February 16, 1999	60-day legal challenge period ends.
February 16, 1999	Construction of uncovered finished water storage facilities is prohibited [40 CFR 141.170(c)].
March 16, 1999	After this date, TTHM and HAA5 monitoring must begin for systems that do not have ICR or occurrence data and wish to determine if they must develop a disinfection profile [40 CFR 141.172(a)(2)(iii)].
April 16, 1999	Systems that have 4 consecutive quarters of HAA5 occurrence data that meet the TTHM monitoring requirements must submit those data to the state to determine if they must develop a disinfection profile [40 CFR 141.172(a)(5)(ii)].
December 31, 1999	TTHM and HAA5 data are due for those systems that collected data under the ICR to determine if they must develop a disinfection profile [40 CFR 141.172(a)(5)(i)].
December 31, 1999	Systems that elect to profile without conducting 4 quarters of TTHM and HAA5 monitoring must notify the state of their election [40 CFR 141.172(a)(5)(iv)].
December 31, 1999	Systems that wish to request state approval of "a more representative annual data set" than the ICR data set to determine if they must develop a disinfection profile must do so in writing [40 CFR 141.172(a)(5)(v)].
March 31, 2000	TTHM and HAA5 monitoring must be complete for systems determining if they must develop a disinfection profile [40 CFR 141.172(a)(2)(iii)(A)].
March 31, 2000	If system is using 3 years of existing operational data to develop the disinfection profile, the profile generated from these data and a request for state approval must be submitted [40 CFR 141.172(b)(3)(i)].
April 1, 2000	Systems determining if they must develop a disinfection profile must submit their TTHM and HAA5 data to the state [40 CFR 141.172(a)(5)(iii)].
April 1, 2000	Systems must begin developing a disinfection profile if either their annual average TTHM ≥ 0.064 mg/L or their annual average HAA5 ≥ 0.048 mg/L [40 CFR 141.172(b)(2)].
March 31, 2001	Disinfection profile is complete [40 CFR 141.172(b)(2)].

Date	IESWTR Requirement
March 31, 2001	After this date, systems that were required to develop a disinfection profile that wish to make a significant change to their disinfection practice must first calculate a disinfection benchmark and consult with the state [40 CFR 141.172(c)].
December 31, 2001	Systems that are not required to filter must comply with the requirements for TTHM in §141.12 and §141.30 until this date. After this date, systems must comply with the requirements in Subpart L for TTHM, HAA5, bromate, chlorite, chlorine, chloramines, and chlorine dioxide [40 CFR 141.71(b)(6)].
December 31, 2001	Systems that do not meet all of the criteria for avoiding filtration and use conventional/direct filtration must meet the turbidity requirements of the rule [0.3 NTU CFE (combined filter effluent) 95 percent of the time, at no time exceed 1 NTU] [40 CFR 141.173].
December 31, 2001	Alternative technologies for systems that serve at least 10,000 people must remove 99 percent of <i>Cryptosporidium</i> oocysts, and the state must establish alternative turbidity performance standards that must be met 95 percent of the time and a maximum [40 CFR 141.173(b)].
January 1, 2002	Systems must comply with the reporting and recordkeeping requirements of 40 CFR 141.175, including turbidity exceptions reporting. Systems must, when appropriate: • Produce filter profiles or identify obvious reason for poor filter performance. • Report profile has been produced or identify obvious reason for poor filter performance. • Conduct filter self-assessments. • Have 3 rd party CPEs performed.
December 2004	State must have first round of sanitary surveys completed for Subpart H CWSs [40 CFR 142.16(b)(3)(i)].
December 2006	State must have first round of sanitary surveys completed for Subpart H NCWSs [40 CFR 142.16(b)(3)(i)].

3. Summary of Requirements

Disinfection profiling and benchmarking

Surface water or GWUDI systems having average annual TTHM ≥ 0.064 mg/L or annual average HAA5 ≥ 0.048 mg/L must develop a *disinfection profile*. The disinfection profile is a compilation of daily measurements of microbial inactivation by disinfection, collected over the period of 1 year. From the disinfection profile, the PWS calculates the average microbial inactivation potential for each month, and the lowest monthly average inactivation becomes the *disinfection benchmark*.

The purpose of these provisions is to provide a process whereby a public water system (PWS) and the state, working together, assure that there will be no significant reduction in microbial protection as the result of disinfection practice modifications designed to meet the more restrictive maximum contaminant levels (MCLs) for DBPs established in the Stage 1 DBPR. Those PWSs required to develop disinfection profiles, and that then wish to modify their disinfection practices to meet the new MCLs, must establish the disinfection benchmark and consult with the state prior to implementing such modifications. In addition, PWSs must keep the disinfection profile on file for the state to review during their sanitary surveys. The benchmark does not set a new regulatory floor for disinfection practice, but instead

characterizes current practice so that the system, in consultation with the state, can make an informed decision when implementing a modification.

Cryptosporidium

The IESWTR sets a maximum contaminant level goal (MCLG) of zero for the protozoan *Cryptosporidium*. It also establishes a requirement for 2-log (99%) removal of *Cryptosporidium* for systems that must currently filter under the SWTR. Systems that use conventional or direct filtration meet this requirement if they are in compliance with the strengthened turbidity performance standards for combined filter effluent in the IESWTR (discussed below). Systems that use slow sand or diatomaceous earth filtration meet the 2-log removal requirement if they are in compliance with the existing turbidity performance standards under the SWTR.

The IESWTR also extends the existing watershed control requirements for unfiltered systems to include the control of potential sources of *Cryptosporidium*. Such sources must be included in an unfiltered system's watershed control plan.

These new provisions, along with the new turbidity requirements, will better protect consumers from *Cryptosporidium* and other pathogens.

Strengthened turbidity requirements

The IESWTR includes a series of requirements related to turbidity. These requirements strengthen current SWTR requirements for combined filter effluent for systems that use conventional or direct filtration. The turbidity level of a system's combined filtered water at each plant must be less than or equal to 0.3 nephelometric turbidity units (NTUs) in at least 95 percent of the measurements taken each month, and the turbidity level of a system's combined filtered water must at no time exceed 1 NTU (under the SWTR, these turbidity requirements are 0.5 NTU and 5 NTU, respectively).

Individual filter monitoring requirements

The IESWTR requires continuous turbidity monitoring for individual filters. The rule requires that surface water and GWUDI systems that use conventional or direct filtration must conduct continuous turbidity monitoring (every 15 minutes) on the effluent of each individual filter. PWSs must report instances of poor filter performance to the state, and, based on performance triggers, must take prescribed actions to identify and correct the cause(s). This requirement will allow systems to identify filters whose poor performance might be masked in a combined filter effluent.

Uncovered finished water storage facilities

The rule prohibits building any uncovered finished water storage facilities (reservoir, holding tank, or other storage facility) for which construction begins after February 16, 1999. This provision will help limit recontamination of treated water, but does not require that existing uncovered finished water storage facilities be covered.

Public water system recordkeeping and reporting requirements

The IESWTR requires PWSs to submit combined filter effluent monitoring and compliance data and report that they have conducted individual filter turbidity monitoring to states within 10 days after the end of each month the system serves water to the public. Additionally, PWSs must report to the state if certain individual filter monitoring trigger levels are exceeded. In this case, systems must report turbidity

measurements and report that filter profiles, filter self-assessments, or Comprehensive Performance Evaluation (CPE) reports have been produced or conducted when instances of poor filter performance occur or persist based on monitoring of individual filter performance. Systems must maintain the results of individual filter monitoring for at least three years.

Sanitary surveys

The IESWTR requires that the state must conduct sanitary surveys for all PWSs using surface water or ground water under the direct influence of surface water (GWUDI), regardless of the population served, no less frequently than every 3 years for community water systems and every 5 years for noncommunity systems. For community water systems determined by the state in previous sanitary surveys to have "outstanding performance," successive sanitary surveys may be conducted at up to 5-year intervals.

Unfiltered Systems

The IESWTR requires unfiltered systems to continue to meet the SWTR source water and site-specific requirements to remain unfiltered. In addition, unfiltered systems must include *Cryptosporidium* in their watershed control programs and must meet all Stage 1 DBPR MCLs and MRDLs to remain unfiltered. Like filtered systems, they are subject to disinfection profiling and benchmarking and sanitary surveys.

4. Additional Information

A series of guidance manuals have been developed to support the Interim Enhanced Surface Water Treatment Rule and the Stage 1 Disinfectants/Disinfection Byproducts Rule. The manuals will aid EPA, state agencies and affected public water systems in implementing the two interrelated rules, and will help to ensure that implementation among these groups is consistent. The manuals are available on EPA's website at www.epa.gov/safewater/mdbp/implement.html. Additional information on ordering these manuals is provided below.

The manuals for the IESWTR include:

Disinfection Profiling and Benchmarking Guidance Manual (EPA 815-R-99-013)

Objective: To help determine if a disinfection profile (an evaluation of current disinfection practice) is required and how to do one; when a disinfection benchmark must be determined and how to extract it from the profile; and how a public water system uses the benchmark, in consultation with the state, to protect from microbial risk when the system changes disinfection practice.

Contents: The manual provides detailed information on the following subjects: applicability of the profiling and benchmarking requirements to public water systems; procedures for generating a disinfection profile, including example profiles; methods for calculating the disinfection benchmark, including example calculations; the use of the benchmark in modifying disinfection practices, communicating with the state, and assessing significant changes to disinfection practices; the development of the profiling and benchmarking regulations; the significance of the log inactivation concept and CT values for inactivations achieved by various disinfectants; and the determination of contact time.

Guidance Manual for Compliance with the Interim Enhanced Surface Water Treatment Rule: Turbidity Provisions (EPA 815-R-99-010)

Objective: The first section provides technical information regarding specific requirements of the Interim Enhanced Surface Water Treatment Rule relating to turbidity and is intended for experienced operators and others in the regulated community. The second section of the document provides background on concepts surrounding turbidity and serves as a primer for less experienced operators and individuals.

Contents: The first section contains key regulatory requirements including combined filter effluent monitoring and individual filter monitoring; recordkeeping and reporting requirements; additional compliance issues such as compliance schedule, public notification, variances/exemptions, and follow-up action requirements; approved methods and additional measurement and calibration issues; components and description of a filter self-assessment; and components and description of a Comprehensive Performance Evaluation. The second section of the manual includes more basic information on turbidity; description of the particles (both natural and man-made) which typically contribute to turbidity; discussion of typical steps in a treatment process and how turbidity is removed or created in each step; discussion of turbidity in different source waters with an emphasis of how changes in source water effect turbidity; and basic turbidimeter design.

Alternative Disinfectants and Oxidants Guidance Manual (EPA 815-R-99-014)

Objective: To provide technical data and engineering information on disinfectants and oxidants that are not as commonly used as chlorine, so that systems can evaluate their options for developing disinfection schemes to control water quality problems such as zebra mussels and Asiatic clams, and oxidation to control water quality problems associated with iron and manganese.

Contents: The manual discusses six disinfectants and oxidants: ozone, chlorine dioxide, potassium permanganate, chloramines, ozone/hydrogen peroxide combinations, and ultraviolet light. A decision tree is provided to help evaluate which disinfectant(s) is most appropriate given certain site-specific conditions (e.g., water quality conditions, existing treatment and operator skill). The manual also contains a summary of existing alternative disinfectants use in the United States and cost estimates for the use of alternative disinfectants.

Microbial and Disinfection Byproducts Simultaneous Compliance Manual (EPA 815-R-99-015)

Objective: To help public water systems achieve simultaneous compliance with various drinking water regulations (e.g., Stage 1 Disinfectants and Disinfection Byproducts Rule, Interim Enhanced Surface Water Treatment Rule, Lead and Copper Rule and the Total Coliform Rule). The manual discusses operational problems systems may encounter when implementing these rules.

Contents: The manual provides detailed information on the requirements in the Stage 1 Disinfectants and Disinfection Byproducts Rule and the Interim Enhanced Surface Water Treatment Rule.

Guidance Manual for Conducting Sanitary Surveys of Public Water Systems: Surface Water and Ground Water Under the Direct Influence (GWUDI) (EPA 815-R-99-016)

Objective: The guidance manual provides an overview of how to conduct a sanitary survey of all water systems using surface water and ground water under the direct influence of surface water. It is intended to help state agencies improve their sanitary survey programs where needed.

Contents: The manual provides information about the objective and regulatory context of sanitary surveys. It covers four principal stages of a sanitary survey: planning, including preparatory steps to be taken by inspectors before conducting the onsite portion; conducting the onsite survey; compiling a sanitary survey report; and performing follow-up activities.

Uncovered Finished Water Reservoirs (EPA 815-R-99-011)

Objective: To provide information on ways systems can limit water quality degradation in existing finished water reservoirs.

Contents: The manual provides detailed information on the following subjects: developing and implementing comprehensive open finished water reservoir management plans based on site-specific conditions; identifying potential sources of contamination in open finished water reservoirs and potential mitigation measures; employing different methods to control the degradation of water quality while it resides in the reservoir; monitoring schemes that can be used to characterize water quality and identify water quality degradation before it becomes severe and is difficult to correct.

To order copies of these guidance manuals you may contact the Safe Drinking Water Hotline at (800) 426-4791 or you may download an electronic version from the OGWDW website at:

www.epa.gov/safewater/mdbp/implement.html

Guidance manuals are also available through the National Service Center for Environmental Publications (NSCEP) (free of charge). These documents may also be purchased through National Technical Information Service (NTIS)

NSCEP: 1.800.490.9198 NTIS: 1.800.553.6847

5. Detailed regulatory requirements

Detailed descriptions of the monitoring and reporting requirements for public water systems (PWSs) are presented in the following section. The IESWTR applies only to subpart H systems that serve 10,000 or more people, with the exception of a sanitary survey provision that applies to all subpart H systems (the state or a third party conducts the sanitary survey). These systems are all required to monitor and report similar data, with the exception of turbidity exceedance reports that will be prepared as required.

Combined filter effluent turbidity monitoring

The Interim Enhanced Surface Water Treatment Rule (IESWTR) establishes a number of provisions related to the performance of filters used in drinking water treatment. These provisions include treatment technique requirements restricting turbidity levels in the combined filter effluent. These requirements are designed to decrease risk from waterborne microbial pathogens by limiting levels of particulate material in finished water. EPA has used a treatment technique because it is neither technically nor economically feasible to measure pathogens such as Giardia, Cryptosporidium, and viruses in either the source water or treated water.


Which systems must comply with turbidity requirements for the combined filter effluent under the IESWTR?

The treatment technique requirements for combined filter effluent turbidity under the IESWTR apply to public water systems (PWS) that use surface water or ground water under the direct influence of surface water (GWUDI), serve 10,000 or more people, and are required to filter.

What are the maximum allowable levels of turbidity in the combined filter effluent?

For systems using conventional filtration or direct filtration, the turbidity level of representative samples of a system's filtered water must be less than or equal to 0.3 NTU in at least 95 percent of the measurements taken each month, and must never exceed 1 NTU. For slow sand and diatomaceous earth filtration systems, requirements for turbidity levels in the combined filter effluent remain as specified under the SWTR (less than or equal to 1 NTU in 95 percent of the measurements taken each month and never greater than 5 NTU). For systems using filtration technologies other than conventional, direct, slow sand, or diatomaceous earth, the systems must demonstrate to the state, using pilot plant studies or

General Requirements (1998 IESWTR)

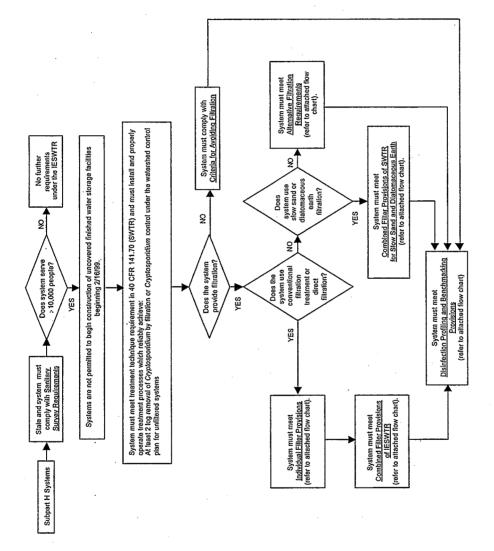

other means, that the alternative filtration technology in combination with disinfection treatment consistently achieves 99.9 percent removal and/or inactivation of Giardia lamblia cysts, 99.99 percent removal and/or inactivation of viruses, and 99 percent removal of Cryptosporidium oocysts. For each approval of an alternative filtration technology, the state will set turbidity performance requirements that the system must meet at least 95 percent of the time, and that the system may not exceed at any time, at values that consistently achieve these levels of removal and/or inactivation of Giardia lamblia, viruses, and Cryptosporidium. Failure to meet these requirements is a treatment technique violation.

What are the monitoring requirements for combined filter effluent turbidity?

Systems must monitor combined filter effluent turbidity as specified under the SWTR. This specifies that turbidity measurements must be performed on representative samples of the system's filtered water every four hours (or more frequently) that the system serves water to the public. A public water system may substitute continuous turbidity monitoring for grab sample monitoring if it validates the continuous measurement for accuracy on a regular basis using a protocol approved by the state. For any systems using slow sand filtration or filtration treatment other than conventional treatment, direct filtration, or diatomaceous earth filtration, the state may reduce the sampling frequency to once per day if it determines that less frequent monitoring is sufficient to indicate effective filtration performance. Turbidity must be measured using methods approved by EPA and by a party approved by the state. A system that uses lime softening may acidify representative samples prior to analysis using a protocol approved by the state. Failure to meet these requirements is a monitoring violation.


What are the reporting and recordkeeping requirements for turbidity in the combined filter effluent?

The reporting requirements for combined filter effluent turbidity are unchanged from those established under the SWTR, except where reporting levels have been modified to reflect more stringent turbidity requirements established under the IESWTR. Required turbidity measurements must be reported within 10 days after the end of each month the system serves water to the public. Information that must be reported includes: 1) the total number of filtered water turbidity measurements taken during the month; 2) the number and percentage of filtered water turbidity measurements taken during the month which are less than or equal to the turbidity limits established under the SWTR for diatomaceous earth and slow sand filtration systems, and under the IESWTR for conventional, direct, and alternative filtration systems; and 3) the date and value of any turbidity measurements taken during the month which exceed 1 NTU for conventional and direct filtration systems, 5 NTU for slow sand and diatomaceous earth filtration systems, and the maximum level established by the state for alternative filtration technology systems. Failure to meet these requirements is a reporting/recordkeeping violation.


IESWTR COMBINED FILTER EFFLUENT TURBIDITY COMPLIANCE REQUIREMENTS

FILTRATION TECHNOLOGY	95th PERCENTILE TURBIDITY (NTU)	MAXIMUM TURBIDITY (NTU)
Conventional filtration	0.3	1
Direct filtration	0.3	1
Diatomaceous earth filtration	1	5
Slow sand filtration	1	5
Filtration technologies not listed above	as determined by the state	as determined by the state


Combined Filter Effluent Provisions of IESWTR (Applicable to Conventional and Direct Filtration Systems)

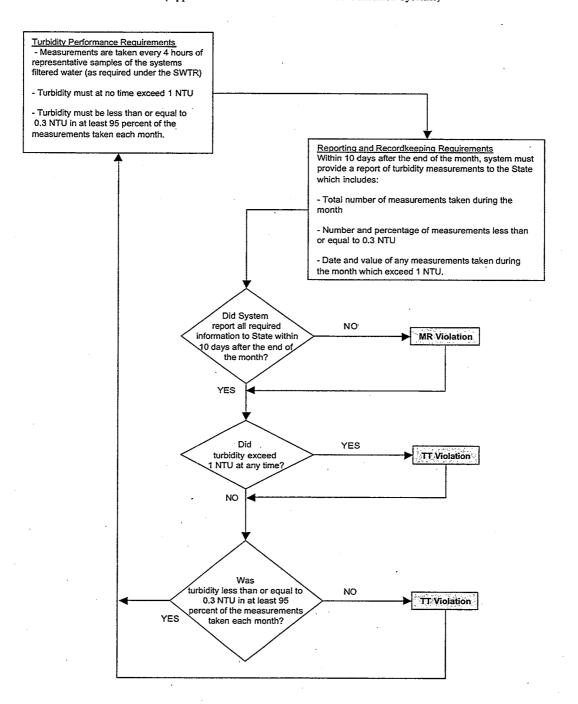

Alternative Filtration Requirements of the IESWTR (Filtration Technologies other than conventional, direct, slow sand or diatomaceous earth)

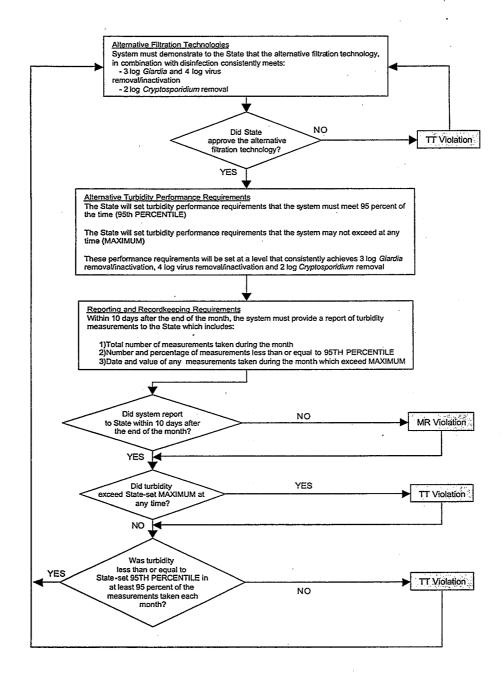

Combined Filter Effluent Provisions of SWTR (Applicable to Systems using Slow Sand and Diatomaceous Earth Filtration)

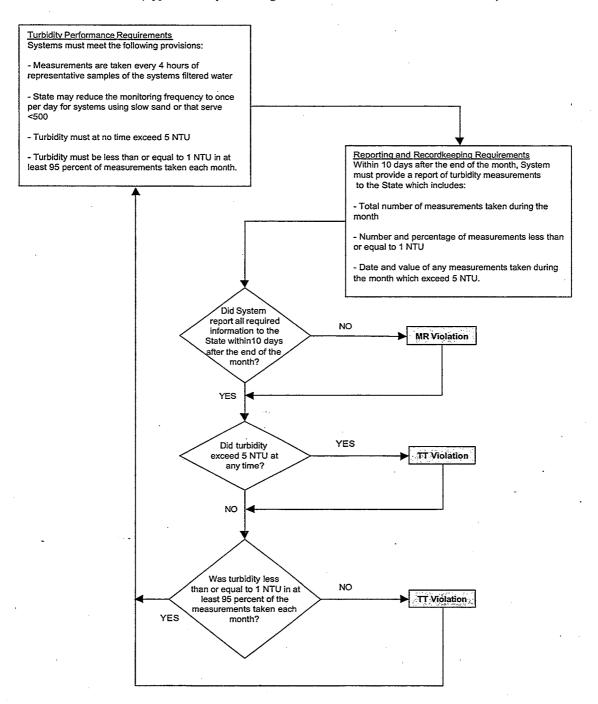

Individual filter turbidity monitoring

The IESWTR establishes a number of requirements related to the performance of filters used in drinking water treatment. Included in these requirements are provisions mandating that certain systems monitor the effluent of individual filters. These provisions are designed to decrease the risk of microbial pathogen contamination of finished waters by focusing greater attention on the performance of individual filters.

Which systems are required to monitor individual filters?

The filtration requirements of the IESWTR apply to PWSs that use surface water or GWUDI, serve 10,000 or more people, and are required to filter. Systems that provide conventional or direct filtration treatment must monitor individual filters.

What are the monitoring requirements for individual filters?

Systems must continuously measure the effluent turbidity of each individual filter using a method approved by EPA, and must record the results every 15 minutes. If there is a failure in the continuous turbidity monitoring equipment, the system must conduct grab sampling every four hours in lieu of continuous monitoring until the turbidimeter is repaired or replaced, and is in violation if the turbidimeter is not replaced or repaired within five working days following the failure of the equipment. Failure to comply with these requirements is a monitoring violation.

What are the reporting and recordkeeping requirements for individual filter monitoring? Systems required to monitor individual filters must maintain the results of this monitoring for at least 3 years. Within 10 days after the end of each month, these systems must make a report to the state that they have conducted individual filter turbidity monitoring. Systems must report individual filter turbidity measurements only if the measurements demonstrate any of the following four exceedance conditions:


- Any individual filter that has a measured turbidity level of greater than 1.0 NTU in two consecutive measurements taken 15 minutes apart. The system must report the filter number, the turbidity measurement, and the date(s) on which the exceedance occurred. The system must also either identify and report an obvious reason for the exceedance or produce a filter profile for the filter within 7 days of the exceedance and report that the profile has been produced. (A filter profile is a graphical representation of turbidity or total particle counts as a function of time for an entire filter run. A discussion of filter profiles is included in EPA's guidance document on turbidity.)
- Any individual filter that has a measured turbidity level of greater than 0.5 NTU in two consecutive measurements taken 15 minutes apart at the end of the first four hours of continuous filter operation after the filter has been backwashed or otherwise taken offline. The system must report the filter number, the turbidity measurement, and the date(s) on which the exceedance occurred. The system must also either identify and report an obvious reason for the exceedance or produce a filter profile for the filter within 7 days of the exceedance and report that the profile has been produced. (A filter profile is a graphical representation of turbidity or total particle counts as a function of time for an entire filter run. A discussion of filter profiles is included in EPA's guidance document on turbidity.)
- Any individual filter that has a measured turbidity level of greater than 1.0 NTU in two consecutive measurements taken 15 minutes apart at any time in each of three consecutive months. The system must report the filter number, the turbidity measurement, and the date(s) on which the exceedance occurred. The system must conduct a self-assessment of the filter within 14 days of the exceedance and report that

the self-assessment was conducted in the monthly report. The self-assessment must consist of at least the following components: assessment of filter performance, development of a filter profile, identification and prioritization of factors limiting filter performance, assessment of the applicability of corrections, and preparation of a filter self-assessment report.

Any individual filter that has a measured turbidity level greater than 2.0 NTU in two consecutive measurements taken 15 minutes apart at any time in each of two consecutive months. The system must report the filter number, the turbidity measurement, and the date(s) on which the exceedance occurred. The system must arrange for the conduct of a comprehensive performance evaluation (CPE) by the state or a third part approved by the state no later than 30 days following the exceedance. (A CPE is a thorough review and analysis of a treatment plant's performance-based capabilities and associated administrative, operation and maintenance practices.) The CPE must be completed and submitted to the state no later than 90 days following the exceedance.

The turbidity guidance manual has detailed information about filter profiling, filter self-assessments, and CPEs. Systems using lime softening may apply to the state for alternative exceedance levels to those specified above if they can demonstrate that higher turbidity levels in individual filters are due to lime carryover only and not due to degraded filter performance.

Failure to comply with these requirements is a reporting violation. However, the exceedance criteria are not treatment technique requirements, and systems have not committed a violation solely by demonstrating any of the exceedance conditions in their individual filters.

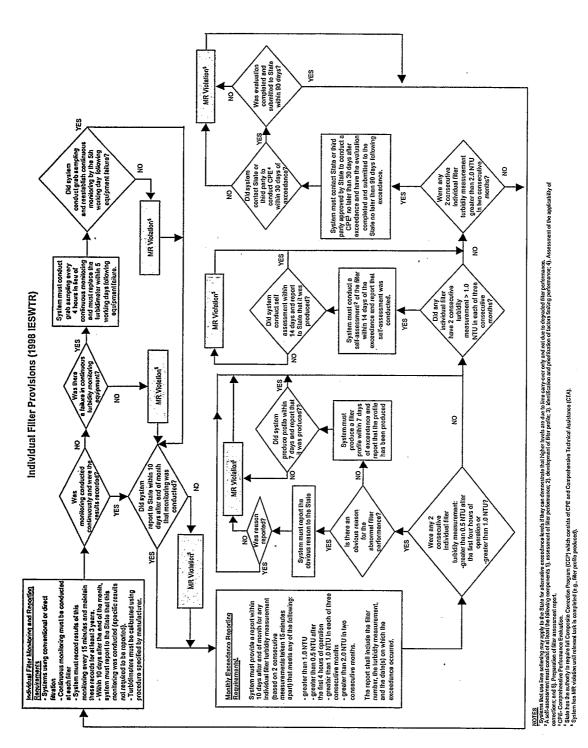

What ROUTINE MONITORING must I conduct under the IESWTR?

What do I have to REPORT to the State?

IMPORTANT: The information in the table below *does not* include the requirements for determining profiling applicability, disinfection profiling, and disinfection benchmarking. Please refer to the section on Disinfection Benchmarking for these monitoring and sampling requirements.

Requirement
All systems must continue to monitor the combined filter effluent at the same location and frequency as under the SWTR.
 All systems using conventional filtration treatment or direct filtration must conduct continuous turbidity monitoring for each individual filter using an approved method and Individual must calibrate turbidimeters using the procedure specified by the manufacturer. Systems must record the results of individual filter monitoring every 15 minutes. If there is a failure in the continuous turbidity monitoring equipment, the system must conduct grab sampling every 4 hours in lieu of continuous monitoring.
• For any individual filter that has a measured turbidity level of greater than 1.0 NTU in 2 consecutive measurements taken 15 minutes apart, the system must report the filter number, turbidity measurement, and date of exceedance. The system must produce a filter profile for the filter within 7 days of the exceedance and report that the profile has been produced or report the obvious reason for the exceedance.
• For any individual filter that has a measured turbidity level of greater than 0.5 NTU in 2 consecutive measurements taken 15 minutes apart after the first 4 hours of operation after the filter has been backwashed or otherwise taken offline, the system must report the filter number, turbidity measurement, and date of exceedance. The system must produce a filter profile for the filter within 7 days of the exceedance and report that the profile has been produced or report the obvious reason for the exceedance.
• For any individual filter that has a measured turbidity level of greater than 1.0 NTU in 2 consecutive measurements taken 15 minutes apart in each of 3 consecutive months, the system must report the filter number, turbidity measurement, and date of exceedance. The system must conduct a self-assessment of the filter within 14 days of the exceedance and report that the self-assessment was conducted.
 For any individual filter that has a measured turbidity level of greater than 2.0 NTU in 2 consecutive measurements taken 15 minutes apart in 2 consecutive months, the system must report the filter number, turbidity measurement, and date of exceedance. The system must contact the state or 3rd party to conduct a CPE no later than 30 days following the exceedance and have the evaluation completed and submitted to the state no later than 90 days following the exceedance.
 Individual Filter Data Results of individual filter monitoring must be maintained for at least 3 years. Individual filter data must be reported only if there has been a turbidity exceedance Combined Filter Effluent Data Reporting Total number of combined filter effluent turbidity measurements taken during last month that do not exceed the turbidity limits. Date and value of any turbidity measurements taken during the month that exceed 1 NTU for systems using conventional or direct filtration. Turbidity measurements must be reported within 10 days after the end of each month the

Disinfection profiling and benchmarking

The Interim Enhanced Surface Water Treatment Rule (IESWTR) establishes disinfection benchmarking as a procedure requiring certain public water systems (PWSs) to evaluate the impact on microbial risk of proposed changes in disinfection practice. It is designed to help utilities and states work together to assure that pathogen control is maintained while the provisions of the Stage 1 Disinfectants and Disinfection Byproducts Rule (Stage 1 DBPR) are implemented. This procedure involves a PWS charting daily levels of pathogen inactivation for a period of at least one year to create a profile of inactivation performance. The PWS then uses this profile to determine a baseline or benchmark of inactivation against which proposed changes in disinfection practices can be measured. Profiling and benchmarking is explained in detail in the Disinfection Profiling and Benchmarking Guidance Manual.

Who is required to prepare a disinfection profile?

Surface water or GWUDI systems having average annual TTHM ≥ 0.064 mg/L or annual average HAA5 ≥ 0.048 mg/L as a result of data or specific monitoring conducted by March 31, 2000 must develop a disinfection profile. These levels, equal to 80% of the MCLs established for these compounds by the Stage 1 DBPR, are intended to include most systems that will modify their disinfection practices to comply with the Stage 1 DBPR. To determine applicability, systems that collected TTHM and HAA5 data under the ICR must use the results of the last 12 months of ICR monitoring unless the state determines there is a more representative data set. Non ICR systems may either use existing TTHM and HAA5 data, if approved by the state, or must conduct TTHM and HAA5 monitoring for four quarters. This monitoring must be completed before April 2000. Alternatively, systems can elect to forgo this monitoring if they construct a disinfection profile.


How are the disinfection profile and benchmark developed?

A disinfection profile consists of a compilation of daily Giardia lamblia log inactivations (plus virus inactivations for systems using either chloramines or ozone for primary disinfection) computed over a period of at least one year through the entire treatment plant. It is based on daily measurements of disinfectant residual concentration(s), contact time(s), temperature, and pH. A system with more than one point of disinfection application must conduct this monitoring for each disinfection segment. The profile may also be developed using up to 3 years of existing (i.e. grandfathered) data if the state finds the data acceptable. Systems having less than 3 years of acceptable grandfathered data are required to conduct one year of monitoring to create the profile. This monitoring must be completed by April 2001. The disinfection benchmark is equal to the lowest monthly average inactivation level in the disinfection profile (or average of low months for multi-year profiles).

How are the disinfection profile and benchmark used?

Any system required to develop a disinfection profile under the IESWTR that decides to make a significant change to its disinfection practice must calculate its benchmark and consult with the state prior to and only if making a significant change. Significant changes in disinfection practice are defined as: 1) changes to the point of disinfection; 2) changes to the disinfectant(s) used in the treatment plant; 3) changes to the disinfection process; and 4) any other modification identified by the state. As part of the consultation process, the system must submit to the state the following information: a description of the proposed change; the disinfection profile for *Giardia lamblia* (and, if necessary, viruses) and benchmark; and an analysis of how the proposed change will affect the current levels of disinfection. In addition, the state is required to review the disinfection profile as part of its periodic sanitary survey.

Disinfection Profiling and Benchmarking Provisions (1998 IESWTR)

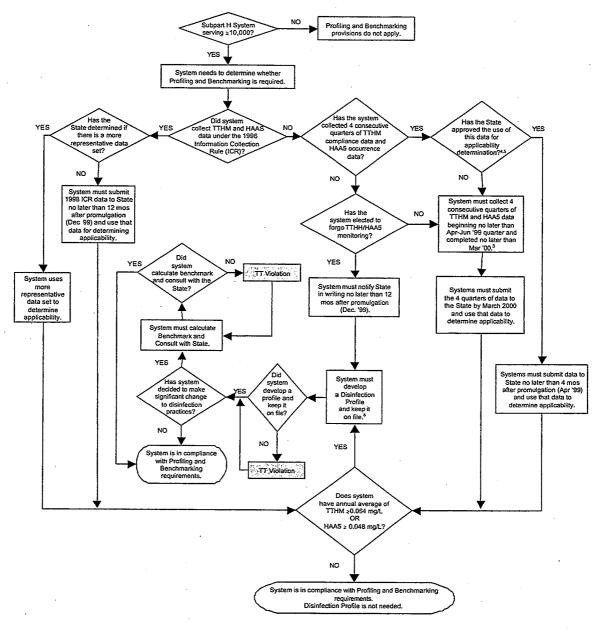

NOTES

*TTHM and HAA5 averages must be taken from same time period.

*Any lab approved under the ICR or using ICR-approved methods may conduct HAA5 analyses.

*TTHM and HAA5 monitoring must meet same sampling number and location requirements as TTHM in 141.12 and 141.30; and same handling and analytical requirements as the ICR in 141.142(b)(1).

*System must conduct HAA5 monitoring until state approves of the existing data.

*State may also require a more representative data set.

*Chisinfection Profile must be kept on file for State to review during Sanitary Survey.

This page is left intentionally blank.

Appendix E

IESWTR Rule Language

This appendix contains the rule language for the IESWTR incorporating the technical amendments. Changes to the original rule language are shown as highlighted text. A complete electronic copy of the IESWTR including preamble as published on December 16, 1998, can be found on the EPA web site at www.epa.gov/ogwdw/mdbp/ieswtrfr.html. A complete electronic copy of the technical amendments for the IESWTR and Stage 1 DBPR, including preamble as published on January 16, 2001, can be found on the EPA website at www.epa.gov/safewater/mdbp/iesfr.html.

This page is left intentionally blank.

For the reasons set out in the preamble, title 40 chapter I of the Code of Federal Regulations is amended as follows:

PART 9 – [AMENDED]

1. The authority citation for part 9 continues to read as follows:

Authority: 7 U.S.C. 135 et seq., 136-136y; 15 U.S.C. 2001, 2003, 2005, 2006, 2601-2671; 21 U.S.C. 331j, 346a, 348; 31 U.S.C. 9701; 33 U.S.C. 1251 et seq., 1311, 1313d, 1314, 1318, 1321, 1326, 1330, 1342, 1344, 1345 (d) and (e), 1361; E.O. 11735, 38 FR 21243, 3 CFR, 1971-1975 Comp. p. 973; 42 U.S.C. 241, 242b, 243, 246, 300f, 300g, 300g-1, 300g-2, 300g-3, 300g-4, 300g-5, 300g-6, 300j-1, 300j-2, 300j-3, 300j-4, 300j-9, 1857 et seq., 6901-6992k, 7401-7671q, 7542, 9601-9657, 11023, 11048.

2. Section 9.1 is amended by adding the new entries to the table to read as follows:

§9.1 OMB approvals under the Paperwork Reduction Act.

40 CI	R Citati	ion	OMB Co	ontrol N	<u>o.</u>

National Primary Drinking Water Regulations

*	*	*	*	*
141.	170		2040	-0205
141.	172		2040	-0205
141.	174		2040	-0205
141.1	174 (a) -	(b)	2040	-0205
141.	175		2040	-0205
141.	175 (a) -	<i>(b)</i>	2040	-0205
141.1	175 (c)		2040	-0090
*	*	*	*	*

PART 141 - National Primary Drinking Water Regulations

- 3. The authority citation for part 141 continues to read as follows:
 Authority: 42 U.S.C. 300f, 300g-1, 300g-2, 300g-3, 300g-4, 300g-5, 300g-6, 300j-4, 300j-9.
- Authority: 42 U.S.C. 300f, 300g-1, 300g-2, 300g-3, 300g-4, 300g-5, 300g-6, 300j-4, 300j-9, and 300j-11.
- 4. Section 141.2 is amended by revising the definition of "ground water under the direct influence of surface water" and adding the following definitions in alphabetical order to read as follows:

§141.2 Definitions.

Comprehensive performance evaluation (CPE) is a thorough review and analysis of a treatment plant's performance-based capabilities and associated administrative, operation and maintenance practices. It is conducted to identify factors that may be adversely impacting a plant's capability to achieve compliance and emphasizes approaches that can be implemented without significant capital improvements. For purposes of compliance with subpart P of this part, the comprehensive performance evaluation must consist of at least the following components: assessment of plant performance; evaluation of major unit processes; identification and prioritization of performance limiting factors; assessment of the applicability of comprehensive technical assistance; and preparation of a CPE report.

<u>Disinfection profile</u> is a summary of daily <u>Giardia lamblia</u> inactivation through the treatment plant. The procedure for developing a disinfection profile is contained in §141.172.

This page is left intentionally blank.

IESWTR Implementation Guidance

June 2001

§141.71 Criteria for avoiding filtration.

- (b) ***
- (6) The public water system must comply with the requirements for trihalomethanes in §§141.12 and 141.30 until December 31, 2001. After December 31, 2001, the system must comply with the requirements for total trihalomethanes, haloacetic acids (five), bromate, chlorine, chlorine, chlorine, chlorine dioxide in subpart L.
- 9. Section 141.73 is amended by adding paragraph (a)(3) and revising paragraph (d) to read as follows:

§141.73 Filtration.

(a) ***

- (3) Beginning January 1, 2002, systems serving at least 10,000 people must meet the turbidity requirements in §141.173(a).
- (d) Other filtration technologies. A public water system may use a filtration technology not listed in paragraphs (a) through (c) of this section if it demonstrates to the State, using pilot plant studies or other means, that the alternative filtration technology, in combination with disinfection treatment that meets the requirements of §141.72(b), consistently achieves 99.9 percent removal and/or inactivation of Giardia lamblia cysts and 99.99 percent removal and/or inactivation of viruses. For a system that makes this demonstration, the requirements of paragraph (b) of this section apply. Beginning January 1, 2002, systems serving at least 10,000 people must meet the requirements for other filtration technologies in §141.173(b).
- 10. Section 141.153 is amended by revising paragraph (d)(4)(v)(C) to read as follows:

§141.153 Content of the reports.

(d) ****

- (4) ****(v) ***
- (C) When it is reported pursuant to §§141.73 or 141.173: the highest single measurement and the lowest monthly percentage of samples meeting the turbidity limits specified in §§141.73 or 141.173 for the filtration technology being used. ***
- 11. Part 141 is amended by adding a new subpart P to read as follows:

Subpart P-Enhanced Filtration and Disinfection

Sec.	
141.170	General requirements.
141.171	Criteria for avoiding filtration.
141.172	Disinfection profiling and benchmarking.
141.173	Filtration.
141.174	Filtration sampling requirements.
141.175	Reporting and recordkeeping requirements.

§141.170 General requirements.

(a) The requirements of subpart P constitute national primary drinking water regulations. These regulations establish requirements for filtration and disinfection that are in addition to criteria under which filtration and

disinfection is required under subpart H. The requirements of this subpart are applicable to subpart H systems serving at least 10,000 people, beginning January 1, 2002 unless otherwise specified in this subpart. The regulations in this subpart establish or extend treatment technique requirements in lieu of maximum contaminant levels for the following contaminants: Giardia lamblia, viruses, heterotrophic plate count bacteria, Legionella, Cryptosporidium, and turbidity. Each subpart H system serving at least 10,000 people must provide treatment of its source water that complies with these treatment technique requirements and are in addition to those identified in §141.70. The treatment technique requirements consist of installing and properly operating water treatment processes which reliably achieve:

- (1) At least 99 percent (2-log) removal of <u>Cryptosporidium</u> between a point where the raw water is not subject to recontamination by surface water runoff and a point downstream before or at the first customer for filtered systems, or Cryptosporidium control under the watershed control plan for unfiltered systems.
- (2) Compliance with the profiling and benchmark requirements under the provisions of §141.172.
- (b) A public water system subject to the requirements of this subpart is considered to be in compliance with the requirements of paragraph (a) of this section if:
- (1) It meets the requirements for avoiding filtration in §§141.71 and 141.171 and the disinfection requirements in §§141.72 and 141.172; or
- (2) It meets the applicable filtration requirements in either §141.173 or §141.73 and the disinfection requirements in §§141.72 and 141.172.
- (c) Systems are not permitted to begin construction of uncovered finished water storage facilities beginning February 16, 1999.

§141.171 Criteria for avoiding filtration.

In addition to the requirements of §141.71, a public water system subject to the requirements of this subpart that does not provide filtration must meet all of the conditions of paragraphs (a) and (b) of this section.

- (a) <u>Site-specific conditions</u>. In addition to site-specific conditions in §141.71(b), systems must maintain the watershed control program under §141.71(b)(2) to minimize the potential for contamination by <u>Cryptosporidium</u> oocysts in the source water. The watershed control program must, for <u>Cryptosporidium</u>:
- (1) Identify watershed characteristics and activities which may have an adverse effect on source water quality; and
- (2) Monitor the occurrence of activities which may have an adverse effect on source water quality.
- (b) During the onsite inspection conducted under the provisions of §141.71(b)(3), the State must determine whether the watershed control program established under §141.71(b)(2) is adequate to limit potential contamination by <u>Cryptosporidium</u> oocysts. The adequacy of the program must be based on the comprehensiveness of the watershed review; the effectiveness of the system's program to monitor and control detrimental activities occurring in the watershed; and the extent to which the water system has maximized land ownership and/or controlled land use within the watershed.

§141.172 Disinfection profiling and benchmarking.

- (a) <u>Determination of systems required to profile</u>. A public water system subject to the requirements of this subpart must determine its TTHM annual average using the procedure in paragraph (a)(1) of this section and its HAA5 annual average using the procedure in paragraph (a)(2) of this section. The annual average is the arithmetic average of the quarterly averages of four consecutive quarters of monitoring.
- (1) The TTHM annual average must be the annual average during the same period as is used for the HAA5 annual average.
- (i) Those systems that collected data under the provisions of subpart M (Information Collection Rule) must use the results of the samples collected during the last four quarters of required monitoring under §141.142.
- (ii) Those systems that use "grandfathered" HAA5 occurrence data that meet the provisions of paragraph (a)(2)(ii) of this section must use TTHM data collected at the same time under the provisions of §§141.12 and 141.30.
- (iii) Those systems that use HAA5 occurrence data that meet the provisions of paragraph (a)(2)(iii)(A) of this section must use TTHM data collected at the same time under the provisions of §§141.12 and 141.30.

- (2) The HAA5 annual average must be the annual average during the same period as is used for the TTHM annual average.
- (i) Those systems that collected data under the provisions of subpart M (Information Collection Rule) must use the results of the samples collected during the last four quarters of required monitoring under §141.142.
- (ii) Those systems that have collected four quarters of HAA5 occurrence data that meets the routine monitoring sample number and location requirements for TTHM in §§141.12 and 141.30 and handling and analytical method requirements of §141.142(b)(1) may use those data to determine whether the requirements of this section apply.
- (iii) Those systems that have not collected four quarters of HAA5 occurrence data that meets the provisions of either paragraph (a)(2)(i) or (ii) of this section by March 16, 1999 must either:
- (A) Conduct monitoring for HAA5 that meets the routine monitoring sample number and location requirements for TTHM in §§141.12 and 141.30 and handling and analytical method requirements of §141.142(b)(1) to determine the HAA5 annual average and whether the requirements of paragraph (b) of this section apply. This monitoring must be completed so that the applicability determination can be made no later than March 31, 2000, or
- (B) Comply with all other provisions of this section as if the HAA5 monitoring had been conducted and the results required compliance with paragraph (b) of this section.
- (3) The system may request that the State approve a more representative annual data set than the data set determined under paragraph (a)(1) or (2) of this section for the purpose of determining applicability of the requirements of this section.
- (4) The State may require that a system use a more representative annual data set than the data set determined under paragraph (a)(1) or (2) of this section for the purpose of determining applicability of the requirements of this section.
- (5) The system must submit data to the State on the schedule in paragraphs (a)(5)(i) through (v) of this section.
- (i) Those systems that collected TTHM and HAA5 data under the provisions of subpart M (Information Collection Rule), as required by paragraphs (a)(1)(i) and (a)(2)(i) of this section, must submit the results of the samples collected during the last 12 months of required monitoring under §141.142 not later than December 31,1999.
- (ii) Those systems that have collected four consecutive quarters of HAA5 occurrence data that meets the routine monitoring sample number and location for TTHM in §§141.12 and 141.30 and handling and analytical method requirements of §141.142(b)(1), as allowed by paragraphs (a)(1)(ii) and (a)(2)(ii) of this section, must submit those data to the State not later April 16, 1999. Until the State has approved the data, the system must conduct monitoring for HAA5 using the monitoring requirements specified under paragraph (a)(2)(iii) of this section.
- (iii) Those systems that conduct monitoring for HAA5 using the monitoring requirements specified by paragraphs (a)(1)(iii) and (a)(2)(iii)(A) of this section, must submit TTHM and HAA5 data not later than April 1, 2000.
- (iv) Those systems that elect to comply with all other provisions of this section as if the HAA5 monitoring had been conducted and the results required compliance with this section, as allowed under paragraphs (a)(2)(iii)(B) of this section, must notify the State in writing of their election not later than December 31, 1999.
- (v) If the system elects to request that the State approve a more representative annual data set than the data set determined under paragraph (a)(2)(i) of this section, the system must submit this request in writing not later than December 31, 1999.
- (6) Any system having either a TTHM annual average ≥0.064 mg/L or an HAA5 annual average ≥0.048 mg/L during the period identified in paragraphs (a)(1) and (2) of this section must comply with paragraph (b) of this section.
- (b) <u>Disinfection profiling.</u> (1) Any system that meets the criteria in paragraph (a)(6) of this section must develop a disinfection profile of its disinfection practice for a period of up to three years.
- (2) The system must monitor daily for a period of 12 consecutive calendar months to determine the total logs of inactivation for each day of operation, based on the CT99.9 values in Tables 1.1-1.6, 2.1, and 3.1 of

- §141.74(b), as appropriate, through the entire treatment plant. This system must begin this monitoring not later than April 1, 2000. As a minimum, the system with a single point of disinfectant application prior to entrance to the distribution system must conduct the monitoring in paragraphs (b)(2)(i) through (iv) of this section. A system with more than one point of disinfectant application must conduct the monitoring in paragraphs (b)(2)(i) through (iv) of this section for each disinfection segment. The system must monitor the parameters necessary to determine the total inactivation ratio, using analytical methods in §141.74(a), as follows:
- (i) The temperature of the disinfected water must be measured once per day at each residual disinfectant concentration sampling point during peak hourly flow.
- (ii) If the system uses chlorine, the pH of the disinfected water must be measured once per day at each chlorine residual disinfectant concentration sampling point during peak hourly flow.
- (iii) The disinfectant contact time(s) (``T") must be determined for each day during peak hourly flow.
- (iv) The residual disinfectant concentration(s) ('C") of the water before or at the first customer and prior to each additional point of disinfection must be measured each day during peak hourly flow.
- (3) In lieu of the monitoring conducted under the provisions of paragraph (b)(2) of this section to develop the disinfection profile, the system may elect to meet the requirements of paragraph (b)(3)(i) of this section. In addition to the monitoring conducted under the provisions of paragraph (b)(2) of this section to develop the disinfection profile, the system may elect to meet the requirements of paragraph (b)(3)(ii) of this section.
- (i) A PWS that has three years of existing operational data may submit those data, a profile generated using those data, and a request that the State approve use of those data in lieu of monitoring under the provisions of paragraph (b)(2) of this section not later than March 31, 2000. The State must determine whether these operational data are substantially equivalent to data collected under the provisions of paragraph (b)(2) of this section. These data must also be representative of Giardia lamblia inactivation through the entire treatment plant and not just of certain treatment segments. Until the State approves this request, the system is required to conduct monitoring under the provisions of paragraph (b)(2) of this section.
- (ii) In addition to the disinfection profile generated under paragraph (b)(2) of this section, a PWS that has existing operational data may use those data to develop a disinfection profile for additional years. Such systems may use these additional yearly disinfection profiles to develop a benchmark under the provisions of paragraph (c) of this section. The State must determine whether these operational data are substantially equivalent to data collected under the provisions of paragraph (b)(2) of this section. These data must also be representative of inactivation through the entire treatment plant and not just of certain treatment segments.
- (4) The system must calculate the total inactivation ratio as follows:
- (i) If the system uses only one point of disinfectant application, the system may determine the total inactivation ratio for the disinfection segment based on either of the methods in paragraph (b)(4)(i)(A) or (b)(4)(i)(B) of this section.
- (A) Determine one inactivation ratio (CTcalc/CT_{99,9}) before or at the first customer during peak hourly flow.
- (B) Determine successive $CTcalc/CT_{99.9}$ values, representing sequential inactivation ratios, between the point of disinfectant application and a point before or at the first customer during peak hourly flow. Under this alternative, the system must calculate the total inactivation ratio by determining $(CTcalc/CT_{99.9})$ for each sequence and then adding the $(CTcalc/CT_{99.9})$ values together to determine $(O(CTcalc/CT_{99.9}))$.
- (ii) If the system uses more than one point of disinfectant application before the first customer, the system must determine the CT value of each disinfection segment immediately prior to the next point of disinfectant application, or for the final segment, before or at the first customer, during peak hourly flow. The (CTcalc/CT_{99,9}) value of each segment and (C (CTcalc/CT_{99,9})) must be calculated using the method in paragraph (b)(4)(i) of this section.
- (iii) The system must determine the total logs of inactivation by multiplying the value calculated in paragraph (b)(4)(i) or (ii) of this section by 3.0.
- (5) A system that uses either chloramines or ozone for primary disinfection must also calculate the logs of inactivation for viruses using a method approved by the State.
- (6) The system must retain disinfection profile data in graphic form, as a spreadsheet, or in some other format acceptable to the State for review as part of sanitary surveys conducted by the State.

- (c) Disinfection Benchmarking
- (1) Any system required to develop a disinfection profile under the provisions of paragraphs (a) and (b) of this section and that decides to make a significant change to its disinfection practice must consult with the State prior to making such change. Significant changes to disinfection practice are:
- (i) Changes to the point of disinfection;
- (ii) Changes to the disinfectant(s) used in the treatment plant;
- (iii) Changes to the disinfection process; and
- (iv) Any other modification identified by the State.
- (2) Any system that is modifying its disinfection practice must calculate its disinfection benchmark using the procedure specified in paragraphs (c)(2)(i) through (ii) of this section.
- (i) For each year of profiling data collected and calculated under paragraph (b) of this section, the system must determine the lowest average monthly <u>Giardia lamblia</u> inactivation in each year of profiling data. The system must determine the average <u>Giardia lamblia</u> inactivation for each calendar month for each year of profiling data by dividing the sum of daily <u>Giardia lamblia</u> of inactivation by the number of values calculated for that month.
- (ii) The disinfection benchmark is the lowest monthly average value (for systems with one year of profiling data) or average of lowest monthly average values (for systems with more than one year of profiling data) of the monthly logs of <u>Giardia lamblia</u> inactivation in each year of profiling data.
- (3) A system that uses either chloramines or ozone for primary disinfection must also calculate the disinfection benchmark for viruses using a method approved by the State.
- (4) The system must submit information in paragraphs (c)(4)(i) through (iii) of this section to the State as part of its consultation process.
- (i) A description of the proposed change;
- (ii) The disinfection profile for <u>Giardia lamblia</u> (and, if necessary, viruses) under paragraph (b) of this section and benchmark as required by paragraph (c)(2) of this section; and
- (iii) An analysis of how the proposed change will affect the current levels of disinfection.

§141.173 Filtration.

A public water system subject to the requirements of this subpart that does not meet all of the criteria in this subpart and subpart H for avoiding filtration must provide treatment consisting of both disinfection, as specified in §141.72(b), and filtration treatment which complies with the requirements of paragraph (a) or (b) of this section or §141.73 (b) or (c) by December 31,2001.

(a) Conventional filtration treatment or direct filtration.

- (1) For systems using conventional filtration or direct filtration, the turbidity level of representative samples of a system's filtered water must be less than or equal to 0.3 NTU in at least 95 percent of the measurements taken each month, measured as specified in §141.74(a) and (c).
- (2) The turbidity level of representative samples of a system's filtered water must at no time exceed 1 NTU, measured as specified in §141.74(a) and (c).

(3) A system that uses lime softening may acidify representative samples prior to analysis using a protocol approved by the State.

(b) Filtration technologies other than conventional filtration treatment, direct filtration, slow sand filtration, or diatomaceous earth filtration. A public water system may use a filtration technology not listed in paragraph (a) of this section or in §141.73(b) or (c) if it demonstrates to the State, using pilot plant studies or other means, that the alternative filtration technology, in combination with disinfection treatment that meets the requirements of §141.72(b), consistently achieves 99.9 percent removal and/or inactivation of Giardia lamblia cysts and 99.99 percent removal and/or inactivation of viruses, and 99 percent removal of Cryptosporidium oocysts, and the State approves the use of the filtration technology. For each approval, the State will set turbidity performance requirements that the system must meet at least 95 percent of the time and that the system may not exceed at any time at a level that consistently achieves 99.9 percent removal and/or inactivation of Giardia lamblia cysts, 99.99 percent removal and/or inactivation of viruses, and 99 percent removal of Cryptosporidium oocysts.

§141.174 Filtration sampling requirements.

- (a) Monitoring requirements for systems using filtration treatment. In addition to monitoring required by §141.74, a public water system subject to the requirements of this subpart that provides conventional filtration treatment or direct filtration must conduct continuous monitoring of turbidity for each individual filter using an approved method in §141.74(a) and must calibrate turbidimeters using the procedure specified by the manufacturer. Systems must record the results of individual filter monitoring every 15 minutes.
- (b) If there is a failure in the continuous turbidity monitoring equipment, the system must conduct grab sampling every four hours in lieu of continuous monitoring, but for no more than five working days following the failure of the equipment.

§141.175 Reporting and recordkeeping requirements.

In addition to the reporting and recordkeeping requirements in §141.75, a public water system subject to the requirements of this subpart that provides conventional filtration treatment or direct filtration must report monthly to the State the information specified in paragraphs (a) and (b) of this section beginning January 1, 2002. In addition to the reporting and recordkeeping requirements in §141.75, a public water system subject to the requirements of this subpart that provides filtration approved under §141.173(b) must report monthly to the State the information specified in paragraphs (a) of this section beginning January 1, 2002. The reporting in paragraph (a) of this section is in lieu of the reporting specified in §141.75(b)(1).

- (a) Turbidity measurements as required by §141.173 must be reported within 10 days after the end of each month the system serves water to the public. Information that must be reported includes:
- (1) The total number of filtered water turbidity measurements taken during the month.
- (2) The number and percentage of filtered water turbidity measurements taken during the month which are less than or equal to the turbidity limits specified in §141.173(a) or (b).
- (3) The date and value of any turbidity measurements taken during the month which exceed 1 NTU for systems using conventional filtration treatment or direct filtration, or which exceed the maximum level set by the State under §141.173(b).

- (b) Systems must maintain the results of individual filter monitoring taken under §141.174 of this subpart for at least three years. Systems must report that they have conducted individual filter turbidity monitoring under §141.174 of this subpart within 10 days after the end of each month the system serves water to the public. Systems must report individual filter turbidity measurement results taken under §141.174 of this subpart within 10 days after the end of each month the system serves water to the public only if measurements demonstrate one or more of the conditions in paragraphs (b)(1) through (4) of this section. Systems that use lime softening may apply to the State for alternative exceedance levels for the levels specified in paragraphs (b)(1) through (4) of this section if they can demonstrate that higher turbidity levels in individual filters are due to lime carryover only and not due to degraded filter performance.
- (1) For any individual filter that has a measured turbidity level of greater than 1.0 NTU in two consecutive measurements taken 15 minutes apart, the system must report the filter number, the turbidity measurement, and the date(s) on which the exceedance occurred. In addition, the system must either produce a filter profile for the filter within 7 days of the exceedance (if the system is not able to identify an obvious reason for the abnormal filter performance) and report that the profile has been produced or report the obvious reason for the exceedance.
- (2) For any individual filter that has a measured turbidity level of greater than 0.5 NTU in two consecutive measurements taken 15 minutes apart at the end of the first four hours of continuous filter operation after the filter has been backwashed or otherwise taken offline, the system must report the filter number, the turbidity, and the date(s) on which the exceedance occurred. In addition, the system must either produce a filter profile for the filter within 7 days of the exceedance (if the system is not able to identify an obvious reason for the abnormal filter performance) and report that the profile has been produced or report the obvious reason for the exceedance.
- (3) For any individual filter that has a measured turbidity level of greater than 1.0 NTU in two consecutive measurements taken 15 minutes apart at any time in each of three consecutive months, the system must report the filter number, the turbidity measurement, and the date(s) on which the exceedance occurred. In addition, the system must conduct a self-assessment of the filter within 14 days of the exceedance and report that the self-assessment was conducted. The self assessment must consist of at least the following components: assessment of filter performance; development of a filter profile; identification and prioritization of factors limiting filter performance; assessment of the applicability of corrections; and preparation of a filter self-assessment report.
- (4) For any individual filter that has a measured turbidity level of greater than 2.0 NTU in two consecutive measurements taken 15 minutes apart at any time in each of two consecutive months, the system must report the filter number, the turbidity measurement, and the date(s) on which the exceedance occurred. In addition, the system must arrange for the conduct of a comprehensive performance evaluation by the State or a third party approved by the State no later than 30 days following the exceedance and have the evaluation completed and submitted to the State no later than 90 days following the exceedance.

 (c) Additional reporting requirements: (1) If at any time the turbidity exceeds 1 NTU in representative samples of filtered water in a system using conventional filtration treatment or direct filtration, the system must inform the State as soon as possible, but no later than the end of the next business day.

 (2) If at any time the turbidity in representative samples of filtered water exceeds the maximum level set by the State under \$141.173(b) for filtration technologies other than conventional filtration treatment, direct filtration, slow sand filtration, or diatomaceous earth filtration, the system must inform the State as soon as possible, but no later than the end of the next business day.

PART 142-NATIONAL PRIMARY DRINKING WATER REGULATIONS IMPLEMENTATION

The authority citation for Part 142 continues to read as follows: Authority: 42 U.S.C. 300f, 300g-1, 300g-2, 300g-3, 300g-4, 300g-5, 300g-6, 300j-4, 300j-9, and 300j-11.

(3)***

(i) Informing public water systems of the new EPA (and upcoming State) requirements and that EPA will be overseeing implementation of the requirements until the State, if eligible for interim primacy, submits a complete and final primacy revision request to EPA, or in all other cases, until EPA approves the State program revision;

* * * * *

(d)***

(2) <u>Final Request.</u> * * * Complete and final State Requests for program revisions shall be submitted within two years of the promulgation of the new or revised EPA regulations, as specified in paragraph (b) of this section.

* * * *

§ 142.14 Records kept by States.

(a)***

- (3) Records of turbidity measurements must be kept for not less than one year. The information retained must be set forth in a form which makes possible comparison with the limits specified in §§141.71, 141.73, 141.173 and 141.175 of this chapter. Until June 29, 1993, for any public water system which is providing filtration treatment and until December 30, 1991, for any public water system not providing filtration treatment and not required by the State to provide filtration treatment, records kept must be set forth in a form which makes possible comparison with the limits contained in §141.13 of this chapter.
- (4)(i) Records of disinfectant residual measurements and other parameters necessary to document disinfection effectiveness in accordance with §§141.72 and 141.74 of this chapter and the reporting requirements of §§141.75 and 141.175 of this chapter must be kept for not less than one year.
- (ii) Records of decisions made on a system-by-system and case-by-case basis under provisions of part 141, subpart H or subpart P of this chapter, must be made in writing and kept at the State.

(7) Any decisions made pursuant to the provisions of part 141, subpart P of this chapter.

- (i) Records of systems consulting with the State concerning a modification to disinfection practice under §141.172(c) of this chapter, including the status of the consultation.
- (ii) Records of decisions that a system using alternative filtration technologies, as allowed under §141.173(b) of this chapter, can consistently achieve a 99.9 percent removal and/or inactivation of <u>Giardia lamblia</u> cysts, 99.99 percent removal and/or inactivation of viruses, and 99 percent removal of <u>Cryptosporidium</u> oocysts. The decisions must include State-set enforceable turbidity limits for each system. A copy of the decision must be kept until the decision is reversed or revised. The State must provide a copy of the decision to the system.
- (iii) Records of systems required to do filter self-assessment, CPE, or CCP under the requirements of §141.175 of this chapter.

Section 142.15 is amended by adding paragraph (c)(5) to read as follows:

§ 142.15 Reports by States.

(c) ***

(5) Sanitary surveys. A list of subpart H systems that have had a sanitary survey completed during the previous year and an annual evaluation of the State's program for conducting sanitary surveys under §142.16 (b)(3) of this chapter.

§ 142.16 Special primacy requirements.

(b) ***

(1) Enforceable requirements. (i) ***

- (ii) States must have the appropriate rules or other authority to assure that PWSs respond in writing to significant deficiencies outlined in sanitary survey reports required under paragraph (b)(3) of this section no later than 45 days after receipt of the report, indicating how and on what schedule the system will address significant deficiencies noted in the survey.
- (iii) States must have the appropriate rules or other authority to assure that PWSs take necessary steps to address significant deficiencies identified in sanitary survey reports required under paragraph (b)(3) of this section, if such deficiencies are within the control of the PWS and its governing body.
- (3) Sanitary survey. In addition to the general requirements for sanitary surveys contained in §142.10(b)(2), an application must describe how the State will implement a sanitary survey program that meets the requirements in paragraphs (b)(3)(i) through (v) of this section. For the purposes of this paragraph, "sanitary survey" means an onsite review of the water source (identifying sources of contamination using results of source water assessments where available), facilities, equipment, operation, maintenance, and monitoring compliance of a public water system to evaluate the adequacy of the system, its sources and operations and the distribution of safe drinking water.
- (i) The State must conduct sanitary surveys for all surface water systems (including groundwater under the influence) that address the eight sanitary survey components listed in paragraphs (b)(3)(i)(A) through (H) of this section no less frequently than every three years for community systems and no less frequently than every five years for noncommunity systems. The State may allow sanitary surveys conducted after December 1995 to serve as the first set of required sanitary surveys if the surveys address the eight sanitary survey components listed in paragraphs (b)(3)(i)(A) through (H) of this section.
- (A) Source.
- (B) Treatment.
- (C) Distribution system.
- (D) Finished water storage.
- (E) Pumps, pump facilities, and controls.
- (F) Monitoring and reporting and data verification.
- (G) System management and operation.
- (H) Operator compliance with State requirements.
- (ii) For community systems determined by the State to have outstanding performance based on prior sanitary surveys, subsequent sanitary surveys may be conducted no less than every five years. In its primacy application, the State must describe how it will decide whether a system has outstanding performance and is thus eligible for sanitary surveys at a reduced frequency.
- (iii) Components of a sanitary survey may be completed as part of a staged or phased state review process within the established frequency.
- (iv) When conducting sanitary surveys for systems required to comply with the disinfection profiling requirements in §141.172 of this chapter, the State must also review the disinfection profile as part of the sanitary survey.
- (v) In its primacy application, the State must describe how it will decide whether a deficiency identified during a sanitary survey is significant for the purposes of paragraph (b)(1)(ii) of this section.
- (g) Requirements for States to adopt 40 CFR part 141, subpart P Enhanced Filtration and Disinfection. In addition to the general primacy requirements enumerated elsewhere in this part, including the requirement that State provisions are no less stringent than the federal requirements, an application for approval of a State program revision that adopts 40 CFR part 141, subpart P Enhanced Filtration and Disinfection, must contain the information specified in this paragraph:
- (1) Enforceable requirements. States must have the appropriate rules or other authority to require PWSs to conduct a Composite Correction Program (CCP) and to assure that PWSs implement any followup recommendations that result as part of the CCP. The CCP consists of two elements a Comprehensive Performance Evaluation (CPE) and Comprehensive Technical Assistance (CTA). A CPE is a thorough review and analysis of a plant's performance-based capabilities and associated administrative, operation and maintenance practices. It is conducted to identify factors that may be adversely impacting a plant's capability to achieve compliance and emphasizes approaches that can be implemented without significant

capital improvements. A CTA is the performance improvement phase that is implemented if the CPE results indicate improved performance potential. During the CTA phase, the system must identify and systematically address plant-specific factors. The CTA is a combination of utilizing CPE results as a basis for followup, implementing process control priority-setting techniques and maintaining long-term involvement to systematically train staff and administrators.

(2) State practices or procedures.

(i) Section 141.172(a)(3) of this chapter- How the State will approve a more representative annual data set than the data set determined under §141.172 (a)(1) or (2) of this chapter for the purpose of determining applicability of the requirements of §141.172 of this chapter.

(ii) Section 141.172(b)(5) of this chapter-How the State will approve a method to calculate the logs of inactivation for viruses for a system that uses either chloramines or ozone for primary disinfection.

(iii) Section 141.172(c) of this chapter- How the State will consult with PWSs to evaluate modifications to

disinfection practice.

(iv) Section 141.173(b) of this chapter-For filtration technologies other than conventional filtration treatment, direct filtration, slow sand filtration, or diatomaceous earth filtration, how the State will determine that a public water system may use a filtration technology if the PWS demonstrates to the State, using pilot plant studies or other means, that the alternative filtration technology, in combination with disinfection treatment that meets the requirements of §141.172(b) of this chapter, consistently achieves 99.9 percent removal and/or inactivation of Giardia lamblia cysts and 99.99 percent removal and/or inactivation of viruses, and 99 percent removal of Cryptosporidium oocysts. For a system that makes this demonstration, how the State will set turbidity performance requirements that the system must meet 95 percent of the time and that the system may not exceed at any time at a level that consistently achieves 99.9 percent removal and/or inactivation of Giardia lamblia cysts, 99.99 percent removal and/or inactivation of viruses, and 99 percent removal of Cryptosporidium oocysts.

Appendix F

Examples of IESWTR Monitoring Forms for States

This appendix contains example monitoring forms that may be helpful if your state is developing monitoring forms for the IESWTR. These examples are provided for demonstration purposes only. Therefore, instructions for completing the forms are not provided.

Contents

Examples of	of Combined Filter Effluent Forms5
Sta	te of Idaho
A.	IESWTR Turbidity Report
Sta	te of Texas
B.	Surface Water Monthly Operating Report-Summary Page 8
C.	Surface Water Monthly Operating Report–Turbidity Data Page
Examples o	f Individual Filter Effluent Forms
Sta	te of Wyoming
Α.	Monthly Report to the Primacy Agency for Individual Filter (IF) Turbidity Monitoring . 13
Sta	te of Texas
B.	Filter Profile Report for Individual Filters
C.	Surface Water Monthly Operating Report-Filter Data Page
D.	Filter Assessment Report for Individual Filters

Examples of Combined Filter Effluent Forms

State	of Idaho •	
A.	Sample IESWTR Turbidity Report	
State	of Texas	
В.	Sample Surface Water Monthly Operating Report-Summary Page	. :
C.	Sample Surface Water Monthly Operating Report-Turbidity Data Page	. :

A. Sample IESWTR Turbidity Report from the State of Idaho

	QUALITY	(S	ee reverse t	for turbidity	standards a	nd monitori	ing frequenc	;y)	primary statesecondaryanother me	standard
Wat	ter System N	ame:	J.,		e gjte		S ID #:		Month: Year:	
Sot	rce Name:		* s	ubmitted	by:) 10 kg		County:	
PLA	NT TYPE:	□ conv	entional							
						i de la composición dela composición de la composición dela composición de la composición dela composición dela composición de la composición dela compo				
DAY	Total Hours of Operation	Raw water turbidity		finished	l water tu required		easurem	ents as		READING
		(NTU)		2	3		3	0	LEVEL (NTU)	TIME
1				Red: 40			1.00	New Control of the Co	The second secon	5.
2				أيد المراكبة	5 to 1	***	3 . ∹ 1579.	\$30 m	14.444	
3				Australia (* \$100 miles	-	Santa S		3 2	
4 5			क्षेत्रकी जिल्लाहरू	. Suest	7.5 3.55 824	3 3 3 3 3 3 3 3 3 3 3 3 3 3 3 3 3 3 3		Mark.		
6		Ç	al US region. And GATE Artis		14) (4) (4) (4)	167 (\$49) 1. 11 (1	GAL BOTHLAS			
7		2.5c	13.5 G	raga z Nikid			14 14 14 14 14 14 14 14 14 14 14 14 14 1	ન પ્લોગ્ક∤ફ	5 2 - 172	
8			**************************************	25.	The state of the s	7.1%			d f	
9			Nata Salata	Section 1		1	\$400 A		2 O	
Star.	Trees,	THE	*****	N 18	No.	7948		13	72 Jan	,
1,550	N 427 Yu.			6 / 1 m	No.	£1	一种人		ν,	14 h
2	** (1.2 **		ne Trady		e, e		18			
3%.				合語を		ंश्र	\$5.			
4	A Section 1	er for the		7. T.	N.	No.	- #			
5				*#30.5% ************************************			Ser.			
.6 .7	****	蒙特以 其	**.37		位势点。 。 "晓…					•
8										
9			Aps.							
0			1285- 1487-	Bes. a.s.	and district the					
1					· 100 / 100 / 100 / 100 / 100 / 100 / 100 / 100 / 100 / 100 / 100 / 100 / 100 / 100 / 100 / 100 / 100 / 100 /					
					h warn,				-	
	t operated this			MONT	(see reve	measurem	ents below ormance sta	andards)	nce standard:	

B. Sample Surface Water Monthly Operating Report-Summary Report from the State of Texas

		FOR PUBLIC	WATER SYSTEMS T	THAT ARE USING SU UNDER THE INFLUE	JRFACE WATE	R SOURCES	
UBLIC WATER			S	ummary Page	PLANT NA	ME	
YSTEM NAME:	TNRCC WSC		ેં જાતી છે.		OR NUMB	ER: PDWS Water Treatm he information contained in this rep	
				to the bell of	my kna ledge.	mation s true, complete, an	
WS ID No.:	1234567	o	perator's Signature:	<u> Al</u> C	rug i	worker	
eport for he Month of:	February 2002	c	ે artificate No. & Grade	e: <u>123-45-678</u>	9, BSW	Date:	March 1, 2002
						(*) VAD	
	CHANGE Y THE ELECTRONICAL	NAME OF TAXABLE PARTY.	TREATMEN 133	NT PLANT PERF	12 22 11 1	n plant was off-line:	34
Total number of tu	arbidity readings: as above 0.18 NTU:		114	(3.5 PM) (3.6)	©15 15 €	n plant was on-line	
Number of reading	gs above 0.3 NTU:	=	3	but turbidity data			·
Number of reading Number of reading				* ************************************			*
Maximum allowable	=		0.3	Number of days	with readings :	aboye 1.0 NTU:	
	dings above this limit:		3.8 % (1)	Number of days	110	(A) w (A)	0 (3)
St	atistical ummary	Maximum turbidity Minimum turbidity		1.17 NTU 0.03 NTU		Average turbidity value: Standard deviation:	0.23 NTU 0.149 NTU
	s) for individual filter monit s) for individual filter monito		Windy Williams	NONE NONE	Filter Profile Filter Profile	Filter Assessmen Filter Assessmen	
		A-1-1-1-1-1-1-1-1-1-1-1-1-1-1-1-1-1-1-1		Number of days but individual fil		s on-line ta was not collected:	1
Manufacture and			and the second	Average log ina	at marking to be	ardia:	0.00
	ith a low CT	(A)		Average jug ma	ctivation for Vi	nises:	0.00
for no more than 4	4.0 consecutive hours:			Average log ina	ctivation for vi	ruses:	
for no more than 4 Number of days wi	4.0 consecutive hours:		<u>î</u> <u>26</u> (4)	Average log inat	ctivation for vi when profiling	ruses; data was not collected: was not collected:	
for no more than 4 Number of days wi for more than 4.0 c	t.0 consecutive hours: ith a low CT		26 (4)	Average log inat	when profiling when CT data	ruses: data was not collected:	=======================================
for no more than 4 Number of days wi for more than 4.0 o Minimum disinfect Number of days wi	4.0 consecutive hours: ith a low CT consecutive hours: ctant residual required leavi ith a low residual		26 (4)	Average log inac Number of days Number of days	when profiling when CT data	ruses; data was not collected; was not collected;	=======================================
for no more than 4 Number of days wi for more than 4.0 of Minimum disinfect Number of days wi for no more than 4	4.0 consecutive hours: ith a low CT consecutive hours: tant residual required leavi ith a low residual 4.0 consecutive hours:		1 26 (4)	Average log inat Number of days Number of days 0.5 mg/L	ctivation for vii when profiling when CT data Free C	ruses: data was not collected: was not collected: Chlorine Total Cl	=======================================
for no more than 4 Number of days wi for more than 4.0 d Minimum disinfect Number of days wi for no more than 4 Number of days wi	4.0 consecutive hours: ith a low CT consecutive hours: tant residual required leavi ith a low residual 4.0 consecutive hours:		1 26 (4)	Average log inac Number of days Number of days	when CT data Free C	ruses: data was not collected: was not collected: Chlorine Total Cl	=======================================
for no more than 4. Number of days wifor more than 4.0 of Minimum disinfect Number of days wifor no more than 4.0 of for more than 4.0 of Number of days wifor more than 4.0 of	4.0 consecutive hours: ith a low CT consecutive hours: trant residual required loavi ith a low residual 4.0 consecutive hours: ith a low residual consecutive hours:	ing the plant:	<u>1</u> 0 (5)	Average log inat Number of days Number of days 0.5 mg/L Number of days leaving the plant	when disinfect when disinfect when disinfect when disinfect	ruses: data was not collected: was not collected: chlorine Total Cl tant residual erty monitored:	alorine
for no more than 4 Number of days wi for more than 4.0 d Minimum disinfec Number of days w for no more than 4 Number of days w for more than 4.0 d	th a low CT consecutive hours: that new CT consecutive hours: that residual required loavi that how residual to consecutive hours: the a low residual consecutive hours:	ing the plant:	<u>1</u> 0 (5)	Average log inat Number of days Number of days 0.5 mg/L Number of days leaving the plant	when profiling when CT data Free C when disinfect was not prop	ruses: data was not collected: was not collected: Chlorine Total Cl tant residual erty monitored:	alorine 1
for no more than 4 Number of days wi for more than 4.0 a Minimum disinfect Number of days wi for no more than 4 Number of days wi for more than 4.0 a Minimum disinfecta	4.0 consecutive hours: th a low CT consecutive hours: that residual required leavi tith a low residual 4.0 consecutive hours: tith a low residual consecutive hours:	ing the plant:		Average log inat Number of days Number of days 0.5 mg/L Number of days leaving the plant TRIBUTION SYS	when CT data Free C when disinfect was not proper TEM Free C	ruses: data was not collected: was not collected: chlorine Total Cl tant residual erty monitored:	alorine 1
for no more than 4 Number of days wi for more than 4.0 Minimum disinfect Number of days wi for no more than 4.0 Number of days wi for more than 4.0 Minimum disinfecta Total number of rea	4.0 consecutive hours: th a low CT consecutive hours: ttant residual required leavi tith a low residual 4.0 consecutive hours: tith a low residual consecutive hours: the a low residual consecutive hours:	ing the plant:	<u>1</u> 0 (5)	Average log inat Number of days Number of days 0.5 mg/L Number of days leaving the plant TRIBUTION SYS 0.5 mg/L	when disinfect was not propin	data was not collected: was not collected: was not collected: chlorine Total Cl tant residual erly monitored: Chlorine Total Cl	alorine 1
for no more than 4.0 Number of days with for more than 4.0 Minimum disinfect Number of days with for no more than 4.0 Number of days with for more than 4.0 Minimum disinfect Total number of rea Average disinfectar	4.0 consecutive hours: ith a low CT consecutive hours: tant residual required leavi ith a low residual 4.0 consecutive hours; thith a low residual consecutive hours: the a low residual consecutive hours:	ing the plant:	1 0 (5)	Average log inat Number of days Number of days 0.5 mg/L Number of days leaving the plant TRIBUTION SYS 0.5 mg/L Percantage of re	when profiling when CT data Free C when disinfect was not proper than the control of the contr	data was not collected: was not collected: chlorine Total Cl tant residual erly monitored: Chlorine Total Cl low residual this month:	1 1 0 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1
for no more than 4 Number of days w for more than 4.0 Minimum disinfect Number of days w for no more than 4.0 Number of days w for more than 4.0 Minimum disinfecta Total number of rea Average disinfectar Number of readings	4.0 consecutive hours: th a low CT consecutive hours: ttant residual required leavi tith a low residual 4.0 consecutive hours: tith a low residual consecutive hours: the a low residual consecutive hours:	ing the plant;	1 0 (5) DIS 1.32 2 2	Average log inat Number of days Number of days 0.5 mg/L Number of days leaving the plant TRIBUTION SYS 0.5 mg/L Percentage of re	when profiling when CT data Free C when disinfect was not proper than the control of the contr	data was not collected: was not collected: was not collected: chlorine Total Cl tant residual erly monitored: Chlorine Total Cl	alorine 1
for no more than 4.0 Number of days wifor more than 4.0 Minimum disinfect Number of days wifor no more than 4.0 Number of days wifor more than 4.0 Minimum disinfect Fortal number of rea Average disinfectar Number of readings Number of readings	4.0 consecutive hours: ith a low CT consecutive hours: tant residual required leavi ith a low residual 4.0 consecutive hours; tith a low residual consecutive hours: the a low residual consecutive hours: the a low residual consecutive hours: with a low residual: s with a low residual: s with no detectable residual	ing the plant:	1 	Average log inat Number of days Number of days 0.5 mg/L Number of days leaving the plant TRIBUTION SYS 0.5 mg/L Percentage of re	when profiling when CT data Free C when disinfect was not proper TEM Free C adings with a leadings with a leading w	data was not collected: was not collected: chlorine Total Cl tant residual erly monitored: Chlorine Total Cl low residual this month:	1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1
for no more than 4.0 Number of days wifor more than 4.0 Minimum disinfect Number of days wifor no more than 4.0 Number of days wifor no more than 4.0 Minimum disinfectar fortal number of readings Number of readings Number of readings	th a low CT consecutive hours: tha low CT consecutive hours: that residual required leavi tith a low residual 4.0 consecutive hours: that is ow residual consecutive hours: that is ow residual consecutive hours: that is ow residual that residual required in distr dings this month: the residual value: the with a low residual: to with no detectable residual	ing the plant:	1 0 (5) DIS 38 3 1.32 2 2 0	Average log inat Number of days Number of days 0.5 mg/L Number of days leaving the plant TRIBUTION SYS 0.5 mg/L Percentage of re	when profiling when CT data Free C when disinfect was not proper TEM Free C addings with a leadings with a leading	data was not collected: was not collected: was not collected: chlorine Total Cl tant residual erly monitored: Chlorine Total Cl low residual this month: low residual last month:	nlorine 17 18 18 18 18 18 18 18
for no more than 4 Number of days wi for more than 4.0 Minimum disinfect Number of days wi for no more than 4.0 Number of days wi for more than 4.0 Winimum disinfecta fotal number of rea Number of readings Number of readings	th a low CT consecutive hours: tha low CT consecutive hours: that residual required leavi tith a low residual 4.0 consecutive hours: that is ow residual consecutive hours: that is ow residual consecutive hours: that is ow residual that residual required in distr dings this month: the residual value: the with a low residual: to with no detectable residual TREATMENT	ing the plant:	1 0 (5) DIS 39 1.32 2 0 PU	Average log inat Number of days Number of flays 0.5 mg/L Number of days leaving the plant TRIBUTION SYS 0.5 mg/L Percentage of re Percentage of re	when profiling when CT data Free C when disinfect was not proportion of the control of the con	data was not collected: was not collected: chlorine Total Cl tant residual erly monitored: Chlorine Total Cl tow residual this month: low residual last month:	1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1
for no more than 4 Number of days with for more than 4.0 of the form of days with for no more than 4.0 of the form of days with for more than 4.0 of the form of t	th a low CT consecutive hours: tha low CT consecutive hours: that residual required leavi tith a low residual 4.0 consecutive hours: that is ow residual consecutive hours: that is ow residual consecutive hours: that is ow residual that residual required in distr dings this month: the residual value: the with a low residual: to with no detectable residual	ing the plant:	1 0 (5) DIS 39 1.32 2 0 PU	Average log inat Number of days Number of days 0.5 mg/L Number of days leaving the plant TRIBUTION SYS 0.5 mg/L Percentage of re	when profiling when CT data Free C when disinfect was not proper TEM Free C addings with a leadings with a leading	data was not collected: was not collected: was not collected: chlorine Total Cl tant residual erly monitored: Chlorine Total Cl low residual this month: low residual last month:	nlorine 17 18 18 18 18 18 18 18
for no more than 4.0 Number of days wifor more than 4.0 Minimum disinfect Number of days wifor no more than 4.0 Number of days wifor no more than 4.0 Minimum disinfectar Number of readings Number of readings Number of readings Were more than 5 sbove	th a low CT consecutive hours: tha low CT consecutive hours: that residual required leavi tith a low residual 4.0 consecutive hours: that is ow residual consecutive hours: that is ow residual consecutive hours: that is ow residual that residual required in distr dings this month: the residual value: the with a low residual: to with no detectable residual TREATMENT	ing the plant: Continue Cont	1 1 DIS 39 1.32 2 0 PU ATIONS table level?	Average log inat Number of days Number of days Number of days O.5. mg/L Number of days leaving the plant TRIBUTION SYS O.5. mg/L Percentage of re Percentage of re BLIC NOTIFICAT	when profiling when CT data Free C when disinfect was not proportion of the control of the con	data was not collected: was not collected: was not collected: chlorine Total Cl tant residual erly monitored: Chlorine Total Cl low residual this month: low residual last month:	nlorine 17 18 18 18 18 18 18 18
for no more than 4 Number of days wi for more than 4.0 Minimum disinfect Number of days wi for no more than 4.0 Number of days wi for more than 4.0 Minimum disinfecta Total number of read Average disinfectan Number of readings Number of readings Number of readings Were more than 5 above Were there any da Were there any da	th a low CT consecutive hours: tha low CT consecutive hours: tant residual required leavi ith a low residual 4.0 consecutive hours: that is ow residual consecutive hours: that is ow residual consecutive hours: the sidual required in districtings this month: the residual required in districtings this month: s with a low residual: s with no detectable residual TREATMENT .0% of the turbidity readings ays with turbidity readings	ing the plant: ibution system: al: TECHNIQUE VIOL. JS above 1.0 NTU? - s. above 5.0 NTU? - s.	1 O) (5) DIS 39 1.32 2 2 0 PUI ATIONS table level? ee (2) above	Average log inat Number of days Number of days leaving the plant TRIBUTION SYS 0.5 mg/L Percentage of re Percentage of re Percentage of re	when profiling when CT data Free C when disinfect was not proportion TEM Free C addings with a leadings with a leading with	data was not collected: was not collected: was not collected: chlorine Total Cl tant residual erly monitored: Total Cl tow residual this month: low residual last month: If YES, date wh COMMISSION†	alorine 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1
for no more than 4 Number of days we for more than 4.0 Minimum disinfect Number of days we for no more than 4.0 Number of days we for more than 4.0 Minimum disinfecta Total number of rea Average disinfectar Number of readings Number of readings Were more than 5 above Were there any da Were there any da Were there any da One on secutive hour	th a low CT consecutive hours: tha low CT consecutive hours: tant residual required loavi th a low residual 4.0 consecutive hours: that a low residual consecutive hours: that a low residual dings this month: the residual required in districtings this month: the residual value: the with a low residual: the with a low residual in the low residual	ing the plant: ibution system: al: TECHNIQUE VIOL. gs above the accep above 5.0 NTU? - s d to meet the CT rec	1 O (5) DIS 39 1.32 2 O PU ATIONS table level? ee (2) above ee (3) above quirements for more	Average log inat Number of days Number of days Number of days leaving the plant TRIBUTION SYS 0.5 mg/L Percentage of re Percentage of re Percentage of re Average 13	when profiling when CT data Free C when CT data Free C was not proput TEM Free C sadings with a	data was not collected: was not collected: was not collected: chlorine Total Cl tant residual erly monitored: Total Cl tow residual this month: low residual last month: If YES, date wh COMMISSION†	alorine 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1
for no more than 4.0 Number of days wifor more than 4.0 Minimum disinfect Number of days wifor no more than 4.0 Number of days wifor no more than 4.0 Number of days wifor more than 4.0 Number of readings Were more than 5 above Were there any da Were there any da Were there any peonsecutive hour	th a low CT consecutive hours: that residual required leavi that residual required leavi that low residual the a low residual the a low residual consecutive hours: the a low residual consecutive hours: the a low residual dings this month: nt residual required in distr dings this month: the residual value: with a low residual: with no detectable residual: a with no detectable residual a with the low residual; a with the same a low residuals a	ing the plant; ing the plant; ibution system: al: TECHNIQUE VIOL. gs above 1.0 NTU? - s above 5.0 NTU? - s id to meet the CT received.	1 O (5) DIS 39 1.32 2 O PU ATIONS table level? ee (2) above ee (3) above quirements for more	Average log inat Number of days Number of days Number of days Number of days eaving the plan TRIBUTION SYS 0.5 mg/L Percentage of re Percentage of re BLIC NOTIFICAT see (1)	when profiling when CT data Free C when disinfect was not properly was n	data was not collected: was not collected: was not collected: chlorine Total Cl tant residual erly monitored: Total Cl tow residual this month: low residual last month: If YES, date wh COMMISSION†	alorine 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1
for no more than 4 Number of days w for more than 4.0 Minimum disinfect Number of days w for no more than 4.0 Number of days w for nore than 4.0 Number of days w for more than 4.0 Number of readings Number of readings Number of readings Were more than 5 above Were there any da Were there any pe consecutive hour Were there any pe than 4.0 consecut Were more than 5 Were more than 5	th a low CT consecutive hours: tha low CT consecutive hours: tant residual required loavi th a low residual 4.0 consecutive hours: that a low residual consecutive hours: that a low residual consecutive hours: that a low residual that a low residual that a low residual: that a low residuals that a low r	ibution system: al: TECHNIQUE VIOL. JS above the accep above 1.0 NTU? - s above 5.0 NTU? - s d to meet the CT receiving the plant fellowing	1 1 DIS 39 1.32 2 0 PU ATIONS table level? ee (2) above ee (3) above quirements for more	Average log inat Number of days Number of days Number of days Leaving the plant TRIBUTION SYS 0.5 mg/L Percentage of re Percentage of re BLIC NOTIFICAT than 4.0. ble level for more	when profiling when CT data Free C when disinfect was not properly the CT data Free C addings with a land of the CT data TON. Yes No Yes	data was not collected: was not collected: was not collected: chlorine Total Cl tant residual erly monitored: Total Cl tow residual this month: low residual last month: If YES, date wh COMMISSION†	alorine 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1
for no more than 4 Number of days w for more than 4.0 Minimum disinfect Number of days w for no more than 4.0 Number of days w for more than 4.0 Number of than 4.0 Minimum disinfectar Total number of read Average disinfectar Number of readings Number of readings Were more than 5 above Were there any da Were there any da Were there any pe consecutive hour Were than 5.0 Were there any pe than 4.0 consecut Were more than 5.0	th a low CT consecutive hours: ith a low CT consecutive hours: tant residual required leavi ith a low residual 4.0 consecutive hours: ith a low residual consecutive hours: ith a low residual intresidual required in distr dings, this month: intresidual value: s with a low residual: s with no detectable residual TREATMENT .0% of the turbidity readings anys with turbidity readings anys with turbidity readings: spriods when the plant failed spriods when the residuals I tive hours? - see (5) above	ibution system: al: TECHNIQUE VIOL. JS above the accep above 1.0 NTU? - s above 5.0 NTU? - s d to meet the CT receiving the plant fellowing	1 1 DIS 39 1.32 2 0 PU ATIONS table level? ee (2) above ee (3) above quirements for more	Average log inat Number of days Number of days Number of days Leaving the plant TRIBUTION SYS 0.5 mg/L Percentage of re Percentage of re BLIC NOTIFICAT than 4.0. ble level for more	when profiling when CT data Free C when disinfect was not propulated with a landings with a	data was not collected: was not collected: was not collected: chlorine Total Cl tant residual erly monitored: Total Cl tow residual this month: low residual last month: HYES, date wh COMMISSION† February 5, 2002	nlorine 1 1 1 1 1 1 1 1 1 1 1 1 1
for no more than 4 Number of days w for more than 4.0 Minimum disinfect Number of days w for no more than 4.0 Number of days w for more than 4.0 Number of than 4.0 Minimum disinfectar Total number of read Average disinfectar Number of readings Number of readings Were more than 5 above Were there any da Were there any da Were there any pe consecutive hour Were than 5.0 Were there any pe than 4.0 consecut Were more than 5.0	th a low CT consecutive hours: that residual required leavi th a low residual 4.0 consecutive hours; that residual required in our tith a low residual consecutive hours; that a low residual consecutive hours; that residual required in distr dings this month; the residual value; with a low residual; s with a low residual; s with no detectable residual; that is with the plant failed says with turbidity readings anys with turbidity readings; anys with tur	ibution system: al: TECHNIQUE VIOL. ps above the accep above 1.0 NTU? - s above 5.0 NTU? - s d to meet the CT rec leaving the plant fel distribution system	17 0 (5) DIS 35 1.32 2 0 PUI ATIONS table level? ee (2) above ee (3) above quirements for more the puick of t	Average log inat Number of days Number of days Number of days Number of days 0.5 mg/L Number of days leaving the plant TRIBUTION SYS 0.5 mg/L Percentage of re Percentage of re BLIC NOTIFICAT than 4.0. ble level for two	when profiling when CT data Free C when disinfect was not propulate the control of the control	data was not collected: was not collected: was not collected: chlorine Total Cl tant residual erly monitored: Total Cl tow residual this month: low residual last month: HYES, date wh COMMISSION† February 5, 2002	nlorine 1 5.1 % (6A) 2.6 % (6B) CUSTOMERS* February 8, 2002

C. Sample Surface Water Monthly Operating Report-Turbidity Data Page From the State of Texas

UBLIC		TNRCC WSC			E			\$15 94	idity Dat	P⊔	NT NAM							
						305.00	<u>.</u> €%s.	ç			NUMBER	±.		later Trea	tment Pla	nt		
WS ID I	No.:	1234567					16 3.		**************************************	_ Coi	nections		11,900					
lonth:		February		<u> </u>		Year:	2002			Pop	ulation:		35,700					·
							PERFO	V*	E DATA	1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1	12 11/10 11 15 35				4.2			ist (CC)
	Raw	Treated		WATER LYSES		SET	TLED WAT	**************************************	IDITY :) ()	4.0X		FI	VISHED W	ATER QUA	LITY		
	Water Pumpage	Water Pumpage	- 2142	1			(Option Basi		*3 ₃	Tress	1,580 c		Turk	idity			Lowest	
Date	(MGD)	(MGD)	UTM	Alk.	1	2	. 3	4	. 5	6'\	NTU1	'NTU2	、NTU3	NTU4	MTU5	NTU6	Residual	Time t
1	1.411	1.322	49	52	2.4	1.9		47 E	.,	1832	/ X»	0.19	0.07	., 0.03	0.31		2.4	
3	1,484	1.444	26	68	2.8	1.8	को सामान्यात्रहरू को सामान्यात्रहरू कामान्यात्रहरू			1-1-April	X	0.33	0.24	0.27	e 0,15	0.12	3.4	
4	1.598	1,511	12 80	59 92	2.1 5.2	2.2	arredition arreditions	total.	parent.	型 (機能)	×	0.23	0.08	~0.12	. 0.17	0.26	3.1	
5	0.000	0.889	×	x	X	X >	Bell Ho	2011 V	erinan Seruk	eu bin	X.	U.34	0.46	0.78 ×	1.06 X	1.17 X	2.3 1,1	
6	2.650	1.103	15	61	1.8	1.4		7.00	1 200	See Tari	X "	×	0.26	0.32	0.21	0.10	2.8	
7	1.302	1.239	73	55	2.3	2.0				1444	×	0.13	0.28	0.38	0.34	0.30	3.0	
8	1,337	1.280	10	47	1.7	1.9	1, 21,5	Jan 20 30 4	gilor s	98.15	×	0.27	;. D.24	0.17	0.19	0.04	2.7	
9	1,701	1.687	24	53	1.9	1.6	Arma M.		\$ A	200	्रे ∆x	0.24	0.32	0.25	0.18	0.12	0.3	0.75
10	1.408	1.397	16	44	1.2	1.1	2.715.7	1000	1737.3	26.5	(X)	. 0.04	0.08	0.07	0.21	0,11	1.9	
11	1.457	1.402	70	62	1.8;	্ ,1.5	基數很	[[4]	3500	S 7 (3-1)	X₹	0.33	0.06	0,20	0.23	0.34	2.2	
12	1.537	1.522	98	43	3.2	2.3					1/8 X	0.29	0.08	0.16	0.14	0.27	3.1	
14	1.092	1.084	16 68	57 48	2.2	1.7	LIS MAN MARKATA	#4.1%	5. 1444. 5. 1444.	5.0 kg/m;	×	0.33	~ 0.28 ~ 0.26	0.10	0.27	0.29	2.0	
15	1.361	1.278	93	69	2.6	2.1	2016 S	4: 4 (#1)	S. C.	rei fyl. Meggaf	X	70,30	0.20	0.31	0.28	0.03	1.4	
16	1.879	1.794	10	55	2.1	1.9	FL 526		SE THE	1 2 4	×	0.31	0.21	0.17	0.28	0.22	1.5	
17	0.109	0.000	91	58	ै 2.2	×)	1.44.2	4	545		54, x	0.20	0.31	0.24	ें0.34	0.20	×	
18	0.230		95	64	, 2.5	x`	過樂業		12-13a	5500	, x.	0.17	0.13	0.16	0.32	0.28		
19	1.630	1,557	26	53	3.0	2.5	19.14.Q	4 14	404,20	TO GET	X	0.22	0.09	0.15	0.16	0.11	2.6	
20	1.293	1,272	21	39	2.3	, 2.4	s Augusti. S	10 10 10 10 10 10 10 10 10 10 10 10 10 1	304	701,3545 23 an 14	X	0.16	0.11	0.19	0.08	0.05	2.6	
21	1.249	1,210	80 91	51 71	2.9	2.5 2.0		1997-12 1997-12	Seria de Seria de Lo		x 2 x	0.29 0.14	0.26	0.12	0.05	0.31	2.9	
23	1,926	1.834	95	66	2.4	1.8	34004		Standard Standard	and the state of	/x	0.23	0.17	0.04	0.05	0.33	· 1.6	
24	1.018	0.930	. 23		1.5	1.6	schill	11.0	3 3 3	- 7 ° , 6 °	×	0.19	0.16	0.14	0.22	0.32	2.2	
25	1.104	1.016	60	47	∌ 22	1.4	ري زهر راه			1,135,1	×	0.20	0.24	0.21	0.18	0.15	2.3	
26	1.934	1.896	*25	્રે 48	1.7	5 و بياما		112792		1	х	0.25	0.17	0.27	0.29	0.14	3.2	L
27	1.337	1,321	50	37	2.6	2.2	ង្គង់គ្រូ	- Jadhy	344		x	0.18	0.30	0.28	0.33	0.27	1.7	
28	1.909	1.893	64	47	2.5	1.9	ECO.				X	0,21	0.19	0.26	0.15	0.12	2.3	ļ.,
29 30				\vdash	 			等级(含 品类)		and A			-					
31							randrati. Kabupita			arakt, "								
Total	38,587	36.415			·	in the same			Agrical Control	1	† NOTE	: ON) Y	se the "Ti	me*" col	mn to sho	w the le-	ngth of time	that the
Avg	1.378	1.301					200m				disinf	ectant re	sidual ent				m fell belov	
Max	2,650	1.896				-K					ecceb	table lev	···					
Min	0.000	0.000					-74	Signatur.	ef									
				_					. 27"							,	•	
JBMITT	ED BY:	A	zd,	, W	<u>brb</u>	6 %		Certification		123-45	6789, BS\	N	-	Date:	March 1	, 2002		
	•	····					-	,										

Examples of Individual Filter Effluent Forms

State o	of Wyoming	
A.	Sample Monthly Report to the Primacy Agency for Individual Filter (IF) Turbidity Monitoring .	13
State o	of Texas	
B.	Sample Filter Profile Report for Individual Filters	14
C.	Sample Surface Water Monthly Operating Report-Filter Data Page	15
D.	Sample Filter Assessment Report for Individual Filters	16

A. Sample Monthly Report to the Primacy Agency for Individual Filter (IF) Turbidity Monitoring from the State of Wyoming

Monthly Report to the Primacy Agency for Individual Filter (IF) Turbidity Monitoring (This report is only required for a PWS that utilizes conventional or direct filtration and serves greater than 10,000 people. These PWSs must record the turbidity from every filter every 15 minutes. Grab sampling every 4 hrs is allowed if the continuous IF turbidimeter fails but for no more than 5 working days. Report within 10 days of the next month.) IF turbidimeters were last calibrated Date: _ System/Treatment Plant PWSID #_ Prepared 3 By_ Year List all filters* that If 1.0 NTU** was If 0.5 NTU** was If 1.0 NTU*** was If 2.0 NTU*** was exceeded turbidity exceeded was a exceeded 4 hrs after a exceeded in the same exceeded in the Month levels of 0.5 NTU filter profile filter 3 months in a same filter 2 backwash or filterafter 4 hrs., 1.0 NTU, completed within 7 months in a row startup was a filter row was a selfand 2.0 NTU in 2 was a 3rd party CPE days? profile completed assessment arranged in 30 days consecutive IF within 7 days? completed in 14 readings taken 15 and completed & days? submitted in 90 minutes apart. days? 2 3 4 5 8 10 11 12 13 29

30 31

^{*}For each filter, attach information identifying the every 15 minute turbidity readings that caused the exceedance (s).

^{**}If the IF exceedance was caused by obvious reason(e.g., valve malfunction, etc.) submit a written explanation describing the situation that caused the turbidity exceedance in lieu of the filter profile.

^{***}If a PWS has reported an obvious reason for an exceedance in column 3 & 4 it does not count as one of the consecutive months.

B. Sample Filter Profile Report for Individual Filters from the State of Texas

UBLIC WATER YSTEM NAME:			PLANT NAME		
WS ID No.:	4 Ç	>. <i>260</i>	Month:	Yea	r:
	Year Head William	OBVIOUS REAS	nus ###		
	PORT THE PROPERTY OF THE PROPE		FILTER NO.:	FILTER NO.: DATE:	
	•	TIME: DURATION: TURBIDITY:	TIME: DURATION: TURBIDITY:	TIME: DURATION: TURBIDITY:	
OBVIOUS REASONS (Check all that apply)					
NONE IDENTIFIED - A Filter Profile must be submitte Filter Problems	d ;	(See Profile No.)	(See Profile	No(See Profi	le No)
Post-Backwash Turbidity Spike	Ŕ				
Prolonged Fitter Run Time Excessive Fitter-Loading Rate				And the second s	
Rate-of-Flow Control Valve Failure Media Defects (insufficient depth, mudballs, etc.)	- generalis po - e en la companya			in the second	
Inadequate Surface Wash or Backwash Facilities			ACTION OF THE SECOND		
Turbidimeter Errors Incorrect Calibration			· 변화 수 . - 기계 : 기계		
Air Bubble Debris				A Comment of the Comm	
Backwash Artifact				檢	
Chemical Feed Equipment Failure Coagulant				And a state of	
Coagulant Aid				100 mg / 100	
Filter Aid Poor Raw Water Quality			The state of the s		
Other Major Unit Process Failures/Maintenance Activ	rities				
Specify:		선생 병수를	s <u>N.</u> (2)	100	
	N. S. C. P. C.	OBVIOUS REAS	ONS		_
	A CONTRACTOR OF THE STATE OF TH	FILTER NO.:	FILTER NO.:	FILTER NO.:	
e e e e e e e e e e e e e e e e e e e		DATE: TIME:	DATE:	DATE:	
	e Salaha Majarahan	DURATION:	TIME:	TIME: DURATION:	
OBVIOUS REASONS (Check all that apply)		TURBIDITY:	TURBIDITY:	TURBIDITY:	
NONE IDENTIFIED - A Filter Profile must be submitte	d	(See Profile No. >_	(See Profile	No) (See Prof.	le No)
Filter Problems	225.000				
Post-Backwash Turbidity Spike Prolonged Fitter Run Time					
Excessive Fitter-Loading Rate Rate-of-Flow Control Valve Failure			Essa V	•	
Media Defects (insufficient depth, mudballs, etc.)	The same of the				
Inadequate Surface Wash or Backwash Facilities Turbidimeter Errors					
Incorrect Calibration					
Air Bubble Debris					
Backwash Artifact					
Chemical Feed Equipment Failure Coagulant					
Coagulant Aid Filter Aid					
Poor Raw Water Quality					
Poor Raw Water Quality Other Major Unit Process Failures/Maintenance Activ Specify:	rities	The second second			

C. Sample Surface Water Monthly Operating Report-Filter Data Page from the State of Texas

BLIC	WATER				,	OR GRO	UND WAT	TER SOU		NDER THI ter Data F	\$40 CN-		SURFAC		₹ (cont.)					
	NAME:		IRCC WSC	<u>c</u>			1.00	<u> </u>					NUMBER	-	PDWS V	Nater Trea	atment P	lant		
S ID	No.:	12	34567					NE SA	· ·	10.0	5.	Mor	onth:		Februar	у		Year:	2002	
		-10.710.00 (N. 17.71)	a regression programmer					(h)		100	1 4 7 4		Edward Com		4					
		ADMIN							1.0 2.0	G 1.	CE DATA							SPECTOR P	Stant.	
- 1									INDIV	IDUAL FIL	LTERTUR	BIDITY		i v						
ate	Filter Max	No. 1	Filter Max	No. 2	Filter Max	r No. 3	Filter	r No. 4	Filter Max	r No. 5	Filter	r No. 6	Filter		· · · · · · · · · · · · · · · · · · ·	r No. 8		r No. 9		No. 10
1	0.37	0.19	0.18	0,11	0.22		0.31		Max 0.42	4 Hrs		4 Hrs 0.18	Max	4 Hrs	*Max -	4 Hrs	Max	4 Hrs	Max	4 Hrs
2	0.38	0.21	0.21	0.13	0.25	0.11	0.33	0.13	0.47	0.23	0.40	> 0.13	19 July 20		Topology Topology	S. 1947	J. der 2)	2527 1	$1 + i \cdot l_2 \tau$	
3	0.41	0.27	0.23	0.15	0.21	0.13	0.29	-	0.39		-				1 7823 2 3 3 3 3 3	14707-0	\$50 to 13	<u> </u>	17 pd 41	1 1200 E 1
5	1.32 X	0.57 X	0.72 X	0.34 X	0.67 X	0.26 X	0.87 X	0.48	1.05	0.52 X	0.84	0.40 X		· Paragram Peragram		1467-4 1771-44	angue Cherr	n tre naka Panganan		
6	0.27	0.16	0.27	0.14	0.29	0.09	0.42		0.46				Section 1	1 March	gradina.	19200	100	1	1 3 7 4	
7	0.35	0.22	0.17	0.09	0.23		0.37		0.49	0.23	-	3 0.18	100	1,875.4	Algal N	19 5.03	i infaithe	29.1	(Page	
8	0.33	0.17	0,22	0.12	0.17	0.08	0.32		0.38	_			-	1	113 p. es 2011 1.13 p. e. 11	7 1 0 1 17 2 10 1 17	Spring into	Total and the	1 1000000000000000000000000000000000000	175°, 1745
9	0.28	0.15	0.16 0.14	0.08	0,24 0,11	0.10	0:41 0:28	_	0.34	0.18	0.29			対象を	Fakig Kale b			18.50		A HOLE
11	0.21	0.19	0.14	0.07	0.11			_	0.41		1 1 1 1 1		-	2.5	100		1	150	1 3 5 3 3	
12	0.36	0.20	0.19	0,10			0.42	4	0.48	0.24	0.38		135	-	200		<u>. N. F</u>			
13	0.19	0.12	0,10	0.06	0.26		0.33	0.17	0,43		_		[350 de	9.43.7		33.57	1,772,14		115	55 m 3 %
14	0.29	0.18	0.23	0.09	0.18 0.16	0.10	0.35 0.28	0.16	0.40	-		0.13	g lateries Graffing	1.55	- 2 454 FERM				Total Control	kirgira: Light
16	0.42	0.21	0.22	0.08	0.16	0.15	0.32	0.12	0.39	-			11 70 p. 24 17 12 4 13 1	* 14/2 * 14 **********************************	STURBLE STURBLE	Tuffer is	1. Htt		1503	11414
17	0.34	х	0.25	0.12	×	×	\$35 X \$	Х	X	X	×	x	\$31 <u>5.55</u>	र सुद्धार स		Section	45.75	12.5	1957	int.
18	0.18	0.16	0.24	0.14	X	X	'XC	X	X	∵X.	X	X.	TalkaN ************************************	190 a. A.	38.0			1 5	9,834	1995
19 20	0.26	0.18 0.15	0.14	0.08	0.23	**************************************	0.32 3 0.38	0.17	0.46		_		Property of the second of the	e te gree Neighber		-05.942 Fact 19	n tida Maria	1 (20.015.) 4 (0.575.)	1 (25%) 2 (2 (2 (1))	Till light
21	0.25	0.15	0.23	0.11	0.18		° 0.33	0.15	0.39	-			uobina Sakhaja	ing data		200 H	The first of the	15 mars		100
22	0.39	0.22	~0.19	0.13	0.20	90.13	0.29		0,42	, -		0.17	155		(1.5kg/1/2)	4.970	Serie	i de chel	20, 33	5-86
23	0.32	0.19	0.18	0.09	0.26		0.41	0.23	0.37	1			Light (MA)	\$100 P	127, , 1	Julia ve j	2 % A a .		<u> হিচ্ছা</u>	ayang t takan
25	0.27	0.17	0.22	0.15	0.28	0.08	0.39	0.19	0.40			_		260255 159 5		"我是我"。 15 第5 第	Popular Popular	PROGE PARKE		district
26	0.26	∜, 0.21	0.16	0.07	0.14	0.08	0.31 ≥\ 0.29	0.16	0.45	-	0.30		الله الاستان الركام والركارات	強闘す	1 1 2 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1	1.3795.4	1445	the texter		V.,
27	0.31	0.25	0.25	0.11	0.21	0.12	₹ 0.36	0.14	0.41	∌′≨0.28	0.27	k 0.11		136611	100 pm	100 Big.	355	yenyer.	P. B. P. P.	Progr
28	0,29	0.20	s, 0.16	0.09	0.19	0.10	0.30	0.18	0.38		0.29	10	13.25	1,190	PESSON		13073A	19545.2°	863632	49541
29 30			Act.				 -	1000 200	 	*%\$		134 Logarith	e in da M	1.05 (S. 15) (1.55 (S. 15)		14.55%	\$60 V-5	i pitokut Hidaday		Taplika Tabuta
31			33	DN.		- A 33	n De		- 124.h.	 	1887 K	<u> </u>	-35354 -35354	1014	135 Too.	Cost, c	#/302 <u>13</u>			Table 1
\neg			·,	V.3.				The state of the s	NA.		7/20		=	Filte						
2	Numbe	- of days	with ever		Criteria ve 0.5 NTU		X Ny Stad	onth.	144782	5, 1 13,034	2 0	3.	4	5	8	7	8 1 (\$4) a. 1	9 (3) (3) (3)	10	Plant
ACHONS			with even						97., 9870:	Red C	10°	3 0	0	1	0	1000	A STATE OF THE STA	HANGE FOR		
Se l	Number	r of days v	with even	nt(s) above	/e 1.0 NTU	U last mor	nth		(\$7%)	20	0	(; ° 0	0	0	0	e nist ka		A. Nati		
COMPLIANCE			with even						20 mg	. NA	NA.	NA NA	NA	NA	NA	tille 12		250	- Charles St.	
ř			days with		<u></u>	-		onths		√E ∳1	0	0	0	1	0	Maritana Maritana		HANGE A	t ve rolls.	
∞ [with even					45		13.			A SECTION							-
			ave an ap							.∵ N ≪	3 N	N	N	N	N	rigeria.	Fig theory to	FARE	Military on a	N
SUMMA			ired to sul					W. H		¥ Y	Y	N	N	Υ	N	Trak.	N-287	- N. C. 19	1213	35
"			ired to su						(P) #37.	N X	N	N	N	N	N	技术病	N. O.	(A)		
	Is the pa	ant requi	ired to su	bmit a Re	quest to	r Complia	ance CPE	<u> </u>	"MA	5 (30)		500000	ACCURATE OF		Accion	(S) (24) (A)	Caratria.		3000	N
			-/		2.1	, ,				Certifica	-ata Na									
вип	TED BY:	: 1	Ha	rdu	'Wi	orke	32		-	and Gra		123-45	-6789, BS	sw	-	Date:	March	1,2002		

D. Sample Filter Assessment Report for Individual Filters from the State of Texas (Page 1)

				PLANT NAME OR NUMBER:		
PWS ID No.:			989A V.6A	FILTER NUMBER: _		
an and and a grant and the art of the same of the same	ename ana	DESIGN SPE	CIFICATIONS			
-44-21-18-21-17-17-17-17-17-17-17-17-17-17-17-17-17	Diameter	Length.	Width	Surface Area	Freeboard	Available Head
MEDIA BED				<u>ka, jila ka ji</u> Yilarana	esta.	
MEDIA TYPE MEDIA SPECS	Min. Size	Max, Size	UC	Density	Depth	1
Layer 1 Material			isa Saria .		A Charles	1 .
Layer 2 Material Layer 3 Material		1750 A 3 88.		State		1
Laver 4 Material		1	53% 645 1406 7 6	1.5 (20%) - 40 (40)	TON TON THE STATE OF	1 .
TOTAL DEPTH LO RATIO						2 mar.
UNDERDRAIN TYPE	L	- Windows as 1921, Windows		Company and Amphania	ni je sekraja iroj Silini	F
the second secon	No. of Grades	Min. Size	Max. Size	Total Depth	The second secon	-
SUPPORT GRAVEL	[SUPPL BACKWAS	SH	357,35,50	9540. 1871	
TROUGHS No.		SUPPL BACKWAS	No. 24.	5.44	K. Her	
Separation		FILTER-TO-WAST		1200	*##	7
OPERATING MODE			And the Hope to the second	1. 1514 3. 1514 3. 151	5 748	+
FLOW DISTRIBUTION	Regulatory	Design	Typical		Maximum	1 '
FILTER FLOW RATE		s a transport to the	13. W.4. 12.8/3	1,5 2 3 5 5	DVV	+
FLT. LOADING RATE BACKWASH RATE	S 3, 135	2 3 3 3 3 3 3			and a set	1
BW LOADING RATE	<u> </u>	A No.		118/4001801818	3.85.0	4
TO THE SECOND	Source	Controller	Meter	Turbidimeter	LOHG	4
FILTER EFFLUENT BACKWASH WATER		Transfer Service	1875 AVE.	7.8.3-7. ·	12 27kg	ţ
*.			DEOCEDIDES			
	P 10 10 1 2 12 12 12 1 1 1 1 1 1 1 1 1 1	4	-KUCEDURES		werenitaa interitaa ka la	
				NTI I (Secondaria)	POEC	₩
	Flow Meter	Backwash Meter	NTU (Primary)	NTU (Secondary)	ROFC	1
Method Frequency	Flow Meter	Backwash Meter	NTU (Primary)	70 (44	ROFC	
ALIBRATION Method Frequency Date of Last	Flow Meter	Backwash Meter	NTU (Primary)	8 0 8 0 1 6 0	ROFC	<u> </u>
ALIBRATION Method Frequency Date of Last	Flow Meter Turbidity	Backwash Meter	NTU (Primary)	7 Run Volume	ROFC	
ALIBRATION Method Frequency Date of Last AACKWASH Criteria Monitoring Interval	Flow Meter Turbidity	Backwash Meter	NTU (Primary)	7 Run Volume	ROFC	1
ALIBRATION Method Frequency Date of Last BACKWASH Criteria Monitoring Interval	Flow Meter Turbidity	Backwash Meter	NTU (Primary)	7 Run Volume	ROFC	
ALIBRATION Method Frequency Date of Last Criteria Monitoring Interval	Flow Meter Turbidity	Backwash Meter	NTU (Primary)	7 Run Volume	ROFC	1
ALIBRATION Method Frequency Date of Last AACKWASH Criteria Monitoring Interval SOPs Start-up Shutdown Backwash	Flow Meter Turbidity	Backwash Meter	NTU (Primary)	7 Run Volume	ROFC	-
CALBRATION Method Frequency Date of Last BACKWASH Criteria Monitoring Interval SOPs Start-up Shutdown	Flow Meter Turbidity	Backwash Meter	NTU (Primary)	7 Run Volume	ROFC	-
Frequency Date of Last BACKWASH Criteria Monitoring Interval SOPs Start-up Shutdown Backwash	Flow Meter Turbidity	Backwash Meter	NTU (Primary)	7 Run Volume	ROFC	

D. Sample Filter Assessment Report for Individual Filters from the State of Texas (Page 2)

THE INFLU	JENCE OF SURFACE V	VATER THAT ARE R			FILTER ASSESSME	NT
SYSTEM NAME:		<u> }.,</u>	A TOP SASSAGE MICHAEL AND	PLANT NAME OR NUMBER:		
PWS ID No.:				FILTER NUMBER:		
		CURRENT	CONDITIONS	, <u>1998</u> a.		
DATE	TIME	TURBIDITY	LOH SASSA	RUN'TIME	RUN VOLUME	
PHYSICAL CONDITION		* POPTONAL DEL	MARKS CA			· · · · · · · · · · · · · · · · · · ·
Walls		ADDITIONAL REM	MARKS:			1
Troughs Suppl. Backwash	1		Par Tib.		355-	
Flow Meter						
ROFC Flow Control Valve						
Turbidimeter LOHG						
		126.5	11	Santrije - Minder	C. Salada and S.	
			ACE CONDITIONS	Patero PW		
MOUNDS	Before BW	After BW	RETRACTION	Before BW	After BW	
No. Length	- 56.	Trusta Telepta 1997 :	No. Length	Terzestus, 1 etc. 1	1,500 - 20 200	
Width Height	5496m 7 839	1252457 Nghang	Width 2	1, 4, 1 11 11		
DEPRESSIONS		74.8X7.6X9.82.722	CRACKS :			
No. Length	\$ 1465 67,03.51	0 9,484 R. Wan,	No. Length	Telephone State	1	
Width Depth		ian ha i	Width Depth	4 44 7 14 14 14 14 14 14 14 14 14 14 14 14 14	・ (作品)2 - 1 / a / (_
ACCUMULATED FLOC	6/1/SPE-7808/8/6/0	59740 (VIII 0877)K	MUDBALLS	- Y - 30 - 20 KK - 2 F - 10		
Thickness Distribution	inger.	*N. 53-1.	Quantity Size		1976 No. 1986	
			Distribution	Mary 2 3 1	3 3 3 5 A	
ADDITIONAL REMARKS:						
						\$\frac{1}{2}
					•	
Part S	Silve	Charles V	Sira Tera	A		
		BACKWASH				
FLOW RATE	Section (Section 2)	ADDITIONAL REM	IARKS:	. *		
FILTRATION RATE DURATION			A. VIII.		•	
VOLUME				**************************************		
TROUGHS Levelness	(2.22.2.3)			A.		
Flooding			Acce.			
SUPPL BACKWASH Duration		i "				·
Effectiveness	Ivertile a second	£.				
JETTING No. of Sites						ŧ
Severity . FLOC MOVEMENT						1
TURBIDITY						
EXPANSION	T	"~est _p 4		,		[

D. Sample Filter Assessment Report for Individual Filters from the State of Texas (Page 3)

				URCES OR GROUND V DUCT AN INDIVIDUAL I		
SYSTEM NAME:				OR NUMBER:		
MINO ID M				FILTER		
PWS ID No.:		\$ 1.50 m		NUMBER:		
NO. OF SITES			PROBE			
MEDIA		ADDITIONAL REN	MARKS:		de.	
Max. Depth Min. Depth			May.		43 .	
Typ. Depth			s			
Max, Elevation					Y.	
Min. Elevation						
Typ. Elevation					106 - 1841 1542 - 15 - 15 -	
AND SECTION OF SECTION EDGE	CATALOGE ET L	FILTER E	XCAVATION	GARAGE STATE		
CONDITION	REFERENCE Normal	SITE 2	SITE3	SITE 4 Walter	SITE5	SITE 6
LAYER 1	- Normal	Althought Buthy	25	** p. 4. 10 - 10 - 10 - 10 - 10 - 10 - 10 - 10	Social.	
INTERFACE 1 LAYER 2		<mark>nga perdaga dan</mark> Bajawa	1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1	1 (%	180,800 to 1 No. 1 (10)	
INTERFACE 2		1,2,3		54.	Y _{2, y} y	· · · · · · · · · · · · · · · · · · ·
LAYER 3 INTERFACE 3		and the	1 2 2 2 2 2 2 2 2 2 2 2 2 2 2 2 2 2 2 2	- 1 - 1 - 1 - 1 - 1 - 1 - 1 - 1 - 1 - 1		
LAYER 4 INTERFACE 4	3,5	3. 1 3. 3. 3. 3. 3. 3. 3. 3. 3. 3. 3. 3. 3.	7 7 7 7		á .	
MUDBALLS			ેર		2 - 4 - 1 2 - 1 - 1 - 2 - 1	
Max. Size	**:* <u>*</u>			25 - 25 - Copper	259/4 52.02	
Max. Depth		i i jar	3 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1	7. G. 188		
CONDITION	SITE 7	SITE 8	SITE 9	SITE 10	SITE 11	SITE 12
LAYER 1	Tourist Valid	< 15 X	* H	No.	X.6 (4.5)	
INTERFACE 1 LAYER 2			1-115a	5 (1) (2년 22) :	75.6AN 1 15.6294	
INTERFACE 2 LAYER 3		* * *, * *,	2009N 300 (200	* .v = 1 *		
INTERFACE 3	No. of the	20 (8)		100,00	7,7	· · · · · · · · · · · · · · · · · · ·
LAYER 4 INTERFACE 4		E maringa i na. Ng nayanga ili,	ે માટ્યું માર્ક સામાન	14/15-1 V		
MUDBALLS	رز2	igan y es	\$15. fb.8	·.		
Max, Size Min. Size			Minate A	57.54 <u>.</u>		
Max. Depth			2.385			
MEDIA CONDITION Sharpness		ADDITIONAL REM	IARKS:			
Encrustation Uniformity	7					
Committee Commit			STREET C	2		
an Director of the Confession	antiation and					
PERCENT MUDBALLS Media Volume	1.24.2	ADDITIONAL REM	IARKS:	-£		
Mudball Volume						
% Mudballs			ESMA			·······
MARKAMETER IN THE STREET	di istini ne	CONCL	USIONS 3			
CONCLUSIONS:		Na diam				
		AL ST			CORRECTIVE PLAN ATT	
						1

D. Sample Filter Assessment Report for Individual Filters from the State of Texas (Page 4)

SYSTEM NAME:			PLANT NAME		
PWS ID No.:			FILTER NUMBER:		
	FILT	ER SCHEMATIC	T 465		
PREPARE A SIMPLE FILTER SCH	EMATIC SHOWING THE LOCATIO		ER TROUGHS, OBSERVE	D ANOMOLIES, AND EXCA	VATION SITES.
				e sila	
		Fr. 1835 Node	N. 1212. 13 23. N. 124.		
	1875 m			and the second s	
	- 연합된. - 2015년:			100 100 100	
√ €					
				*	
		Y.			
,	17		i vidit er Live die Santana		
	<u> </u>				
			•		